

EASTSIDE FIRE STATION SEISMIC GRANT UPGRADE

COOS BAY FIRE DEPARTMENT



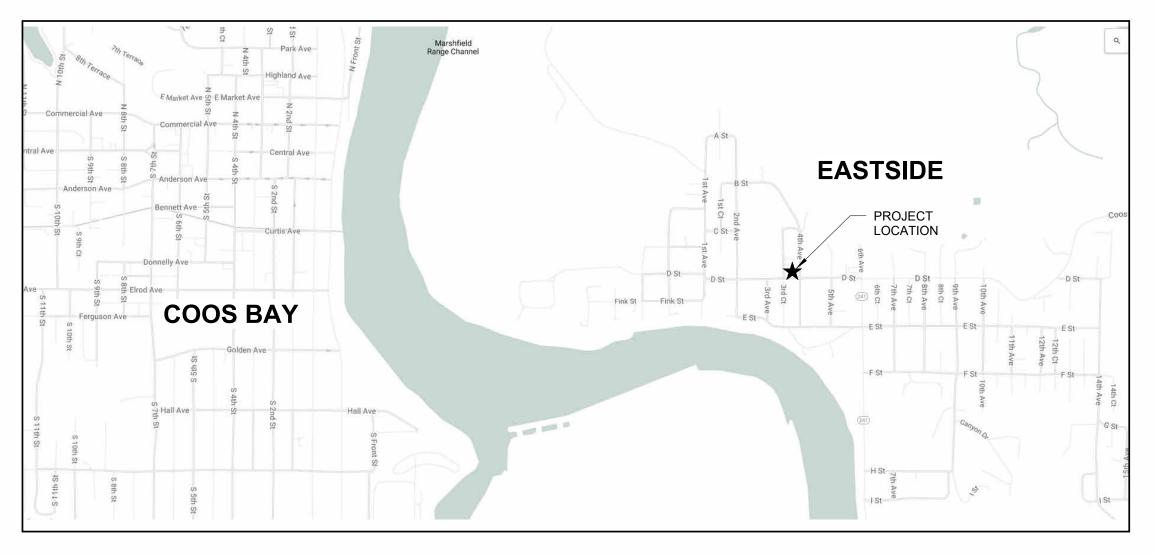

PERSPECTIVE - EXISTING

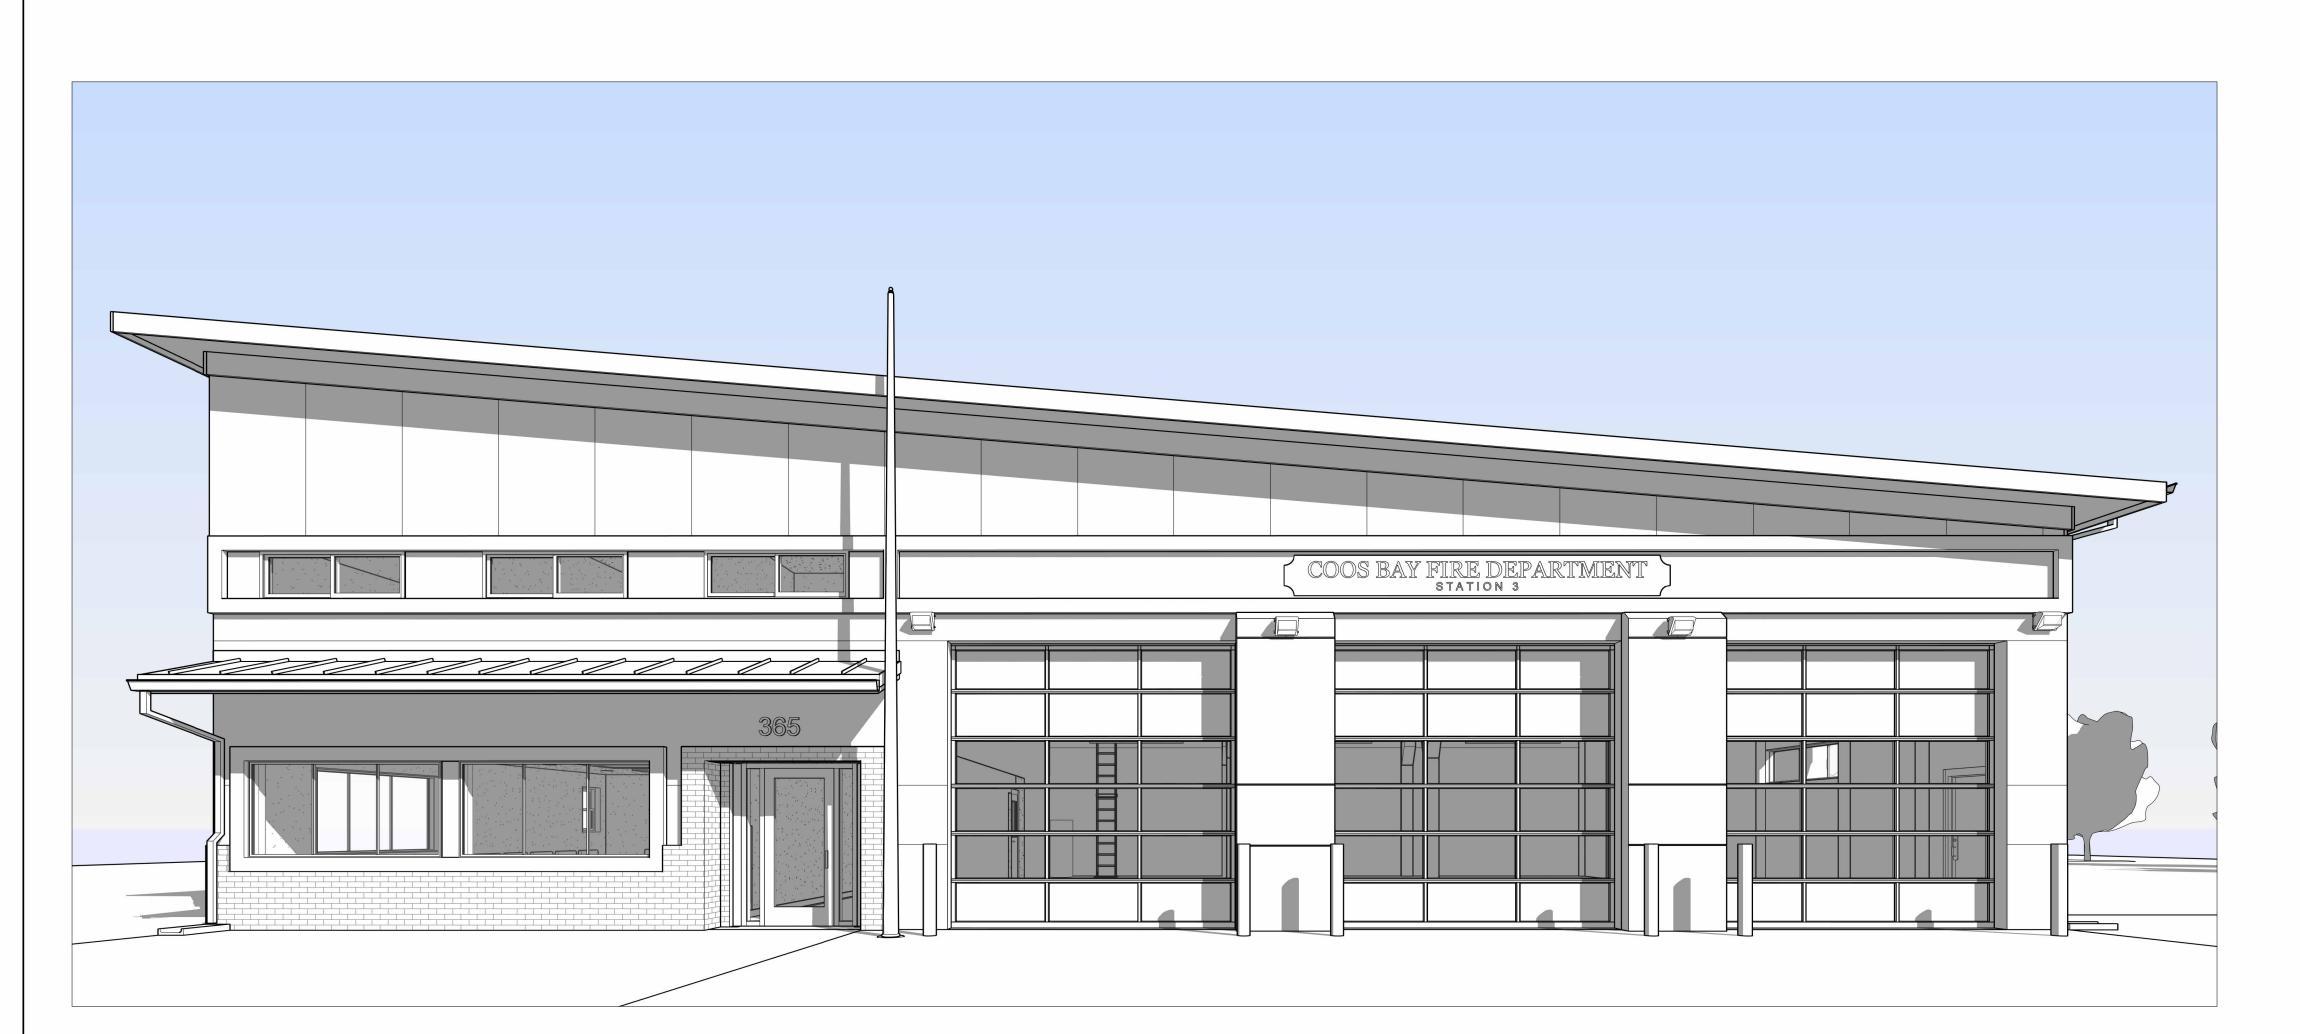

3 VICINITY MAP



PROJECT TEAM

CITY OF COOS BAY

500 CENTRAL AVE, COOS BAY, OR 97420 PHONE: (541) 269-1181 CONTACT: JÉFF ADKINS, FIRE CHIEF

HGE ARCHITECTS INC. 333 SOUTH 4TH STREET COOS BAY, OR 97420 PHONE: (541) 269-1166 CONTACT: JÓE SLACK

STRUCTURAL DCI ENGINEERS 921 SW WASHINGTON ST.

SUITE 560, PORTLAND OR, 97205 PHONE: (503) 242-2448 CONTACT: KÉVIN REYES

ELECTRICAL DOUBLE "E" ENGINEERING, 315 ASH ST. MYRTLE POINT, OR 97458 PHONE: (541) 294-0587 CONTACT: GREG PRIDE

SHEET INDEX

G0.0 COVER SHEET G0.1 CODE SUMMARY

ARCHITECTURAL DEMO

AD2.1 1ST FLOOR DEMO PLAN

AD2.2 2ND FLOOR AND ROOF DEMO PLANS

AD4.1 BUILDING ELEVATIONS DEMO

ARCHITECTURAL

A1.1 SITE PLAN

2ND FLR PLAN

A2.3 REFLECTED CEILING PLANS

A4.1 BUILDING ELEVATIONS

BUILDING DETAILS

OPENING DETAILS

STRUCTURAL

S1.1 STRUCTURAL GENERAL NOTES, LEGEND, AND

S1.2 STRUCTURAL GENERAL NOTES CONTINUED

STRUCTURAL SPECIAL INSPECTIONS

STRUCTURAL FIRST FLOOR FOUNDATION PLAN STRUCTURAL SECOND FLOOR FRAMING PLAN

S2.4 STRUCTURAL UPPER ROOF FRAMING PLAN

S4.1 STRUCTURAL FOUNDATION DETAILS

S6.0 STRUCTURAL WOOD FRAMING DETAILS

S7.0 STRUCTURAL FRAMING DETAILS

ELECTRICAL

E1.0 ELECTRICAL PLAN SYMBOLS & SCHEDULES

E1.1 ELECTRICAL PLAN DEMOLITION

E2.0 ELECTRICAL PLAN LIGHTING

E3.0 ELECTRICAL PLAN POWER & DATA

GENERAL

G0.2 GENERAL INFORMATION

A2.1 1ST FLR PLAN

A2.4 ROOF PLAN

A3.1 BUILDING SECTIONS

BUILDING ELEVATIONS

INTERIOR ELEVATIONS

SCHEDULES

ABBREVIATIONS

S2.3 STRUCTURAL LOW ROOF FRAMING PLAN

S3.1 STRUCTURAL ELEVATIONS

S3.2 STRUCTURAL ELEVATIONS

S4.2 FOUNDATION DETAILS

S5.1 STRUCTURAL FRAMING DETAILS

JOSEPH A. SLACK

ARCHITECTS,

333 S. 4TH STREET COOS BAY, OR 97420

P: 541.269.1166 general@hge1.com

www.hge1.com

UPGR/ GR **EISMIC** ATION FIRE

STSIDE OF COOS BAY


CONSTRUCTION **REVISIONS:** # DATE DESCRIPTION


MAY 2025

SHEET TITLE: **COVER SHEET**

G0.0

OCCUPANT LOAD SCHEDULE								
ROOM NUMBER	ROOM NAME	AREA	FUNCTION OF SPACE	OCCUPANT LOAD FACTOR	OCCUPANTS PER ROOM			
3	CONFERENCE	508 SF	В	15	34			
22	DAY ROOM	665 SF	В	150	5			
23	KITCHEN	136 SF	В	150	1			
B: 3		1309 SF			40			
25	DORM 1	110 SF	R-2	200	1			
26	DORM 2	113 SF	R-2	200	1			
27	DORM 3	111 SF	R-2	200	1			
R-2: 3		334 SF			3			
6	STORAGE	170 SF	S-1	300	1			
7	STORAGE	163 SF	S-1	300	1			
8	APPARATUS BAY	2325 SF	S-1	300	8			
S-1: 3	1	2657 SF	2657 SF					
GRAND TOT	AL	4300 SF	4300 SF					

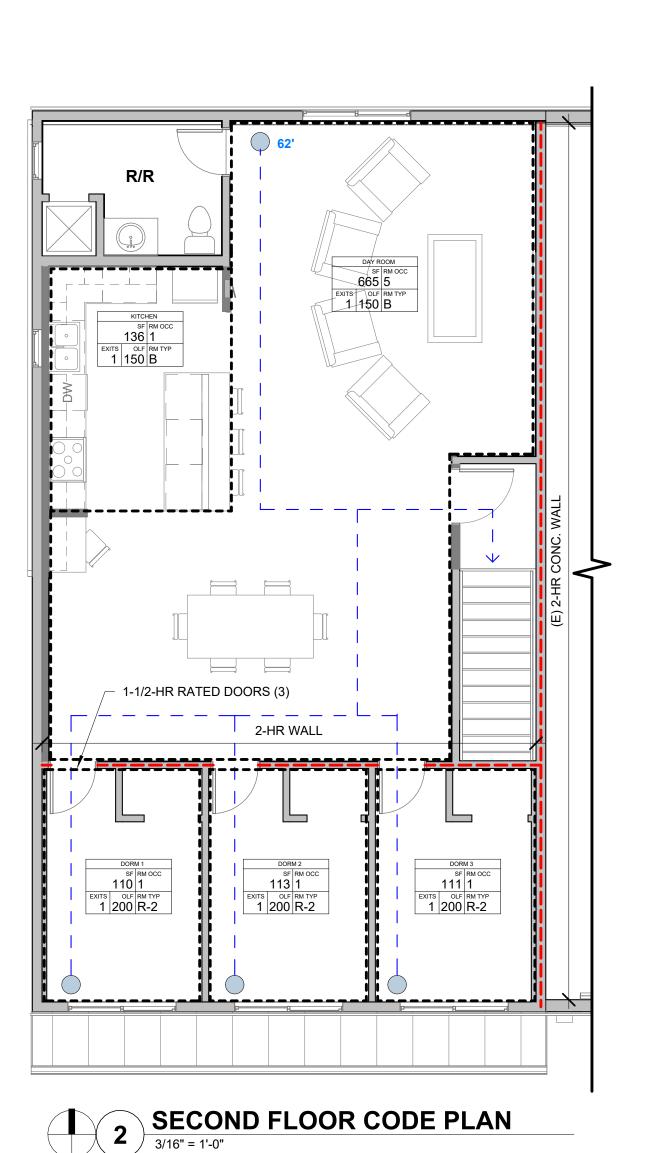

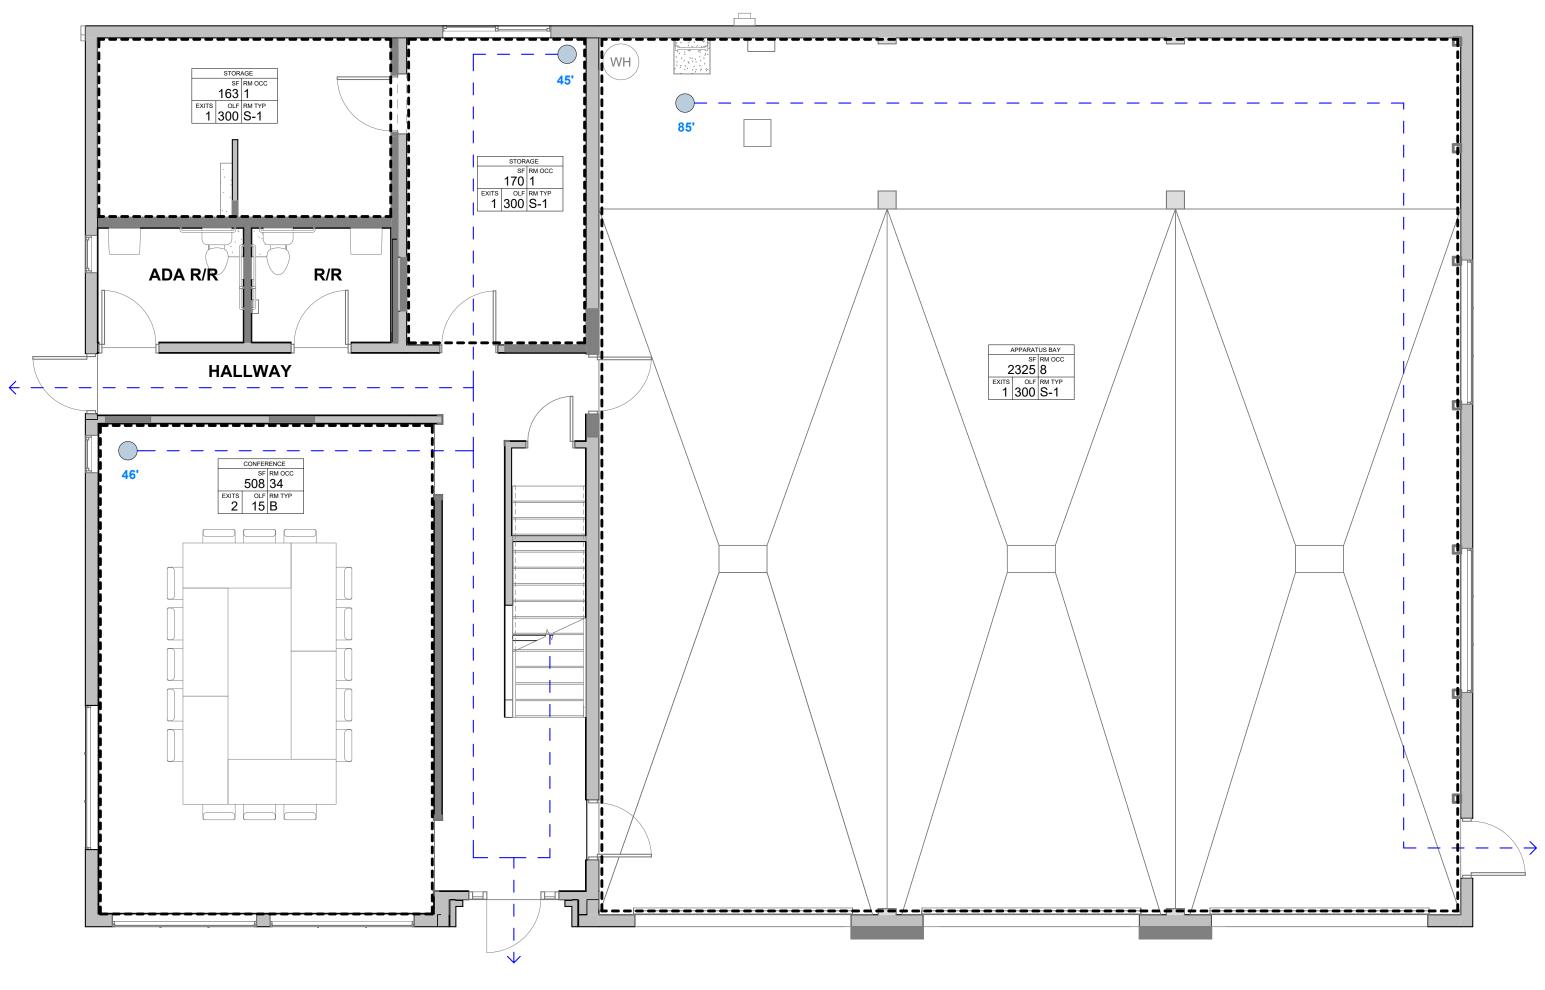

FIRST FLOOR CODE PLAN
3/16" = 1'-0"

CODE SUMMARY

APPLICABLE CODES:

2022 OREGON STRUCTURAL SPECIALTY CODE (OSSC) COOS BAY MUNICIPAL CODE (CBMC): CHAPTER 17.235 INDUSTRIAL-COMMERCIAL DISTRICT

CONSTRUCTION TYPE (TABLE 601):

TYPE III B, NON-SPRINKLERED (NON COMBUSTIBLE EXTERIOR WALLS)

BUILDING AREA (GROSS SQUARE FEET):

EXISTING: 1ST FLOOR 3,840 SF

1,425 SF 5,265 SF 2ND FLOOR

PROPOSED: NO INCREASE OF BUILDING AREA

OCCUPANCY CLASSIFICATIONS (CHAPTER 3):

BUSINESS (OFFICES & ASSOCIATED SPACES) S-1 STORAGE (APPARATUS BAY) R RESIDENTIAL (DORMS, DAYROOM)

OCCUPANCY SEPARATIONS (TABLE 508.4):

B / S-1: NO SEPARATION REQUIRED B / R: 2-HR SEPARATION REQUIRED (NON-SPRINKLERED)

S-1 / R: 2-HR SEPARATION REQUIRED (NON-SPRINKLERED)

NOTE: NO CHANGE IN OCCUPANCY. EXISTING ASSEMBLIES ARE TO BE MAINTAINED. 2-HR RATED WALLS TO BE PROVIDED BETWEEN DORM ROOMS & BUSINESS OCCUPANCY. INCREASING FIRE RATING OF EXISTING FLOOR ASSEMBLY IS COST PROHIBITIVE.

ALLOWABLE BUILDING HEIGHTS & AREAS: TYPE III B, NON-SPRINKLERED, MOST STRINGENT OCCUPANCY TYPE

HEIGHT (TABLE 504.3) ALLOWABLE: 55 FT

(ALLOWABLE HEIGHT PER CITY OF COOS BAY, ZONE I-C: 35 FT) REMODEL: 24' - 9"; OK

STORIES (TABLE 504.4) ALLOWABLE: 2

ACTUAL: 2; OK (NO CHANGE)

AREA (TABLE 506.2)

ALLOWABLE: 19,000 SF ACTUAL: 5,265 SF; OK

TRAVEL DISTANCE MAXIMUM (TABLE 1017.2): MOST STRINGENT OCCUPANCY TYPE:

PLUMBING FIXTURES (TABLE 2902.1): BUILDING CLASSIFICATION: BUSINESS

TOILETS: 1 PER 25 FOR THE FIRST 50, THEN 1 PER 50 1 PER 40 FOR THE FIRST 80, THEN 1 PER 80 LAVATORIES:

DRINKING FOUNTAINS: NONE

TOTAL OCCUPANTS: REQUIRED:

3 TOILETS, 3 LAVS 3, TOILETS, 3 LAVS, 1 SHOWER; OK ACTUAL:

INSULATION VALUES: ROOF: R-38, 12"-THICK BATT INSULATION WALLS: R-21, 5-1/2"-THICK BATT INSULATION

ROOF VENTING

BUILDING AREA: 3,850 SQ. FT.

REQUIRED VENTING @ 1/150 = 25.66 SQ. FT. REQUIRED VENTING @ 1/300 = 12.83 SQ. FT. 6.42 SQ. FT. UPPER; 6.42 SQ. FT. LOWER

LOWER VENTING REQ: 50'-0" LINEAR VENT


- 6.42 SQ. FT. REQ'D VENTING AREA REQUIRED VENT WIDTH: 0.13 SQ. FT. / LINEAR FT.
- = 19 SQ. IN. / LINEAR FT.
- ACTUAL: 20 SQ. IN. / LINEAR FT. (6"-WIDE VENT)

UPPER VENTING REQ:

- 50'-0" LINEAR VENT 6.42 SQ. FT. REQ'D VENTING AREA
- REQUIRED VENT WIDTH: 0.13 SQ. FT. / LINEAR FT. = 19 SQ. IN. / LINEAR FT.
- ACTUAL: 20 SQ. IN. / LINEAR FT. (6"-WIDE VENT

(RESULTING IN 50% UPPER VENTING & 50% LOWER VENTING)

ROOM CODE LABEL

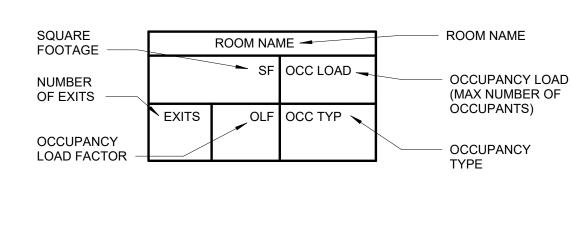


TRAVEL PATH OCCUPANCY BOUNDARY -----

FIRE-RATED WALL

Copyright © 2025 HGE ARCHITECTS, Inc.

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com

www.hge1.com



(<u>D</u> IRE

ASTSIDE
TY OF COOS BAY

CONSTRUCTION **REVISIONS:** # DATE DESCRIPTION

MAY 2025 SHEET TITLE:

CODE SUMMARY

G0.1

LEGEND - PLAN SYMBOLS

BUILDING SECTION SYMBOL SYMBOL EXTERIOR ELEVATION SYMBOL INTERIOR ELEVATION $\langle 4.XXX \rangle$ DOOR TAG IDENTIFICATION ROOM NAME ROOM NAME AND NUMBER 000 WALL TAG WINDOW TAG FIRE EXTINGUISHER - SURFACE MOUNT FIRE EXTINGUISHER CABINET AND FIRE EXTINGUISHER - SEMI-RECESSED FD 🖸 FLOOR DRAIN LEVEL OR SPOT ELEVATIONS

CEILING HEIGHT & FINISH

ABBREVIATIONS



D DBL DET DF DIA DIAG DIM DIR DIV DM DN DO DR DRWR DS DWG DWL DWS	DEPTH DOUBLE DETAIL DRINKING FOUNTAIN DIAMETER DIAGONAL DIMENSION DIRECTION DIVISION DE-MOUNTABLE PARTITION DOWN DITTO DOOR DRAWER DOWNSPOUT DRAWING DOWEL DEFORMED WELDED STUD	FA FV FD FDN FE FEC FIN FIX FLR FLRG FOS FP FR FS FT FTG FURG	FOUNDATION FIRE EXTINGUISHER FIRE EXTINGUISHER CABINET FIRE HOSE CABINET FINISH FIXTURE FLEXIBLE FLOOR FLOORING FACE OF STUD FIREPROOF/FIRE PROTECTION FIRE RETARDANT FULL SIZE/FULL SCALE
EA EC EF EH HOOD EJ EL ELEC ELEV EMBED EMER ENT EQ EQUIP ES ESR ETR EVC EW	ELEVATOR/ELEVATION EMBEDDED EMERGENCY ENTRANCE EQUAL EQUIPMENT EMERGENCY SHOWER ELASTOMERIC SHEET ROOFING	GA GAL GALV GB GC GEN GFCI GFGI GFRC GFRG GL GLB GMU GWB GYP	GAUGE GALLON GALVANIZED GRAB BAR GENERAL CONTRACTOR GENERAL GOVERNMENT FURNISHED, CONTRACTOR INSTAI
EW EWC EXC EXP EXPD EXPF EXT	EACH WAY ELECTRIC WATER COOLER EXCAVATE EXPANSION EXPOSED EXPLOSION PROOF EXTERIOR	H HDBD HDCP HDG HDWD HDWE HK HM HP HR HT HVAC HWS	HEIGHT HARDBOARD HANDICAPPED HOT DIPPED GALVANIZED HARDWOOD HARDWARE HOOK HOLLOW METAL HIGH POINT HANDRAIL HEIGHT HEATING VENTILATION AND AIR CONDITIONING HEAD WELDED STUDS
			NODE DIAMETED

	JAN JS JST JT	JANITOR JANITOR SINK JOIST JOINT
	KD KO	KNOCKED DOWN KNOCK-OUT / KNEE OPENING
ALLED ALLED	LAM LB LBS LD LDG LF LG LGT LKR LLH LLV LONG LP LSH LSL LTG LVL LVR	LENGTH LABORATORY LAMINATED POUND POUNDS LINEAR DIFFUSER LANDING LINEAR FOOT LONG LIGHT LOCKER LONG LEG HORIZONTAL LONG LEG VERTICAL LONGITUDINAL LOW POINT LONG SLOTTED HOLE LAMINATED STRAND LUMBER LIGHTING LAMINATED VENEER LUMBER LOUVER LIGHTWEIGHT CONCRETE
	MAN MAR MAS MATL	MACHINE MANUAL MARBLE MASONRY MATERIAL MAXIMUM MACHINE BOLT MASONRY BEARING WALL MECHANICAL CONTRACTOR MEDIUM DENSITY OVERLAY MECHANICAL MEMBRANE METAL MEZZANINE MANUFACTURER MINIMUM MIRROR MISCELLANEOUS MARK METAL LATH MOLDING MASONRY OPENING METAL PARTITION MACHINE SCREW MOUNTED MOUNTING

T & B TOP AND BOTTOM **NOT APPLICABLE** NIC **NOT IN CONTRACT** TACKBOARD/TOWEL BAR NO TO BE REMOVED TCP NOM THIN COAT PLASTER NOMINAL NS NON-SHRINK TD TOWEL DISPENSER NTS NOT TO SCALE TOWEL DISPENSER AND WASTE NORMAL WEIGHT CONCRETE TEMP TEMPERATURE/TEMPERED NWC TER TERRAZZO TEX TEXTURE OVERALL TFC TROWELED FLOOR COVERING OC ON CENTER T & G TONGUE AND GROOVE **OUTSIDE DIAMETER/OVERFLOW DRAIN** OD THK THICK OFF TJI TRUSS JOIST I-JOIST OFFICE OPNG OPENING TOP OF BEAM OPP OZ TOC TOP OF CURB/TOP OF CONCRETE OPPOSITE TOP OF DECK/TOP OF DUCT ELEVATION OUNCE TOF TOP OF FOOTING TOG TOP OF GRATE PARTITION TOP OF JOIST TOP TOP OF PIPE ELEVATION PIECE TOS PCC PRECAST CONCRETE TOP OF SLAB/TOP OF STEEL PORTLAND CEMENT PLASTER TOP OF WALL PAPER TOWEL DISP. & WASTE RECEPTACLE TPG PDWR TOPPING TOILET PAPER HOLDER PHILLIPS HEAD/PHASE PH PLATE/PROPERTY LINE TRANSOM TRANS TRANSVERSE PLAM PLASTIC LAMINATE TS TUBE STEEL PLAS PLASTER THREADED WELDED STUD PLBG PLUMBING TYP TYPICAL PLYWD PLYWOOD PROTECTED METAL UNDERGROUND PANEL PNLG PANELING UNO UNLESS NOTED OTHERWISE POL POLISHED URINAL PR PRE FAB PREFABRICATED PRE FIN PRE-FINISHED POUNDS PER SQUARE FOOT VINYL BASE PSI POUNDS PER SQUARE INCH VCT PT POINT/PAINT VERT PAINTED/PAINT VEST PAINT TO MATCH PVC VOL POLYVINYL CHLORIDE QT **QUARRY TILE** QTY QUANTITY RADIUS WAF ROOFTOP AIR HANDLING UNIT WC RB RUBBER BASE WD REINFORCED CONCRETE WDW RADIANT CEILING PANEL WG / REFLECTED CEILING PLAN ROOF DRAIN W/O REC RECESSED REF REFERENCE REINFORCING REL RELOCATE REM REMAINDER WSCT REQD REQUIRED WSTP RES RESILIENT RET RETURN **ROUGH IN** RM ROOM RO **ROUGH OPENING** RT RUBBER TILE RUB RUBBER SELF ADHESIVE MEMBRANE FLASHING SAT STANDARD AGGREGATE TOPPING SAWRB SELF ADHESIVE WEATHER RESTISTANT BARRIER SB SC SOIL BEARING SEAMLESS COATING SCF SPECIAL CONCRETE FINISH

SCHD

SD

SE

SF

SG SGL

SH

SHT

SIM

SLV

SM

SPEC

SPR

SS ST

STD

STL

STO

STRU

SUSP

SV

SJ

SCHEDULE

SOAP DISPENSER

SUPPLY AIR GRILLE

SHORT LEG VERTICAL

SANITARY NAPKIN DISPENSER

SANITARY NAPKIN VENDER

STRUCTURAL/STRUCTURE

SHELF EDGE SECTION

SAND FLOAT

SHOWER DOOR

SINGLE

SHELF

SHEET

SIMILAR

SMOOTH

STEEL JOIST

SLAB ON GRADE

SPECIFICATION

SHOWER ROD

STAINLESS STEEL

SPRINKLER

SQUARE

STREET

STEEL


STANDARD


STORAGE


SUSPENDED


SHEET VINYL SYMMETRICAL

VINYL COMPOSITION TILE VERTICAL VESTIBULE VERIFY IN FIELD VOLUME VWC VINYL WALL COVERING WIDE FLANGE STEEL BEAM WITH WELDED ANGLE FRAME WATER CLOSET WOOD WINDOW WIDE FLANGE WIRE GLASS WITHOUT WEATHERPROOF WATERPROOFING WASTE RECEPTACLE WEATHER RESTISTANT BARRIER WAINSCOT WEATHERSTRIP WTR WATER WELDED WIRE FABRIC X EXISTING

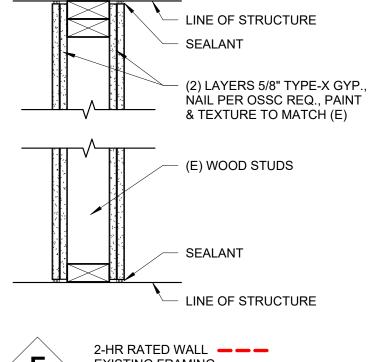



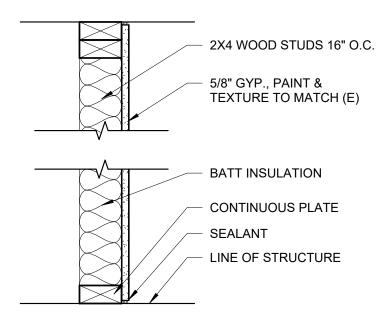

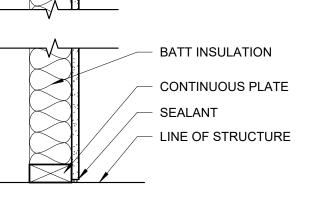

CONTR

CORR

CPT

CSG

CTR

CTSK

CR

CT

CONTRACTOR

CERAMIC TILE

COUNTERSUNK

COLD WATER

CENTER/COUNTER


CABINET UNIT HEATER


COAT RACK/CURTAIN ROD

CORRIDOR


CARPET

CASING

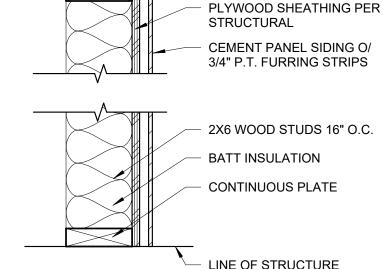

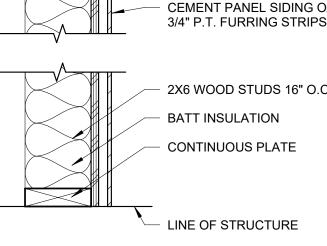

LINE OF STRUCTURE

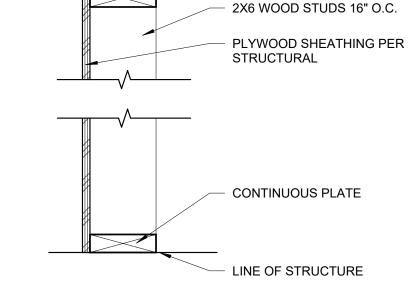

B 2X6 PONY WALL

INSIDE DIAMETER

INCHES

INT

INFORMATION

INSULATION

INTERIOR

INSULATED METAL PANEL

INSULATED PLENUM WALL

INSULATED ROOF FILL



LINE OF STRUCTURE

5/8" GYP., PAINT &

BATT INSULATION

LINE OF STRUCTURE

CONTINUOUS PLATE

16" O.C.

SEALANT


FURR OUT TO MATCH (E) WHERE OCCURS

INTERIOR PARTITION 5/8" GWB ON BOTH SIDES,

MATCH (E)-

TEXTURE TO MATCH (E)


FROM 2X8 WOOD STUDS

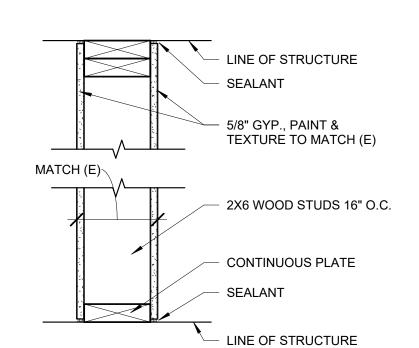

INTERIOR PARTITION


5/8" GWB ON BOTH SIDES,


FURR OUT TO MATCH (E) WHERE OCCURS

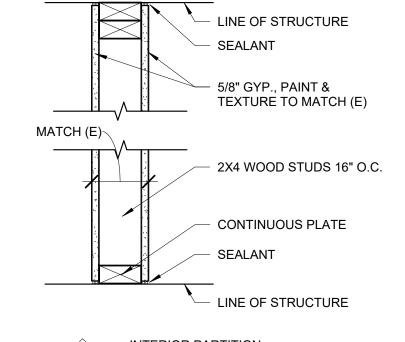



INTERIOR PARTITION 5/8" GWB ON BOTH SIDES, FURR OUT TO MATCH (E) WHERE OCCURS

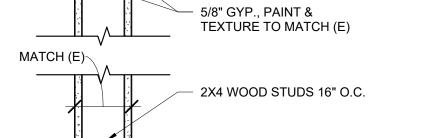




ABBREVIATIONS ABOVE ARE FOR ARCHITECTURAL SHEETS ONLY.



333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com



(۵ (<u>D</u> S S 0 $\overline{\mathbb{R}}$ TSIDE COOS BAY


က မ

CONSTRUCTION **REVISIONS:** # DATE DESCRIPTION

DATE: MAY 2025

SHEET TITLE: GENERAL INFORMATION

G0.2

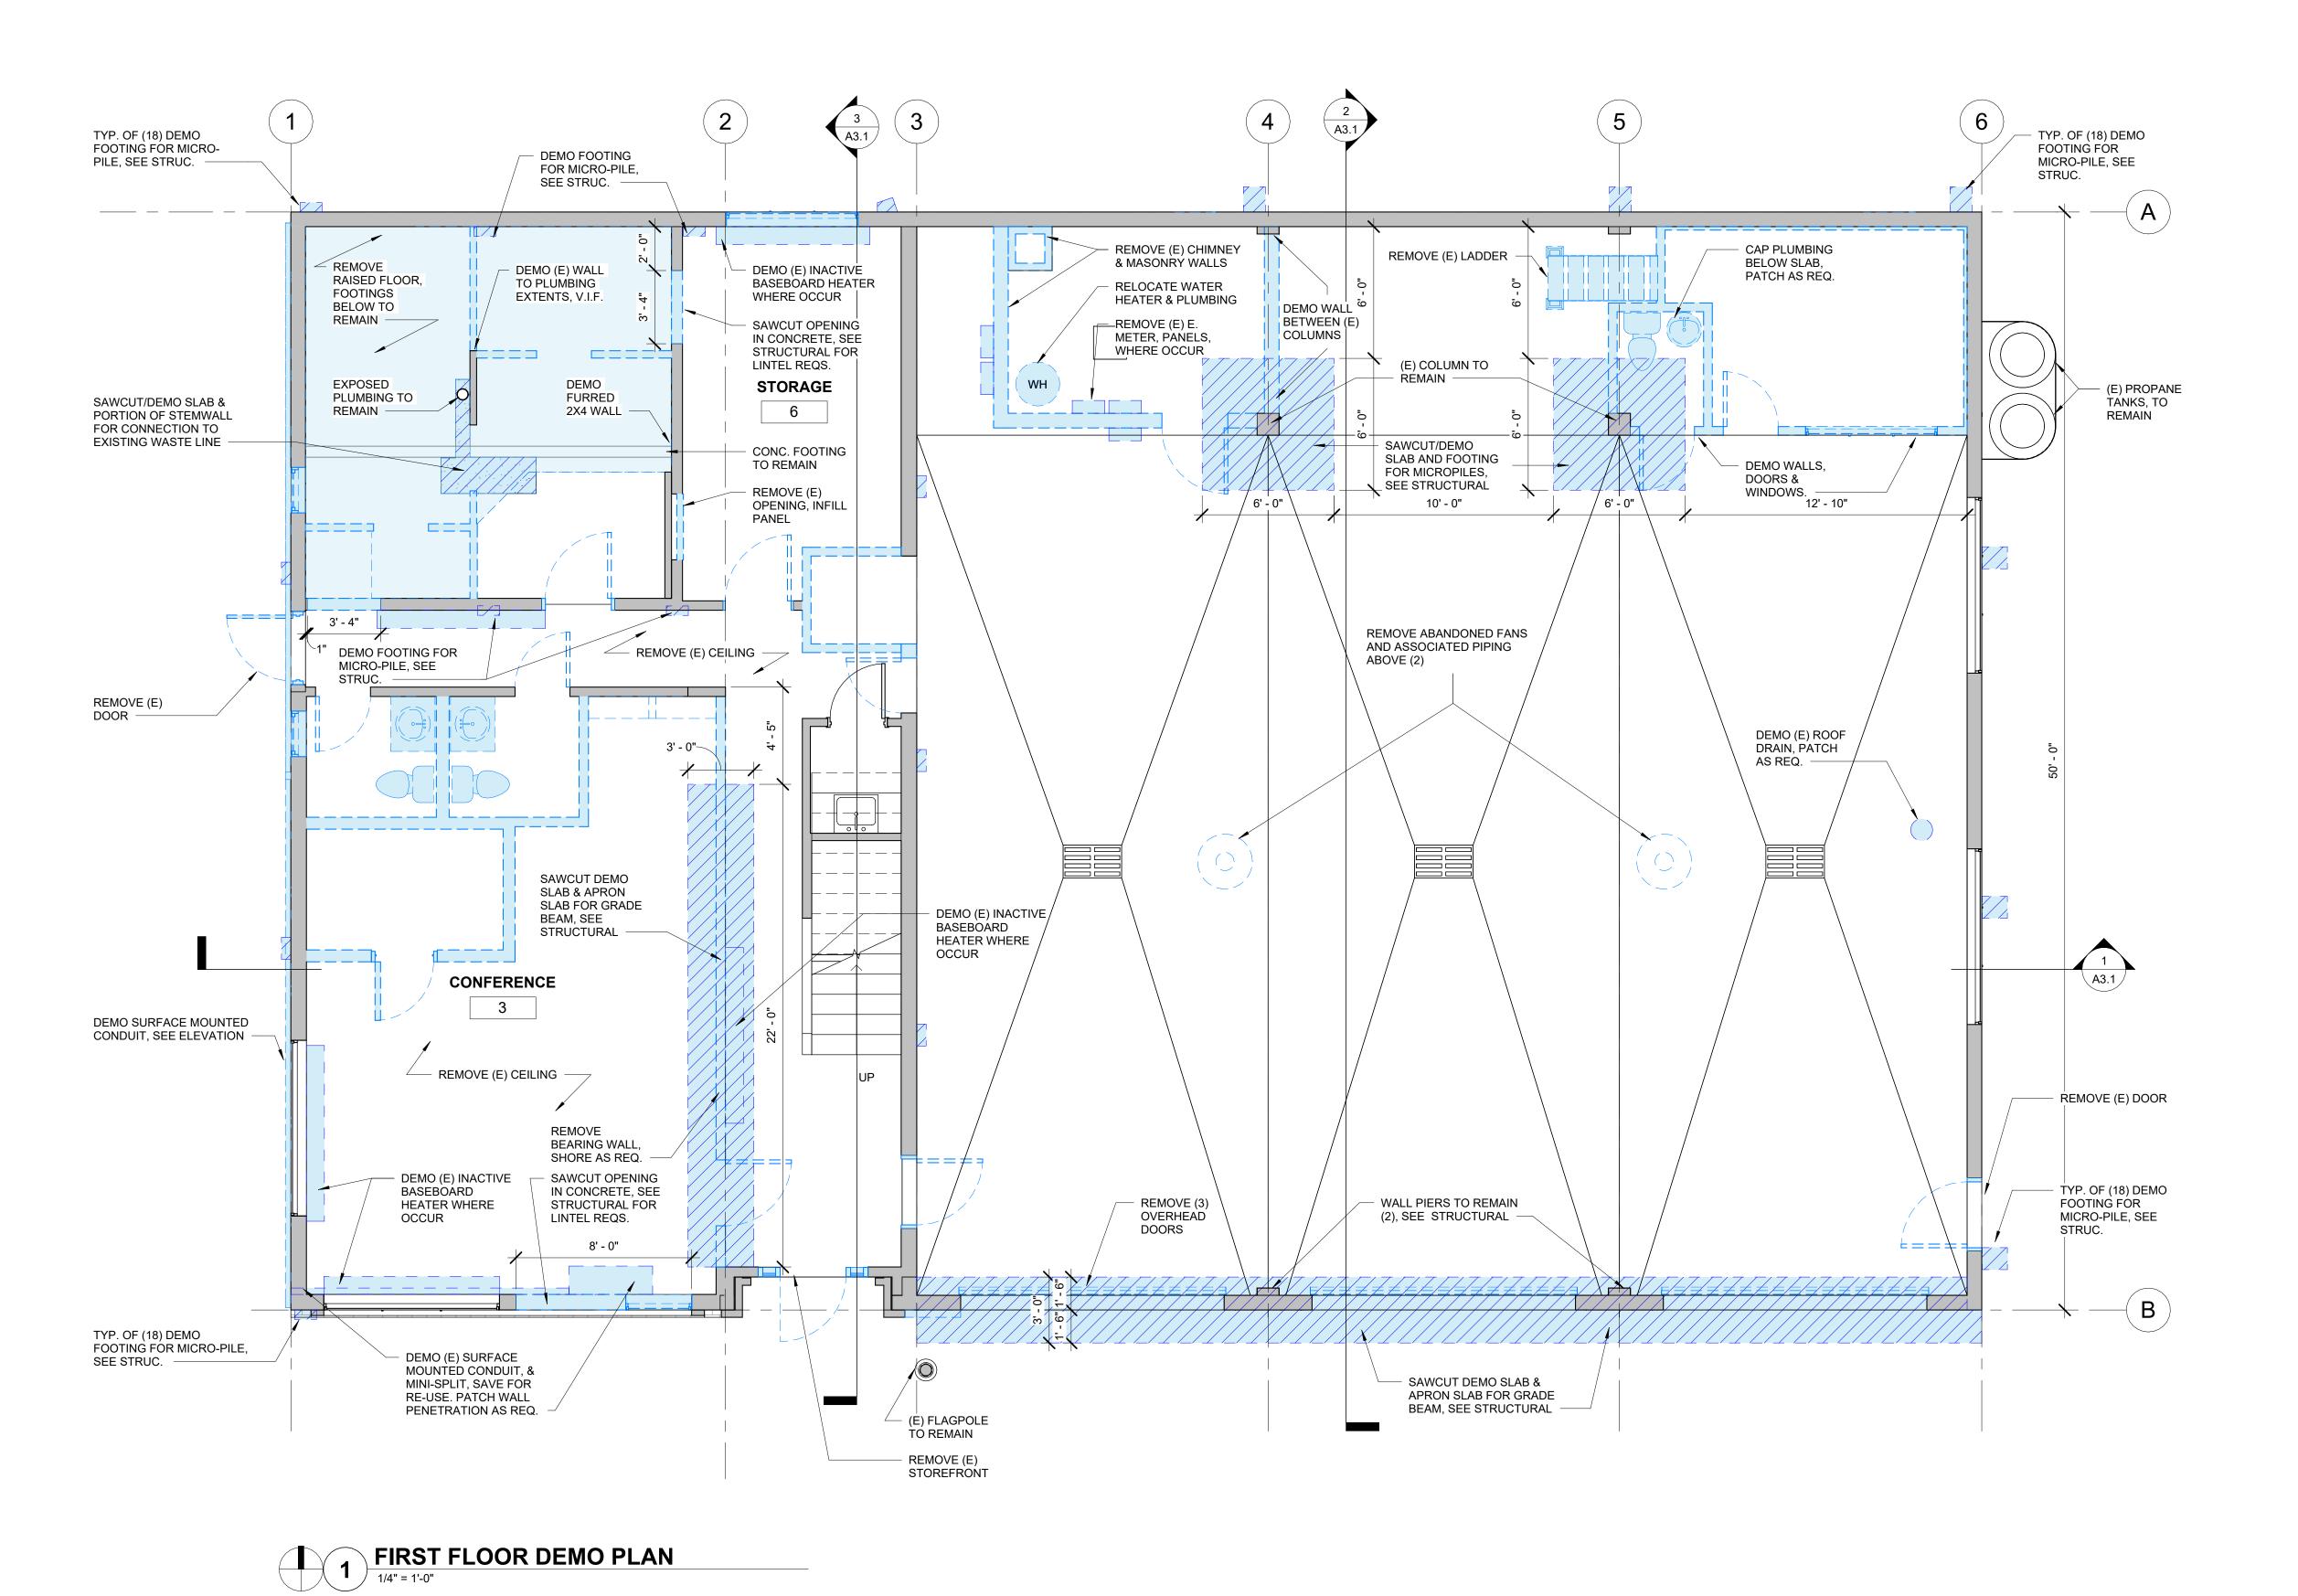

DEMO PLAN LEGEND

DEMO WALL / DOOR / WINDOW, ____ EQUIPMENT (E) WALLS TO REMAIN

DEMO SLAB

DEMO PLAN GENERAL NOTES

- THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL DIMENSIONS. SITE GRADES, ETC., IN FIELD PRIOR TO CONSTRUCTION AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES IN THE DRAWINGS AND ACTUAL FIELD CONDITIONS PRIOR TO START OF WORK.
- ANY FIELD CONDITIONS NOT CALLED OUT ON THE ARCHITECTURAL PLANS ARE TO BE COORDINATED WITH THE CONTRACTOR, ARCHITECT, OWNER, AND OTHERS AS NECESSARY IN THE FIELD.
- CONTRACTOR TO PROTECT AREAS AND SURFACES ADJACENT TO THE CONSTRUCTION AREA FROM DAMAGE AND DEBRIS. ALL AREAS ARE TO BE CLEAN AND SERVICEABLE AT THE COMPLETION OF DEMOLITION, PRIOR TO COMMENCEMENT OF NEW CONSTRUCTION



333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com



GR **ISMIC** S NOL FIRE ASTSIDE
TY OF COOS BAY

CONSTRUCTION

REVISIONS: # DATE DESCRIPTION

PLAN

MAY 2025 SHEET TITLE: **1ST FLOOR DEMO**

AD2.1

DEMO PLAN LEGEND


DEMO WALL / DOOR / WINDOW, EQUIPMENT

(E) WALLS TO REMAIN

DEMO SLAB

DEMO PLAN GENERAL NOTES

- 1. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL DIMENSIONS. SITE GRADES, ETC., IN FIELD PRIOR TO CONSTRUCTION AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES IN THE DRAWINGS AND ACTUAL FIELD CONDITIONS PRIOR TO START OF WORK.
- 2. ANY FIELD CONDITIONS NOT CALLED OUT ON THE ARCHITECTURAL PLANS ARE TO BE COORDINATED WITH THE CONTRACTOR, ARCHITECT, OWNER, AND OTHERS AS NECESSARY IN THE FIELD.
- 3. CONTRACTOR TO PROTECT AREAS AND SURFACES
 ADJACENT TO THE CONSTRUCTION AREA FROM DAMAGE
 AND DEBRIS. ALL AREAS ARE TO BE CLEAN AND
 SERVICEABLE AT THE COMPLETION OF DEMOLITION, PRIOR
 TO COMMENCEMENT OF NEW CONSTRUCTION

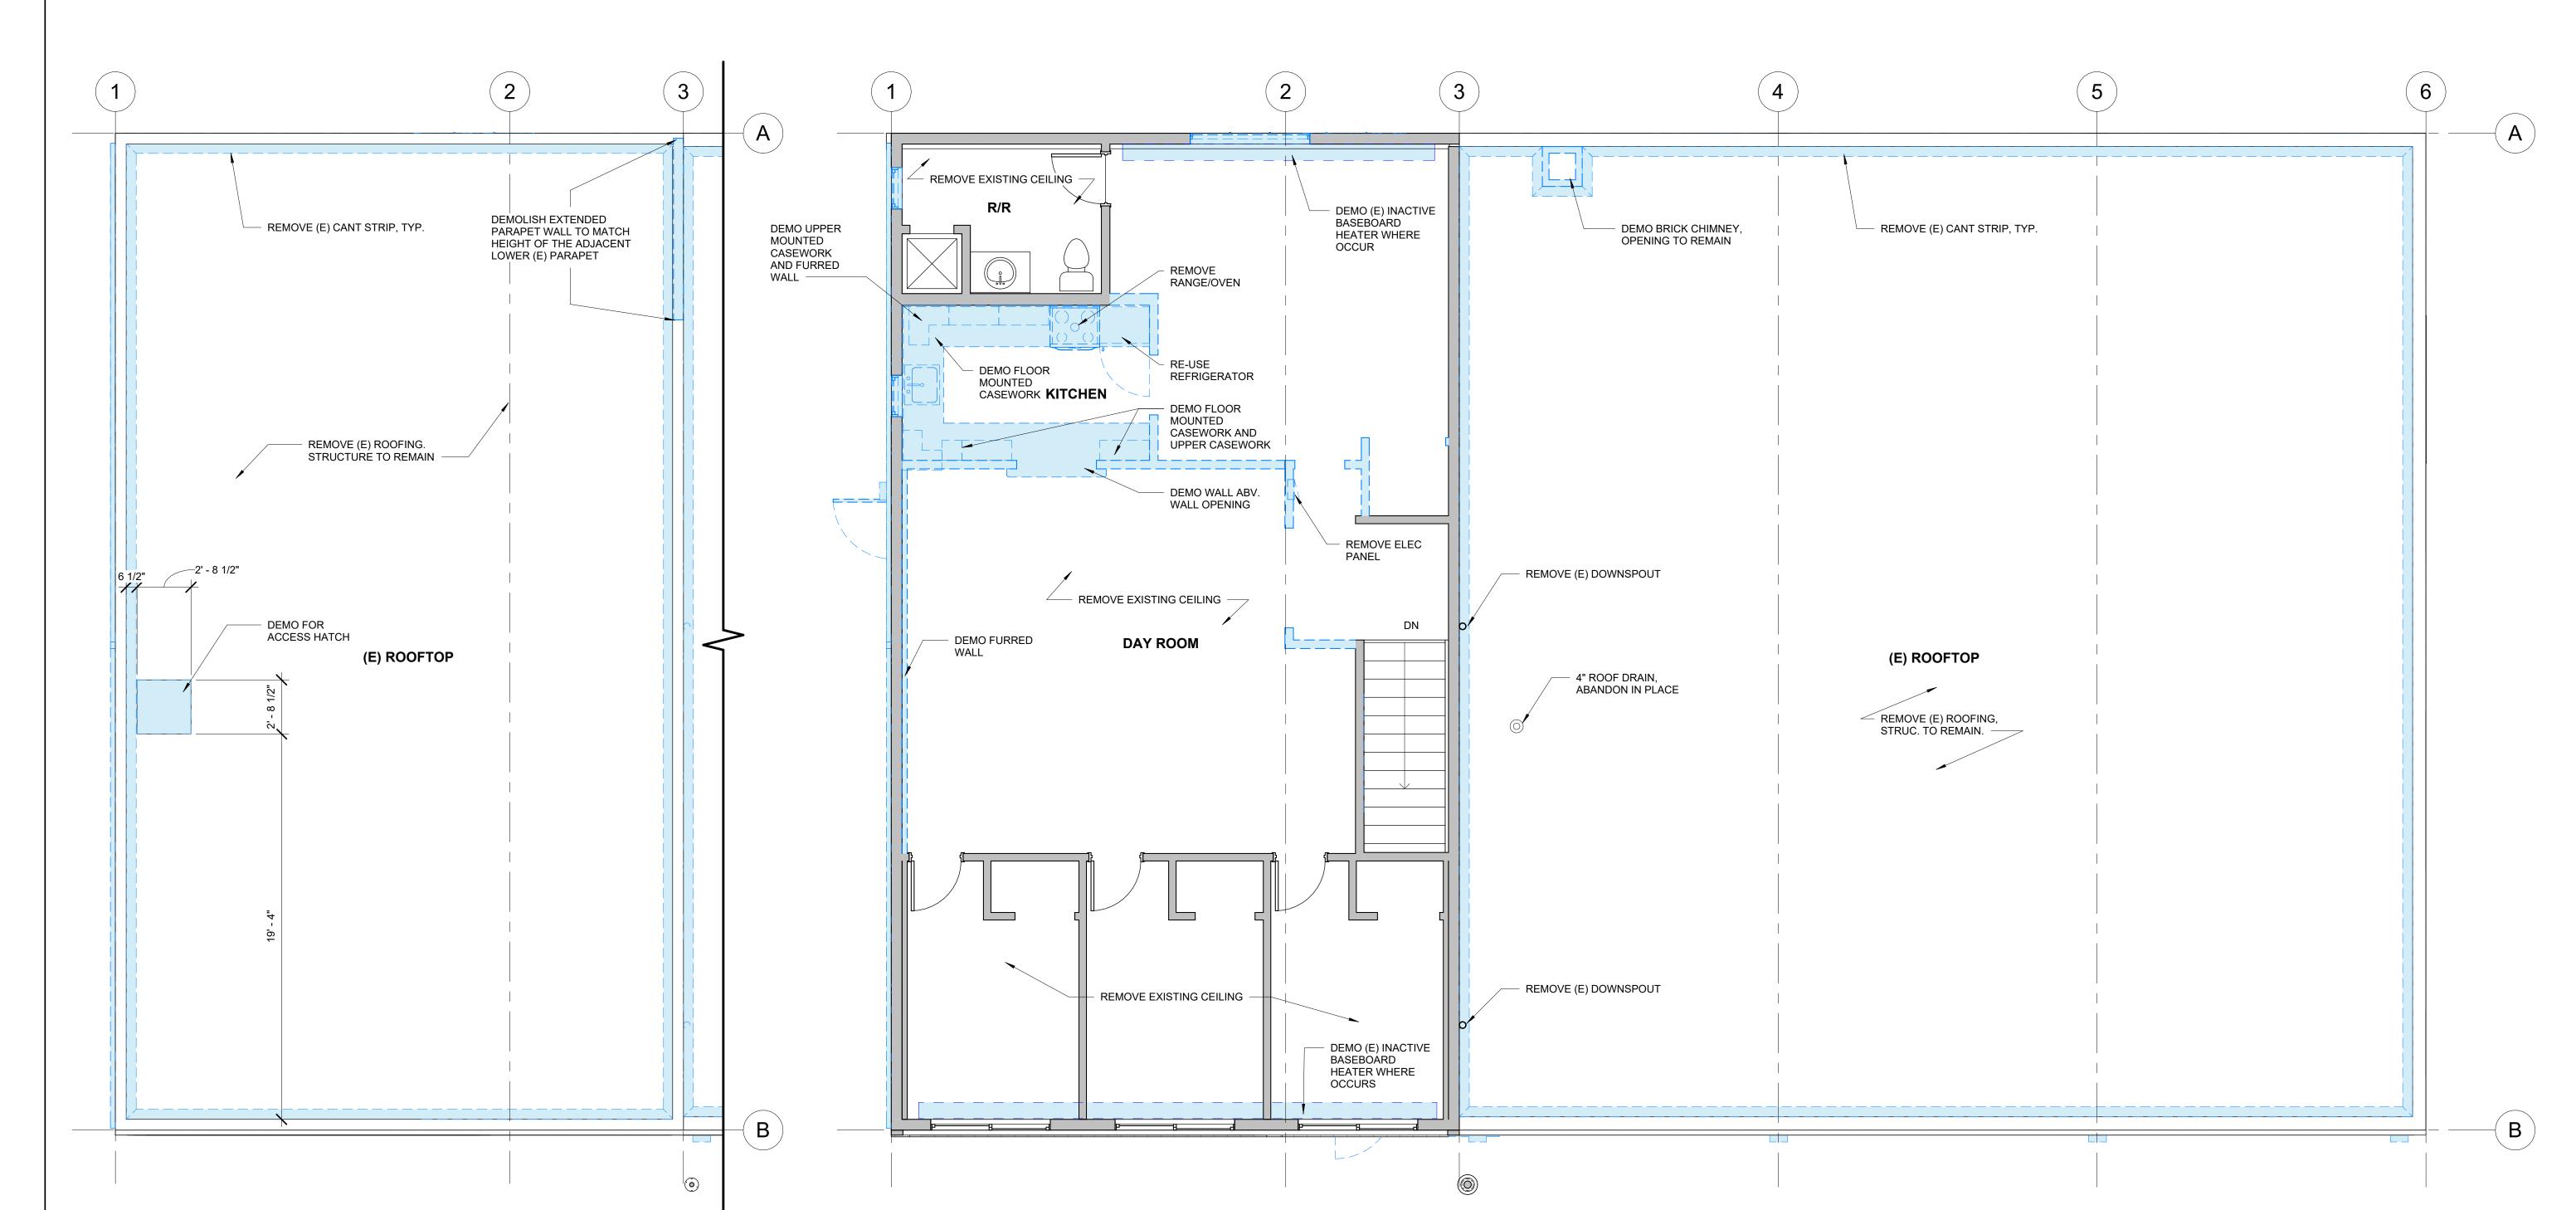

ROOF DEMO PLAN

1/4" = 1'-0"

SECOND FLOOR DEMO PLAN

1/4" = 1'-0"

HGE ARCHITECTS

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com

JOSEPH A. SLACK

COOS BAY, OREGON

OF OR

STSIDE FIRE STATION SEISMIC GRANT UPGRADE

PROJECT NO.: 22.22.2

SASTINE FIRE
CITY OF COOS BAY
365 D ST,
COOS BAY OR 97420

REVISIONS: # DATE DESCRIPTI

DATE DESCRIPTION


E: MAY 2025

SHEET TITLE:

2ND FLOOR AND
ROOF DEMO PLANS

AD2.2





SIDE FIRE STATION SEISMIC GRANT UPGRADE

EASTSIDE FIRE STAT

CITY OF COOS BAY

COOS BAY, OR 97420

CONSTRUCTION

REVISIONS:
DATE DESCRIPTION

DATE: MAY 2025

SHEET TITLE:
BUILDING
ELEVATIONS DEMO

AD4.1



(E) ASPHALT

2'-0" TOPO LINES

— SANITARY MAINLINE

PLANTER / LANDSCAPING

POLE MOUNTED SITE LIGHTING

PARKING COUNT PER PARKING SPACE CLUSTER

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com

ADE GRANT SEISMIC STATION FIRE EASTSIDE I CITY OF COOS BAY 365 D ST, COOS BAY, OR 97420


CONSTRUCTION

REVISIONS: # DATE DESCRIPTION

MAY 2025

SHEET TITLE: SITE PLAN


A1.1

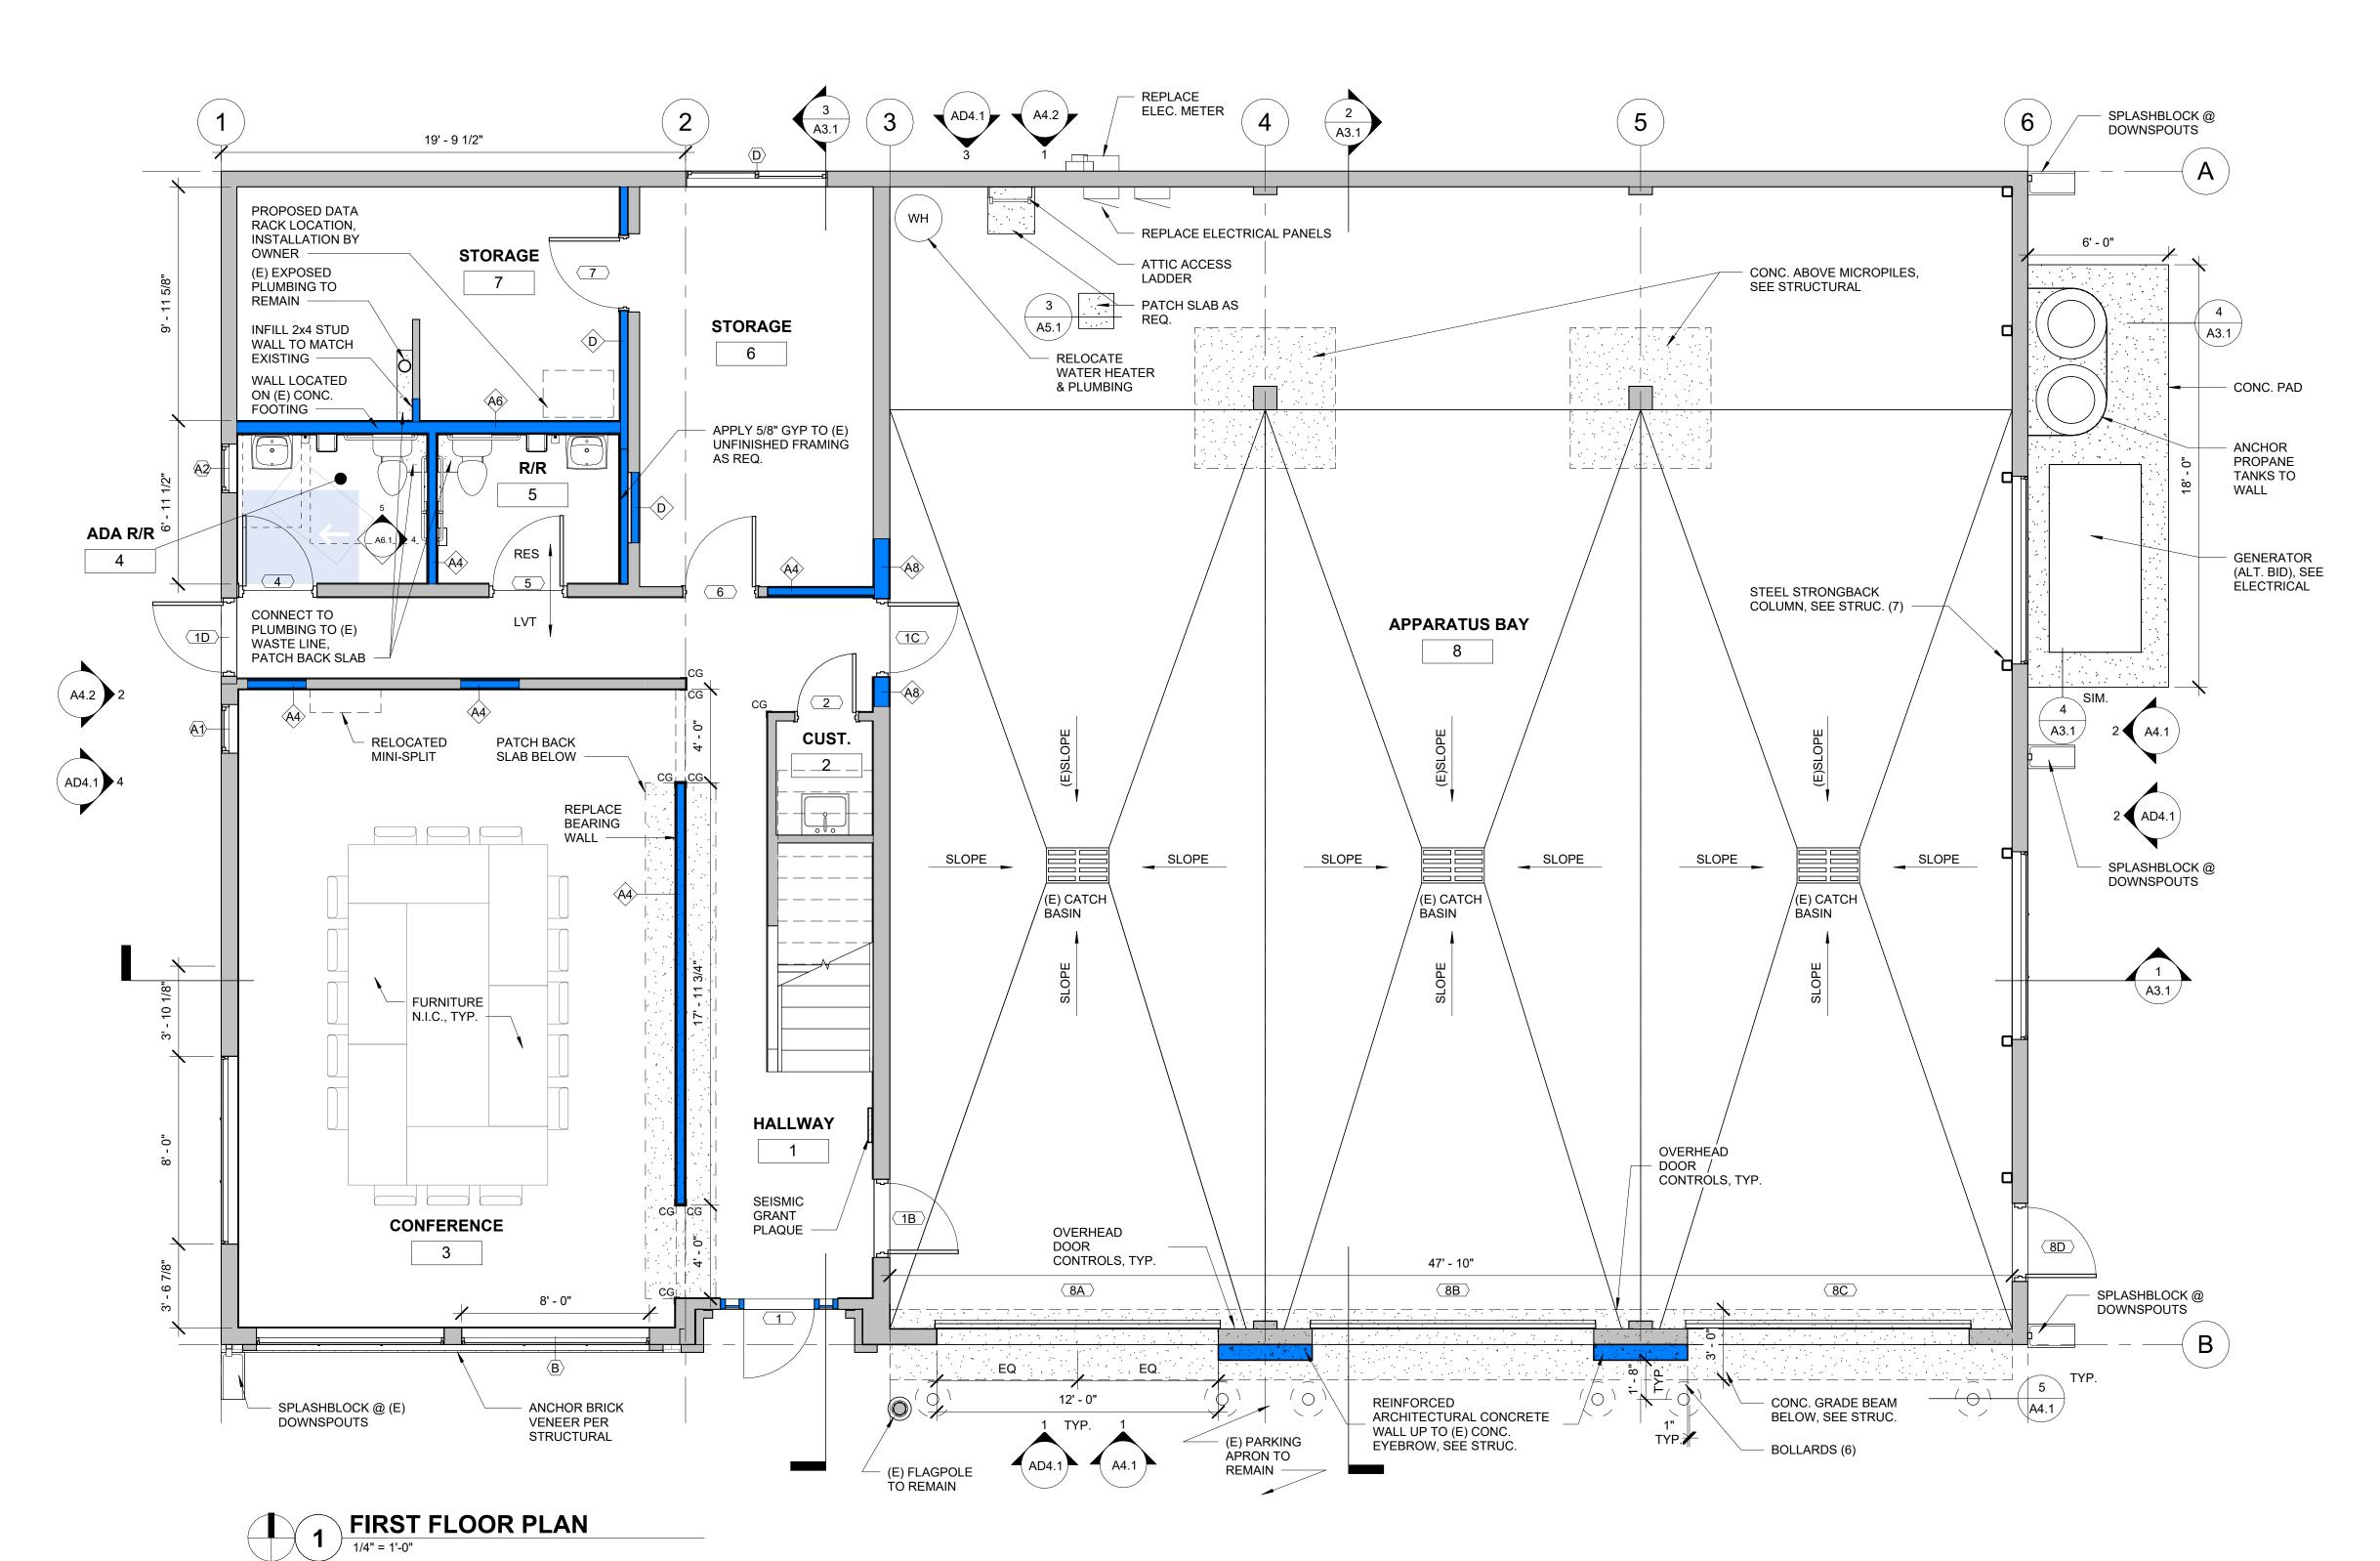

FLOOR PLAN GENERAL NOTES:

- DIMENSIONS SHOWN ARE TO FACE OF STUD UNLESS NOTED OTHERWISE. CONTACT THE ARCHITECT FOR ANY ADDITIONAL DIMENSIONS REQUIRED TO LAY OUT THE WORK. WRITTEN DIMENSIONS GOVERN; DO NOT SCALE DRAWINGS.
- ALL CONSTRUCTION SHALL COMPLY WITH ALL APPLICABLE COUNTY AND STATE CODES AND STANDARDS.
- THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING THE WORK OF ALL UTILITY COMPANIES AND PERFORMING ALL WORK REQUIRED FOR UTILITIES.
- ANY FIELD CONDITIONS NOT CALLED OUT ON THE ARCHITECTURAL PLANS ARE TO BE COORDINATED WITH THE CONTRACTOR, ARCHITECT, OWNERS, AND OTHERS AS NECESSARY IN THE FIELD.
- THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES IN THE DRAWINGS AND ACTUAL FIELD CONDITIONS PRIOR TO START OF WORK.
- THE ARCHITECT WILL NOT BE RESPONSIBLE FOR, NOR HAVE CONTROL OF CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, NOR THE SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK AND WILL NOT BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- THE ARCHITECT WILL NOT BE RESPONSIBLE, NOR HAVE CONTROL OF, NOR BE IN CHARGE OF THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTOR, OR ANY OF THEIR AGENTS OR EMPLOYEES, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK.

FLOOR PLAN LEGEND

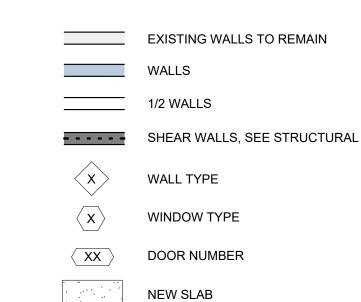



333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com



(<u>D</u> SEISMIC 'ATION FIRE

ASTSIDE ITY OF COOS BAY


CONSTRUCTION

REVISIONS: # DATE DESCRIPTION

MAY 2025

SHEET TITLE: **1ST FLR PLAN**

A2.1

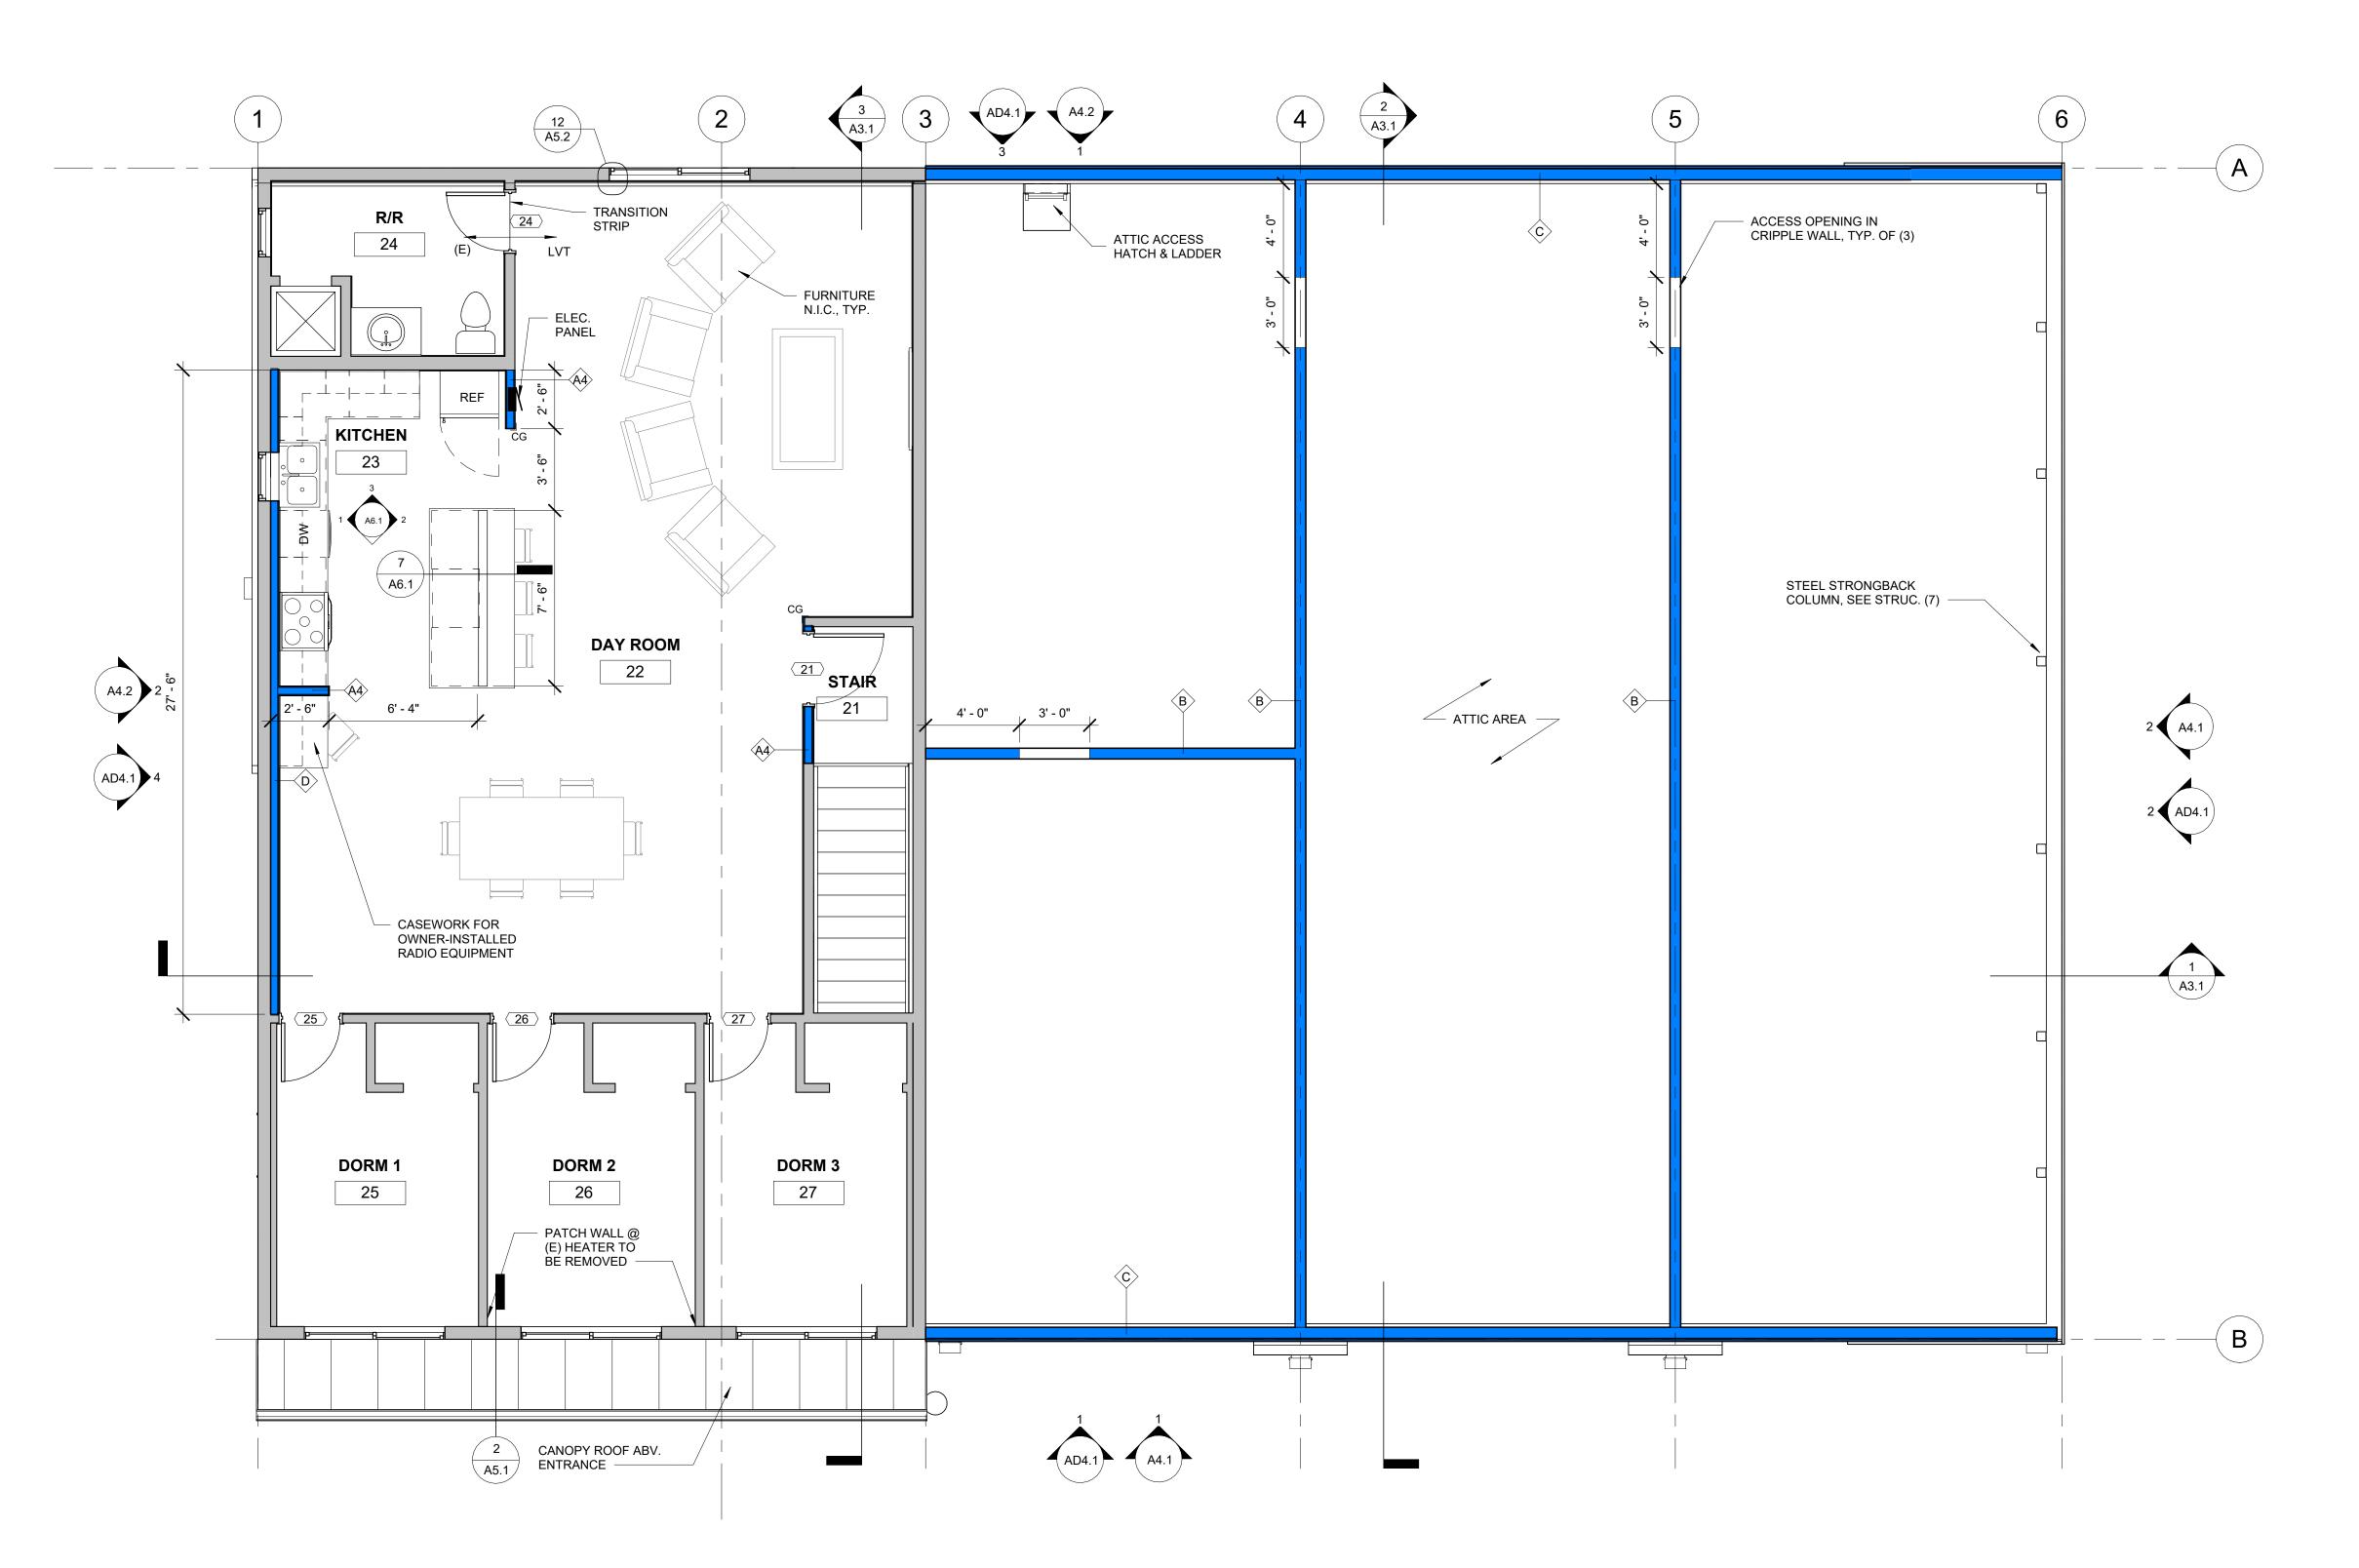


SECOND FLOOR PLAN

1/4" = 1'-0"

FLOOR PLAN GENERAL NOTES:


- 1. DIMENSIONS SHOWN ARE TO FACE OF STUD UNLESS NOTED OTHERWISE. CONTACT THE ARCHITECT FOR ANY ADDITIONAL DIMENSIONS REQUIRED TO LAY OUT THE WORK. WRITTEN DIMENSIONS GOVERN; DO NOT SCALE DRAWINGS.
 - ALL CONSTRUCTION SHALL COMPLY WITH ALL APPLICABLE COUNTY AND STATE CODES AND STANDARDS.
- THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING THE WORK OF ALL UTILITY COMPANIES AND PERFORMING ALL WORK REQUIRED FOR UTILITIES.
- ANY FIELD CONDITIONS NOT CALLED OUT ON THE ARCHITECTURAL PLANS ARE TO BE COORDINATED WITH THE CONTRACTOR, ARCHITECT, OWNERS, AND OTHERS AS NECESSARY IN THE FIELD.
- THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES IN THE DRAWINGS AND ACTUAL FIELD CONDITIONS PRIOR TO START OF WORK.
- THE ARCHITECT WILL NOT BE RESPONSIBLE FOR, NOR HAVE CONTROL OF CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, NOR THE SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK AND WILL NOT BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- THE ARCHITECT WILL NOT BE RESPONSIBLE, NOR HAVE CONTROL OF, NOR BE IN CHARGE OF THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTOR, OR ANY OF THEIR AGENTS OR EMPLOYEES, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK.

FLOOR PLAN LEGEND

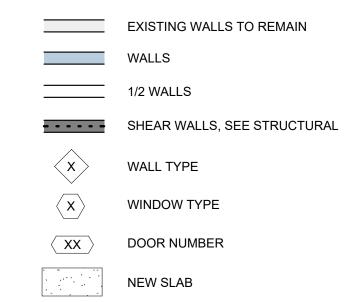



333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com



Ŋ SEISMIC 'ATION FIRE

EASTSIDE | CITY OF COOS BAY 365 D ST, COOS BAY, OR 97420

CONSTRUCTION REVISIONS:


DATE DESCRIPTION

MAY 2025

SHEET TITLE:


2ND FLR PLAN

A2.2

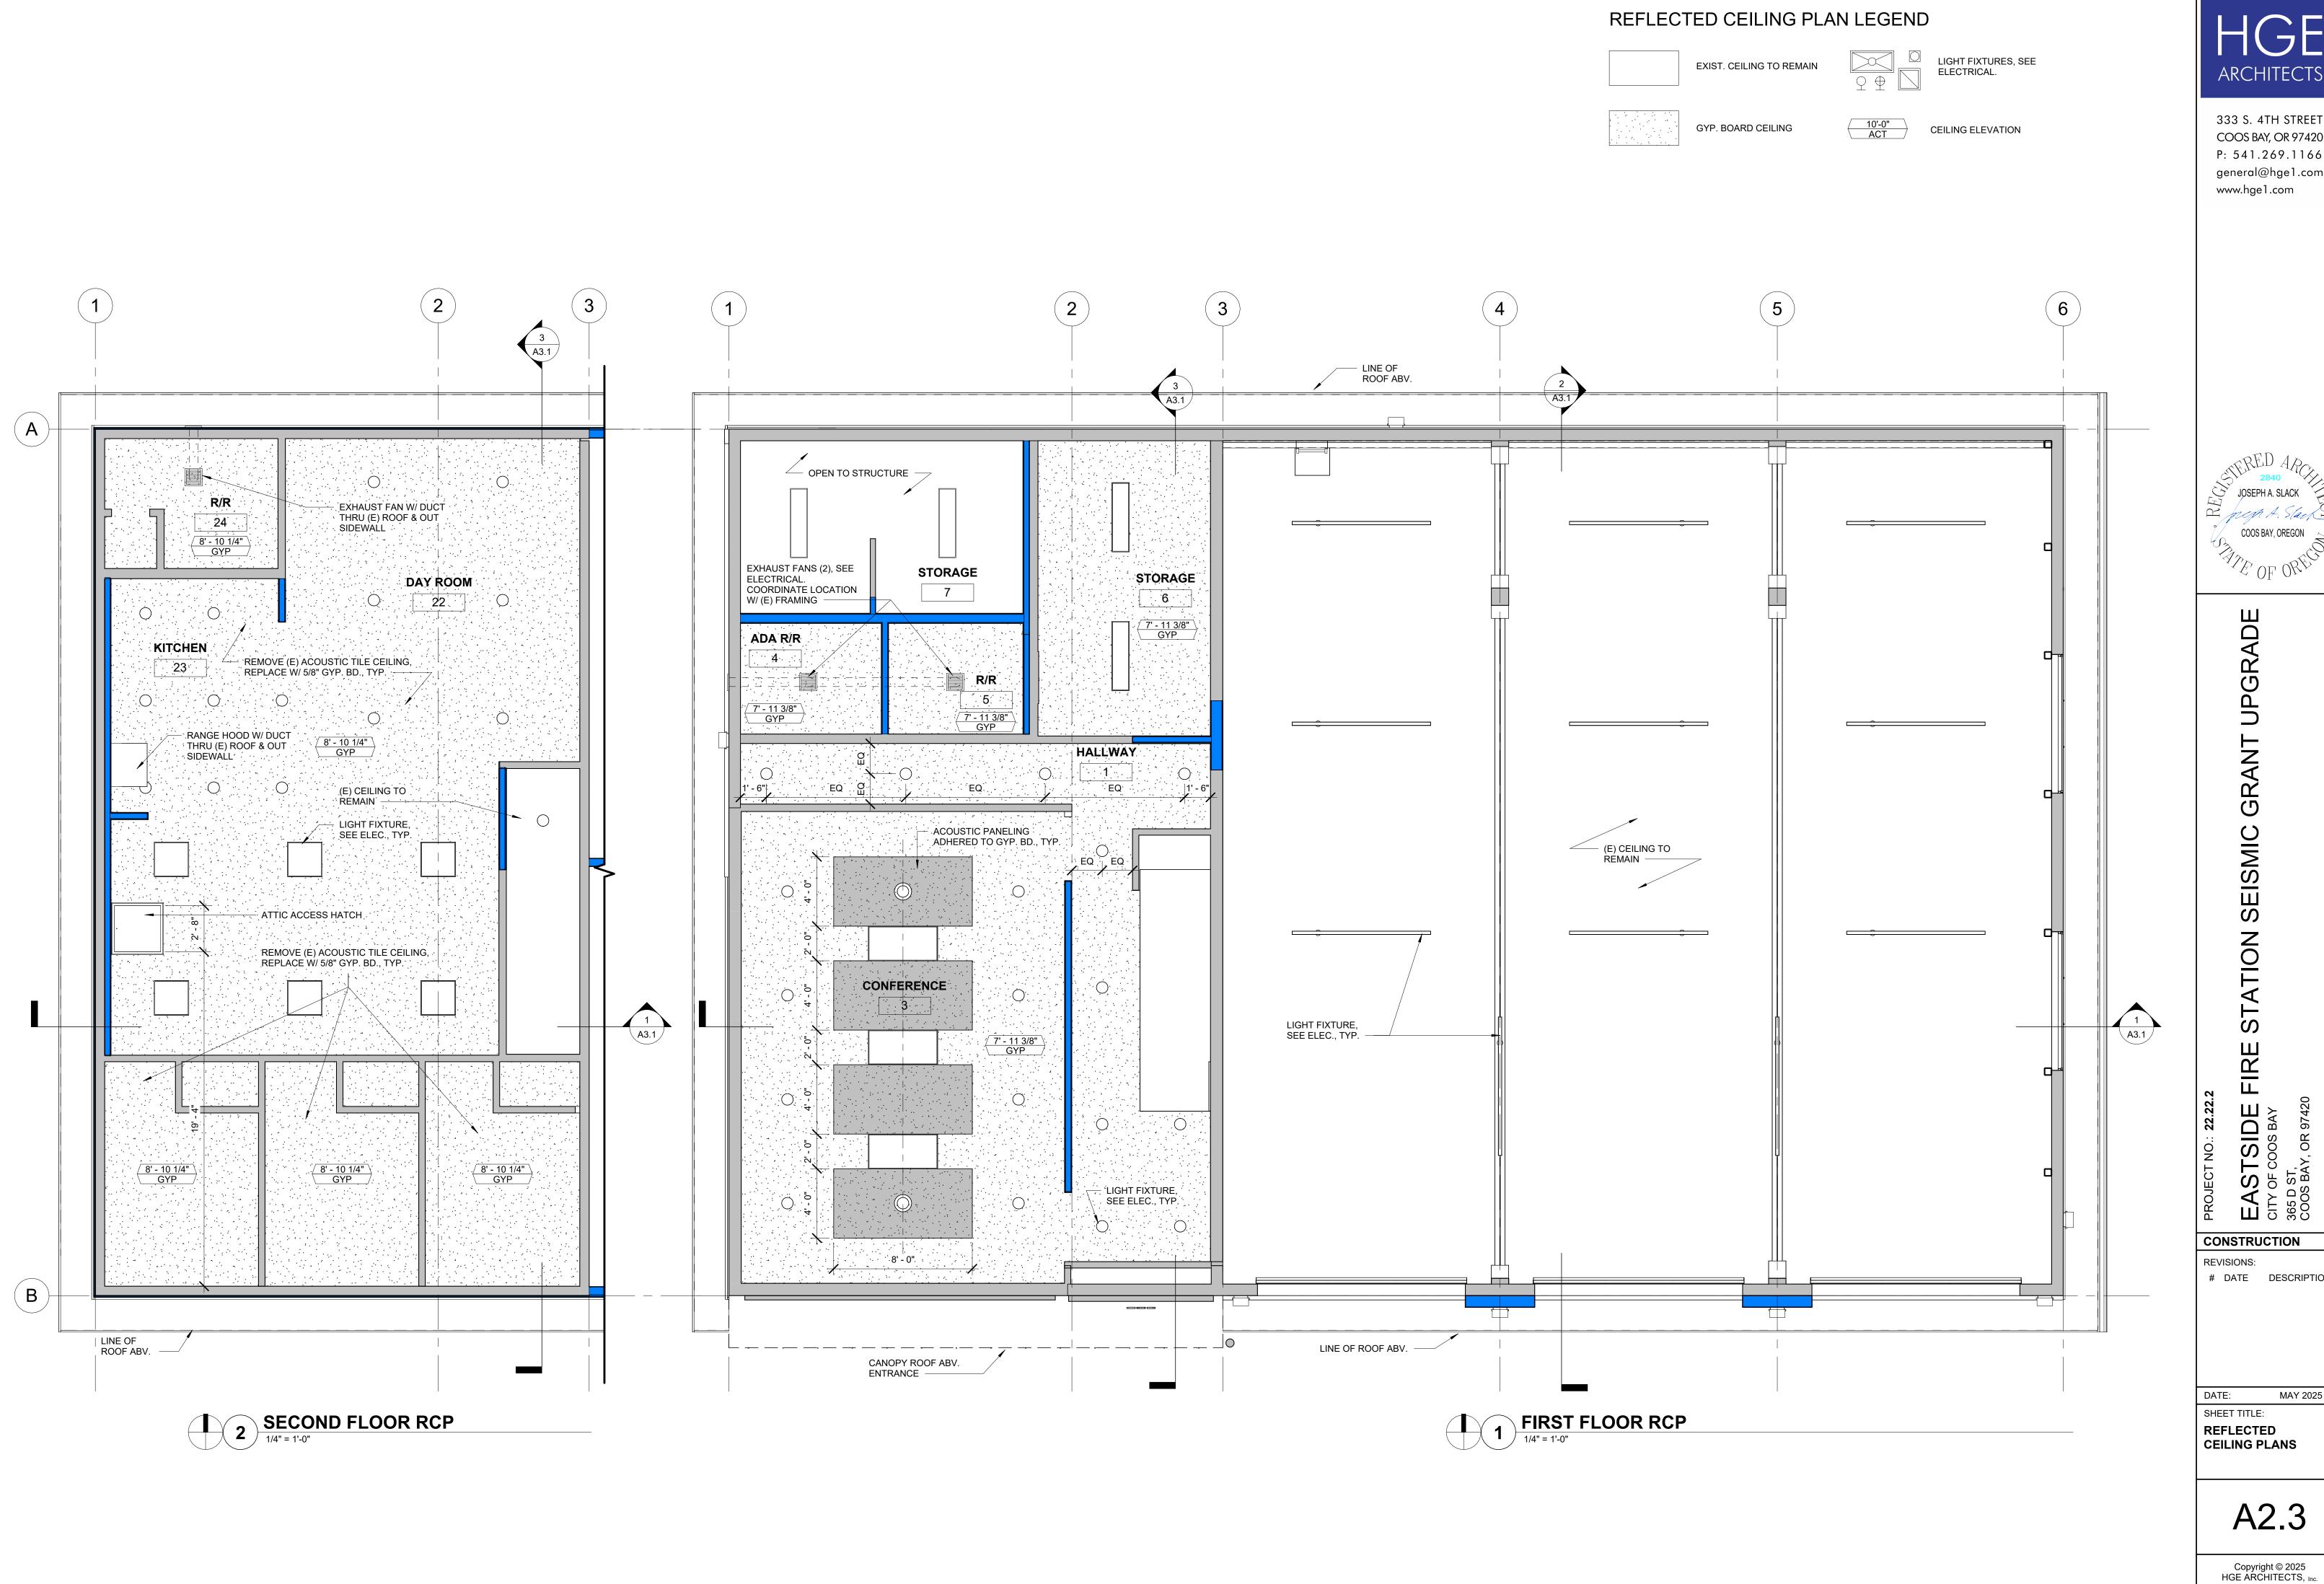


ARCHITECTS

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com



DATE DESCRIPTION

MAY 2025

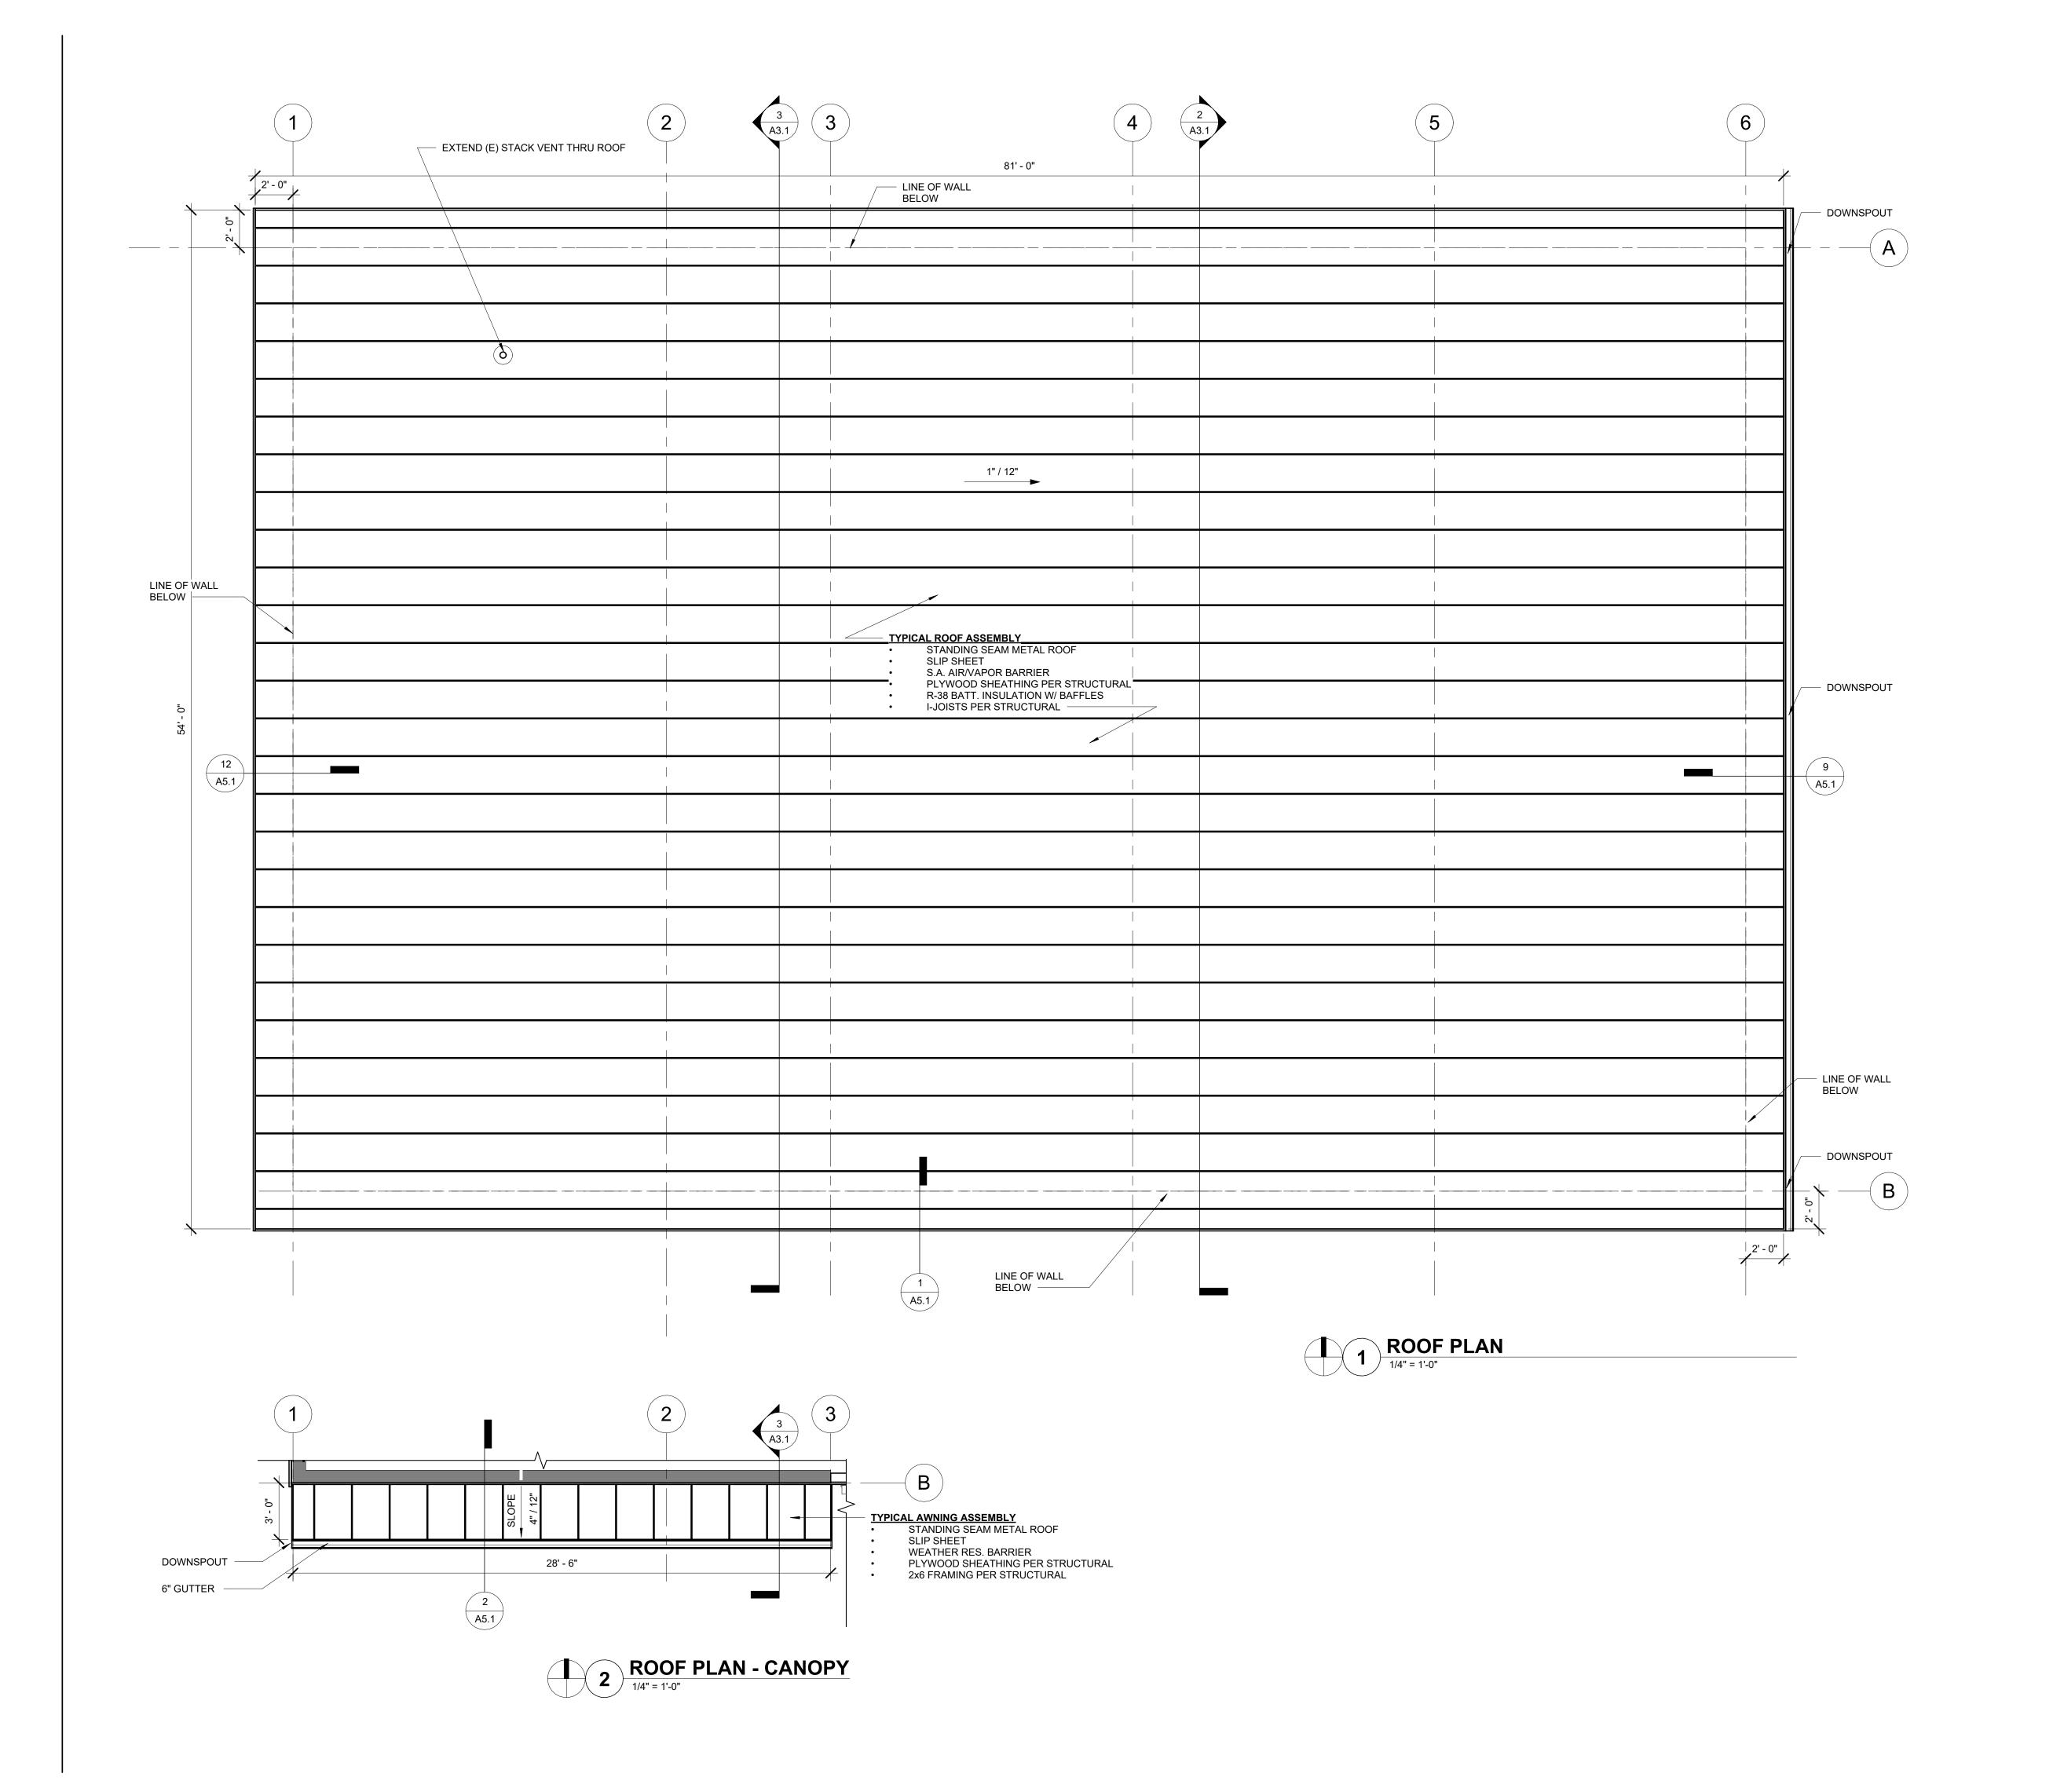



2840
JOSEPH A. SLACK

COOS BAY, OREGON

OF OR

DE FIRE STATION SEISMIC GRANT UPGRADE

EASTSIDE F
CITY OF COOS BAY
365 D ST,
COOS BAY, OR 97420

CONSTRUCTION
REVISIONS:


REVISIONS: # DATE DESCRIPTION


DATE DESCRIPTION

MAY 2025


SHEET TITLE:
ROOF PLAN

A2.4

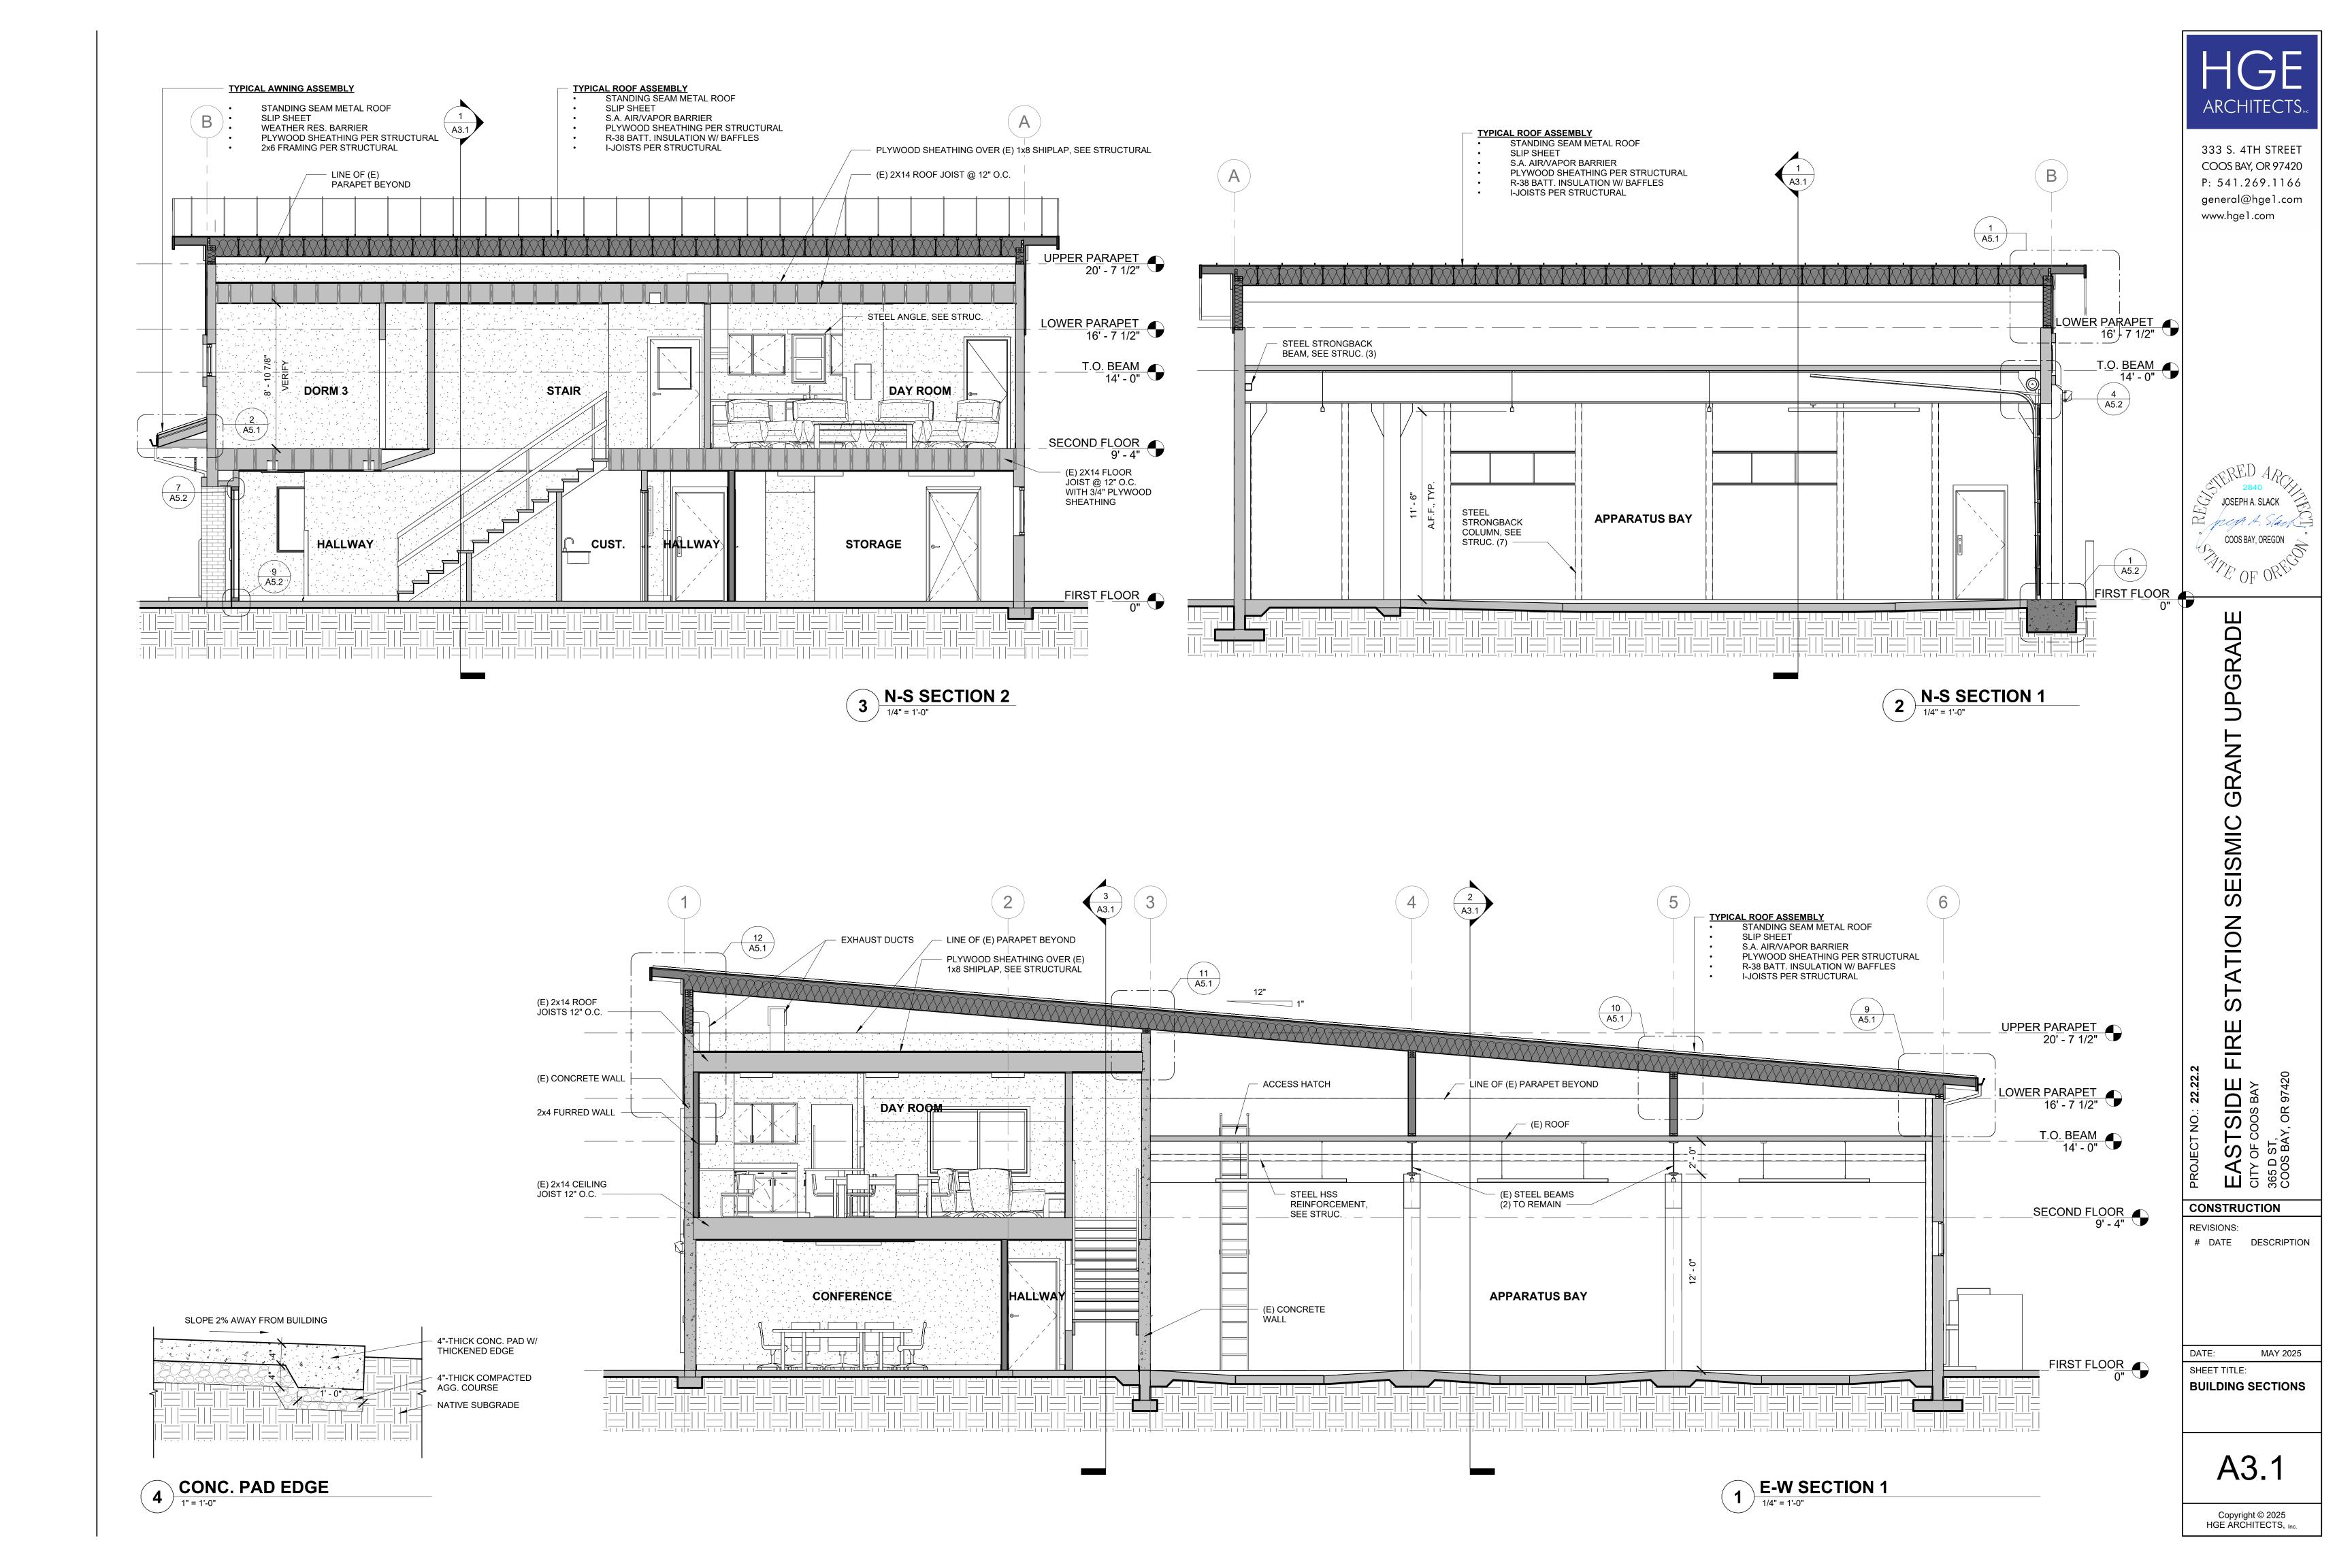

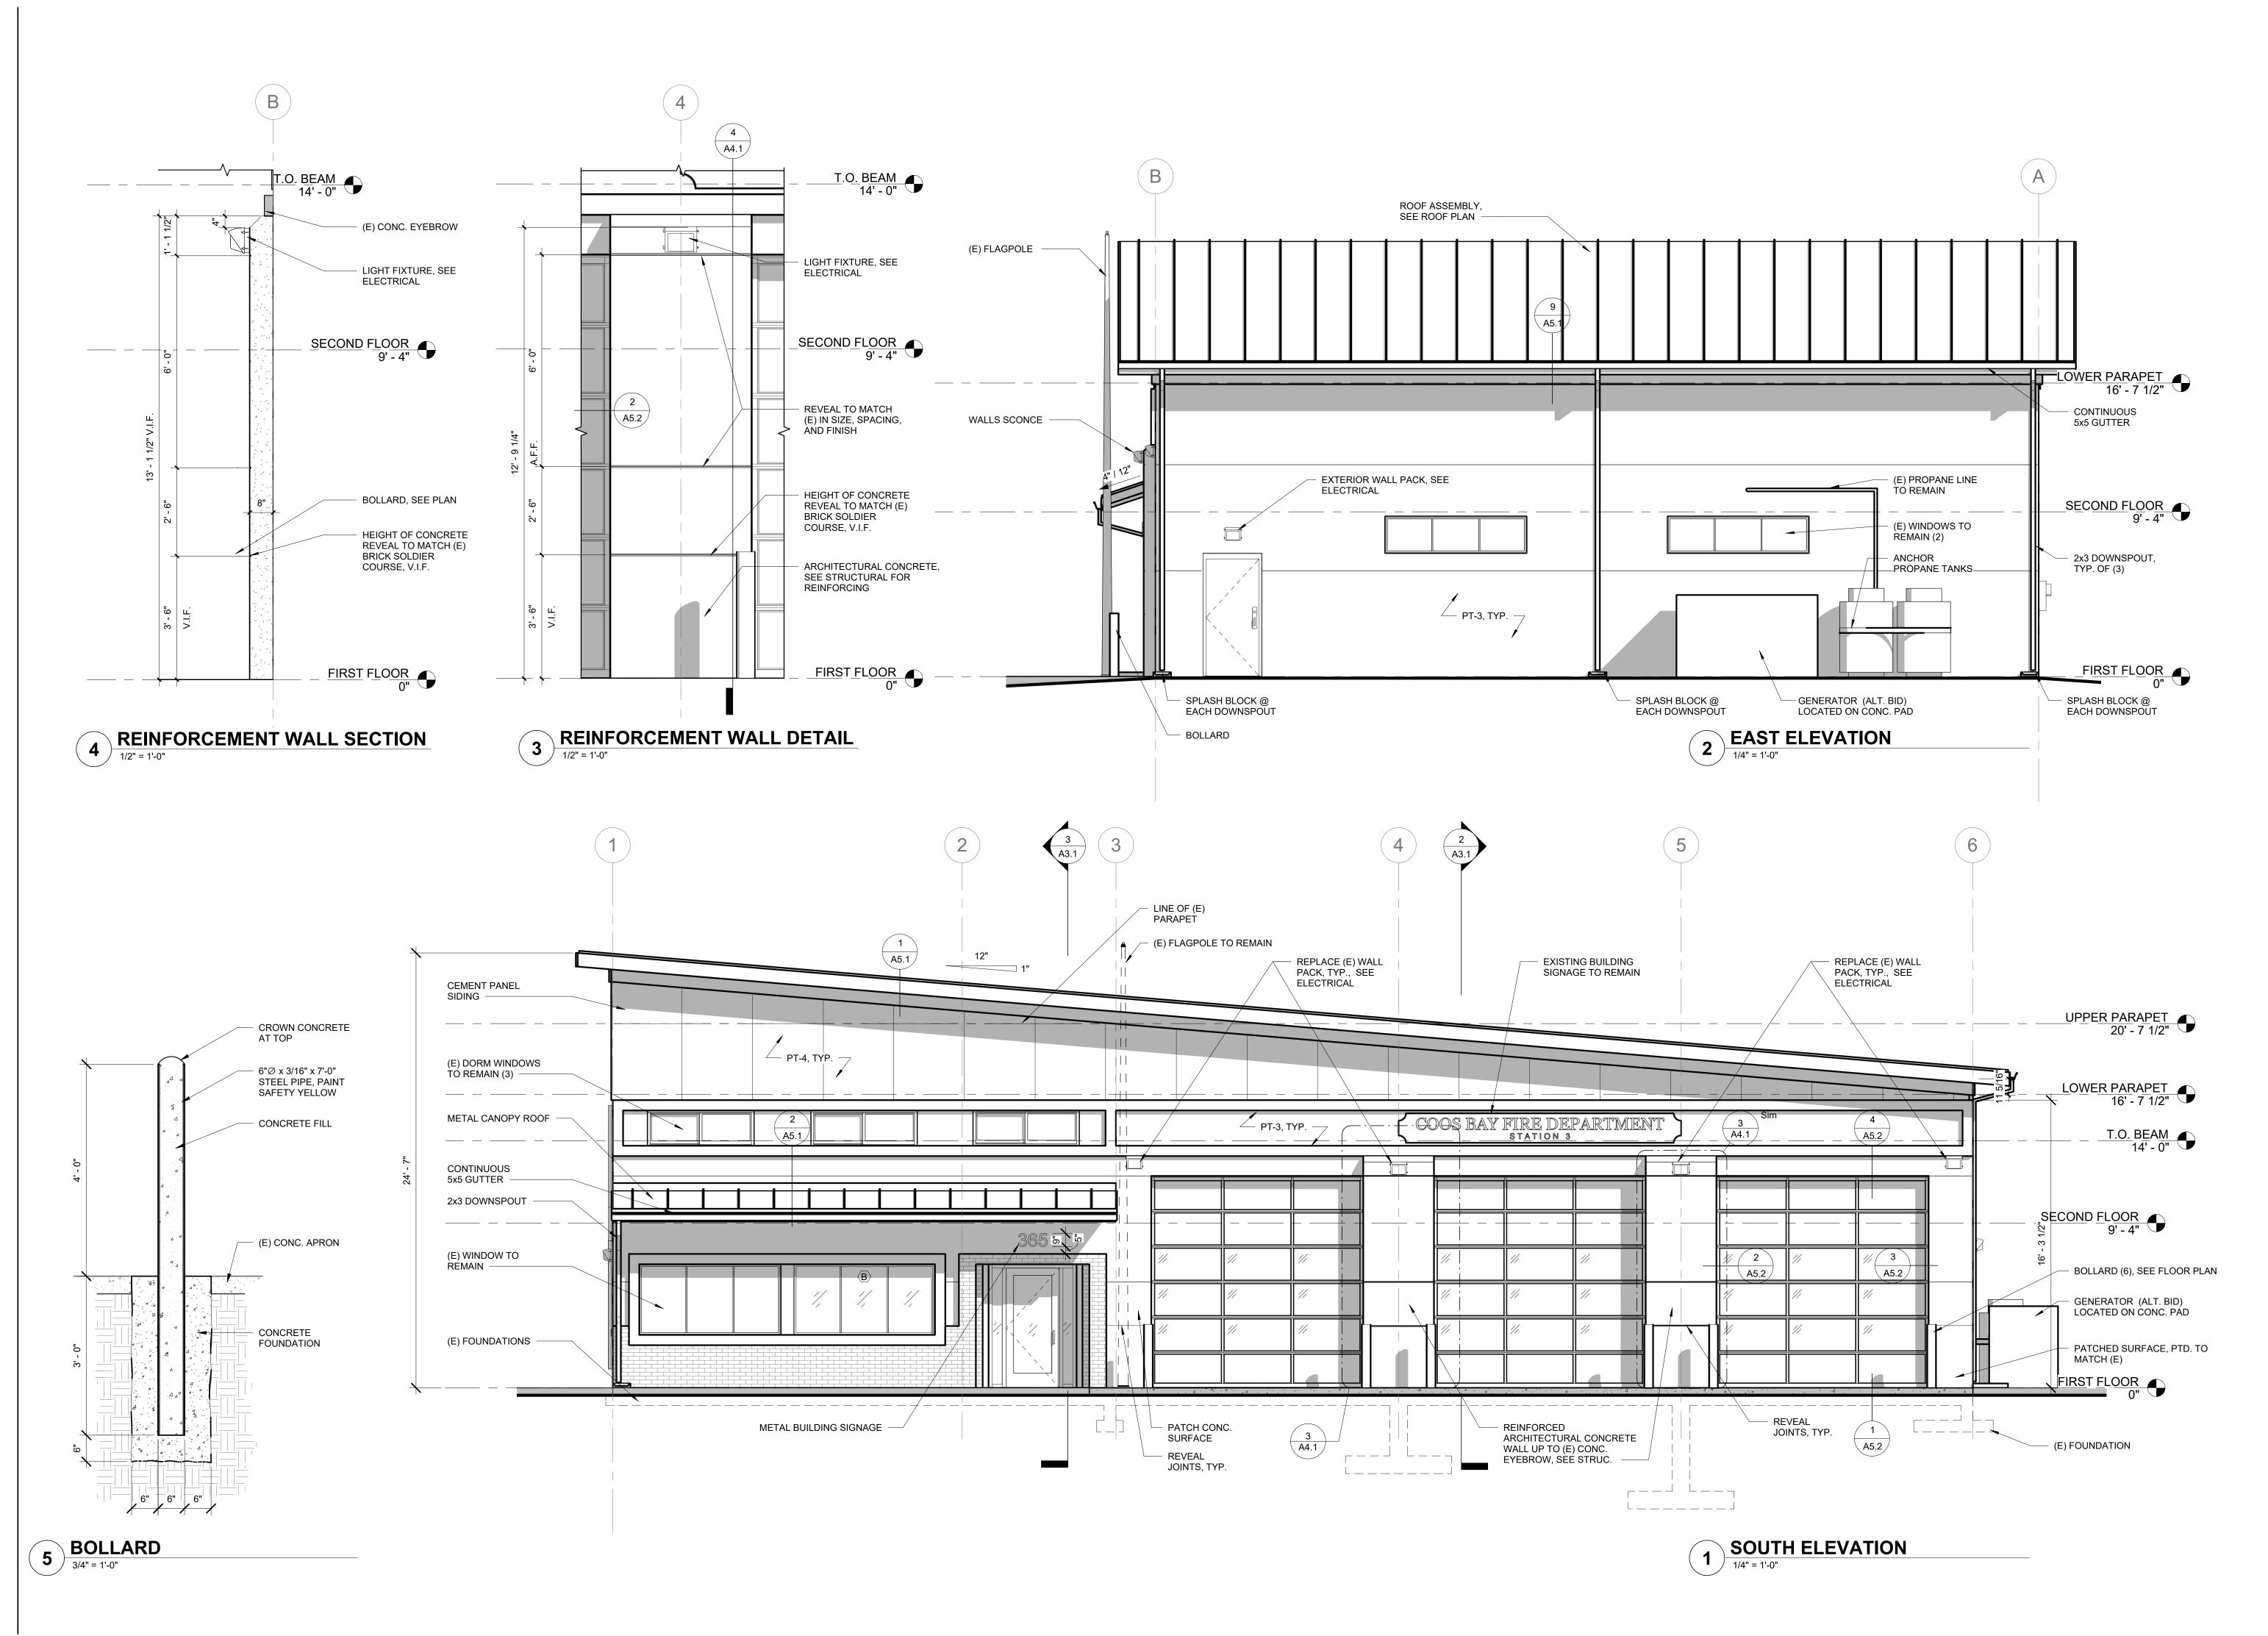





TSIDE FIRE STATION SEISMIC GRANT UPGRADE

EASTSIDE FIRE STOTY OF COOS BAY COOS BAY, OR 97420


CONSTRUCTION
REVISIONS:

REVISIONS: # DATE DESCRIPTION


DATE: MAY 2025

SHEET TITLE:
BUILDING
ELEVATIONS

A4.1

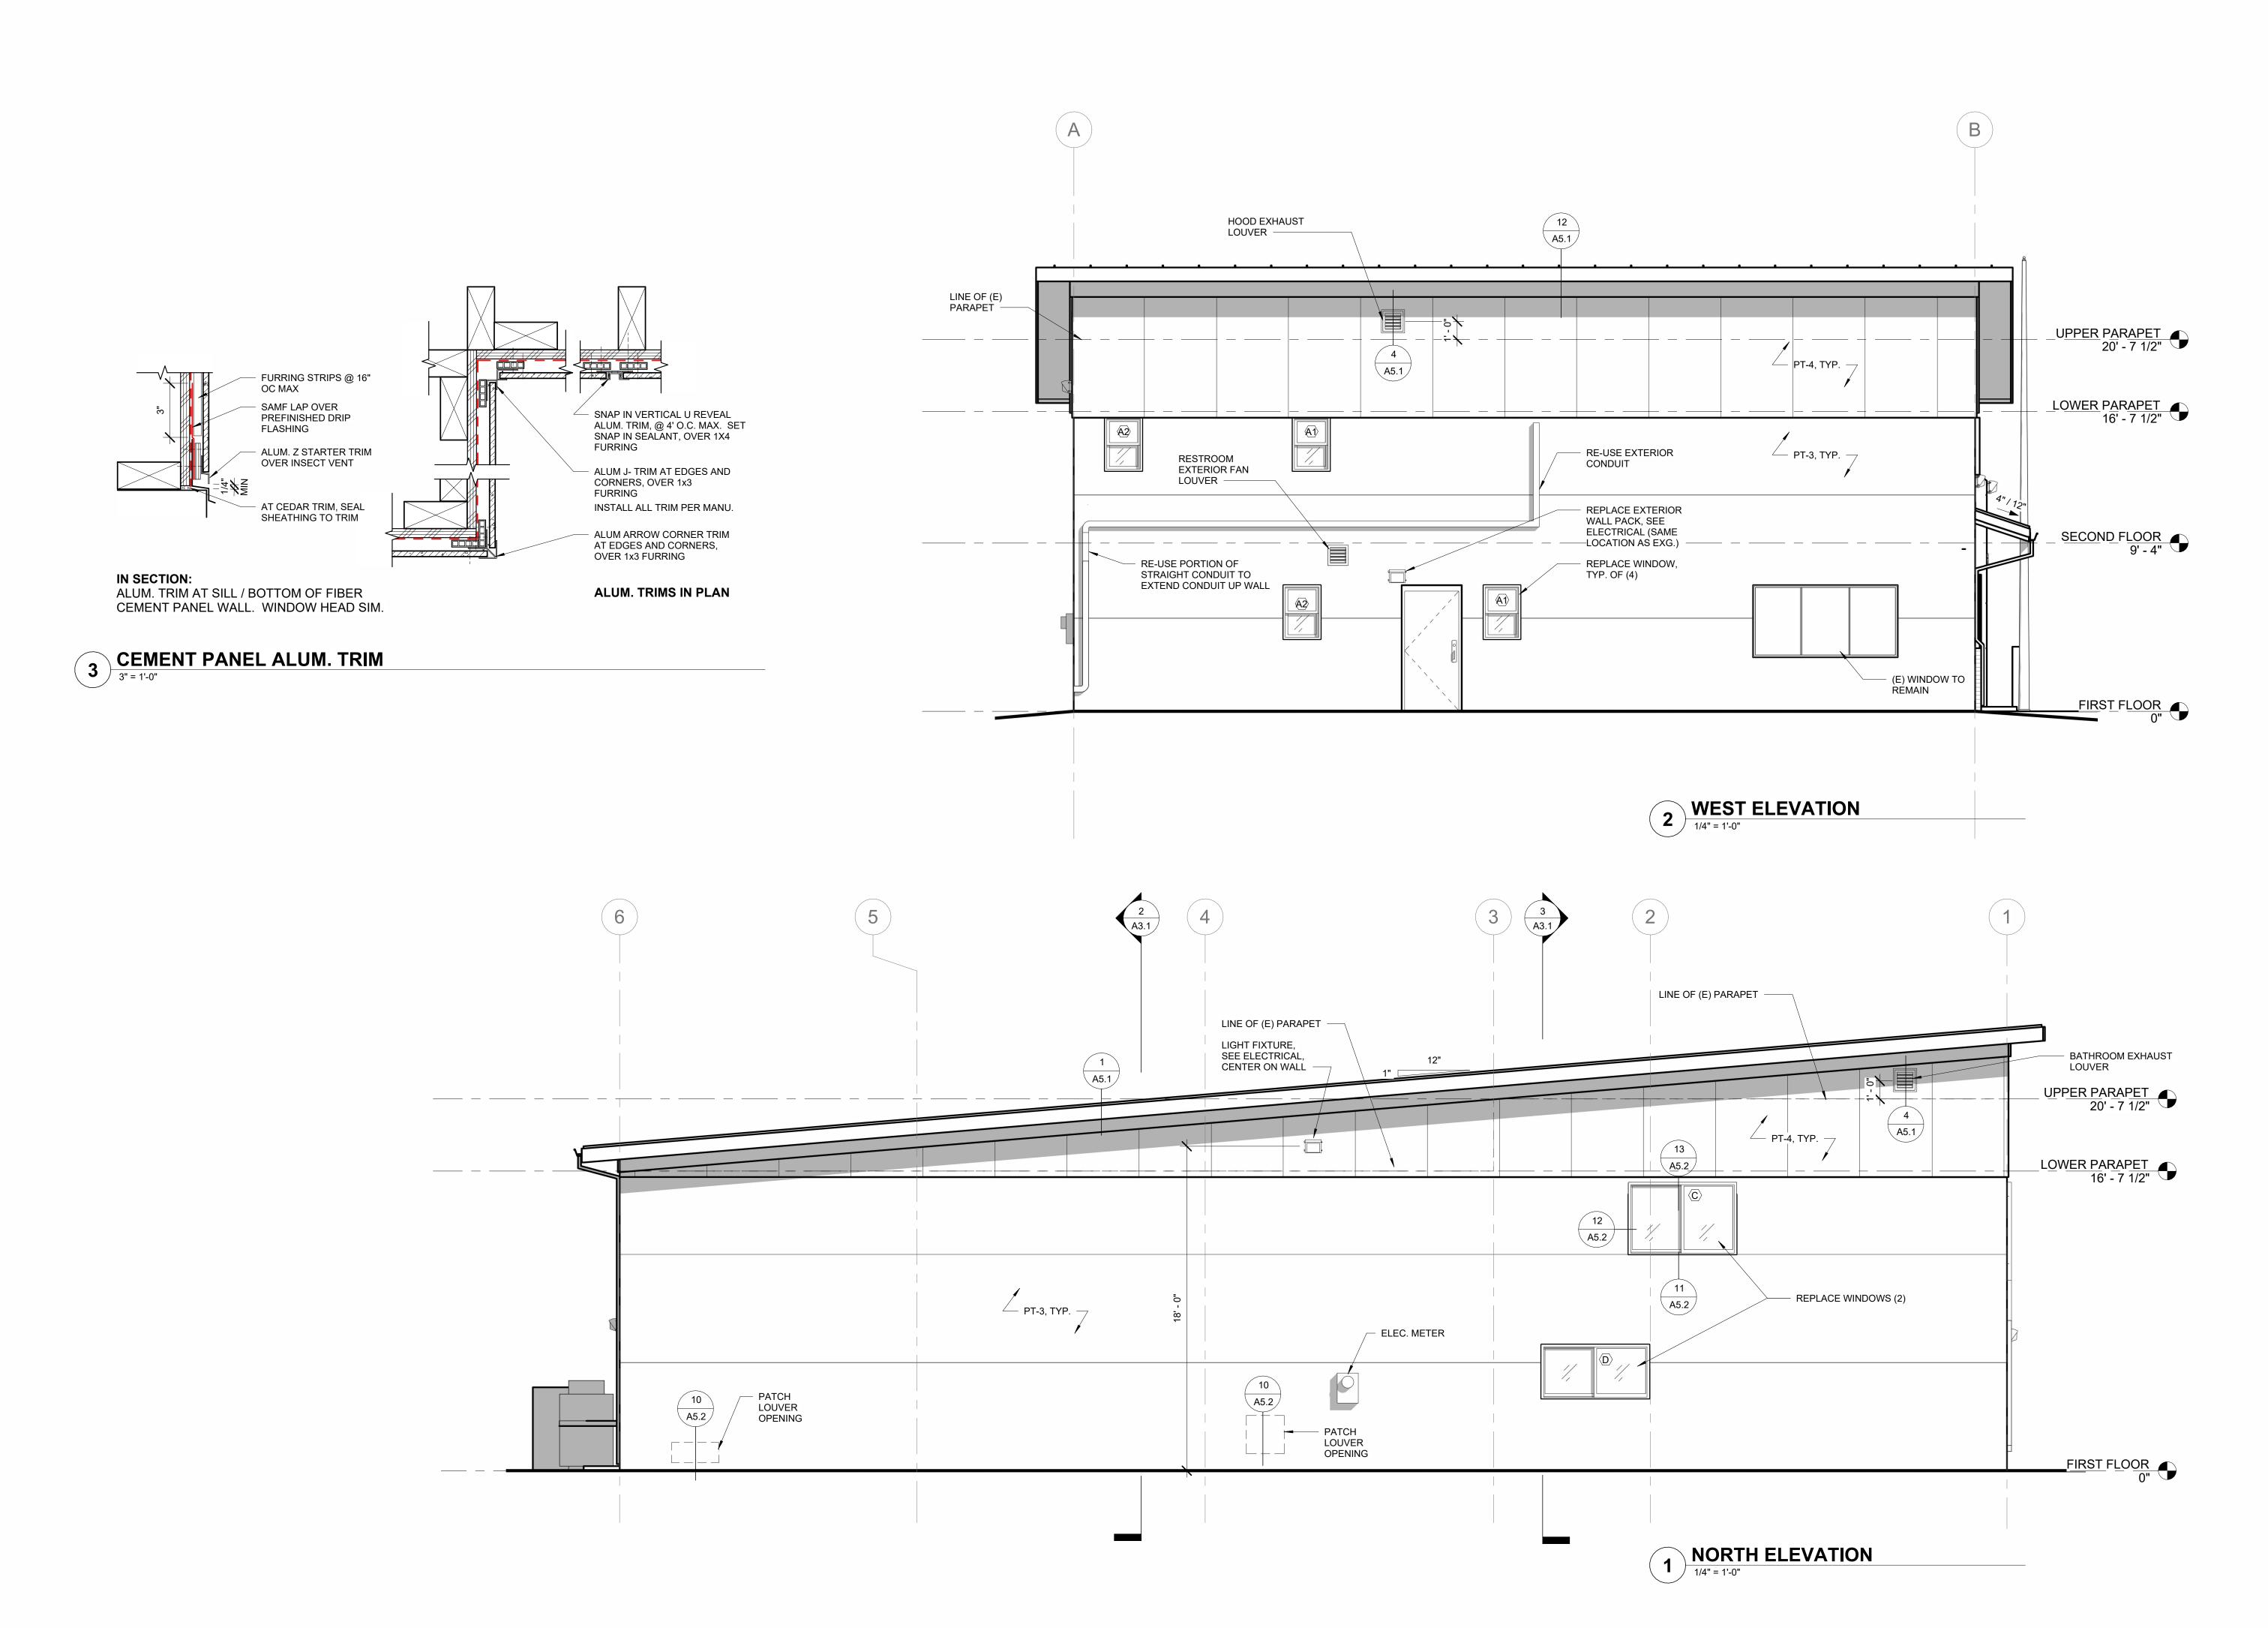





EASTSIDE FIRE STATION SEISMIC GRANT UPGRADE

365 D ST,
200S BAY, OR 97420


CONSTRUCTION


REVISIONS: # DATE DESCRIPTION


MAY 2025

DATE: MAY:
SHEET TITLE:
BUILDING
ELEVATIONS


A4.2

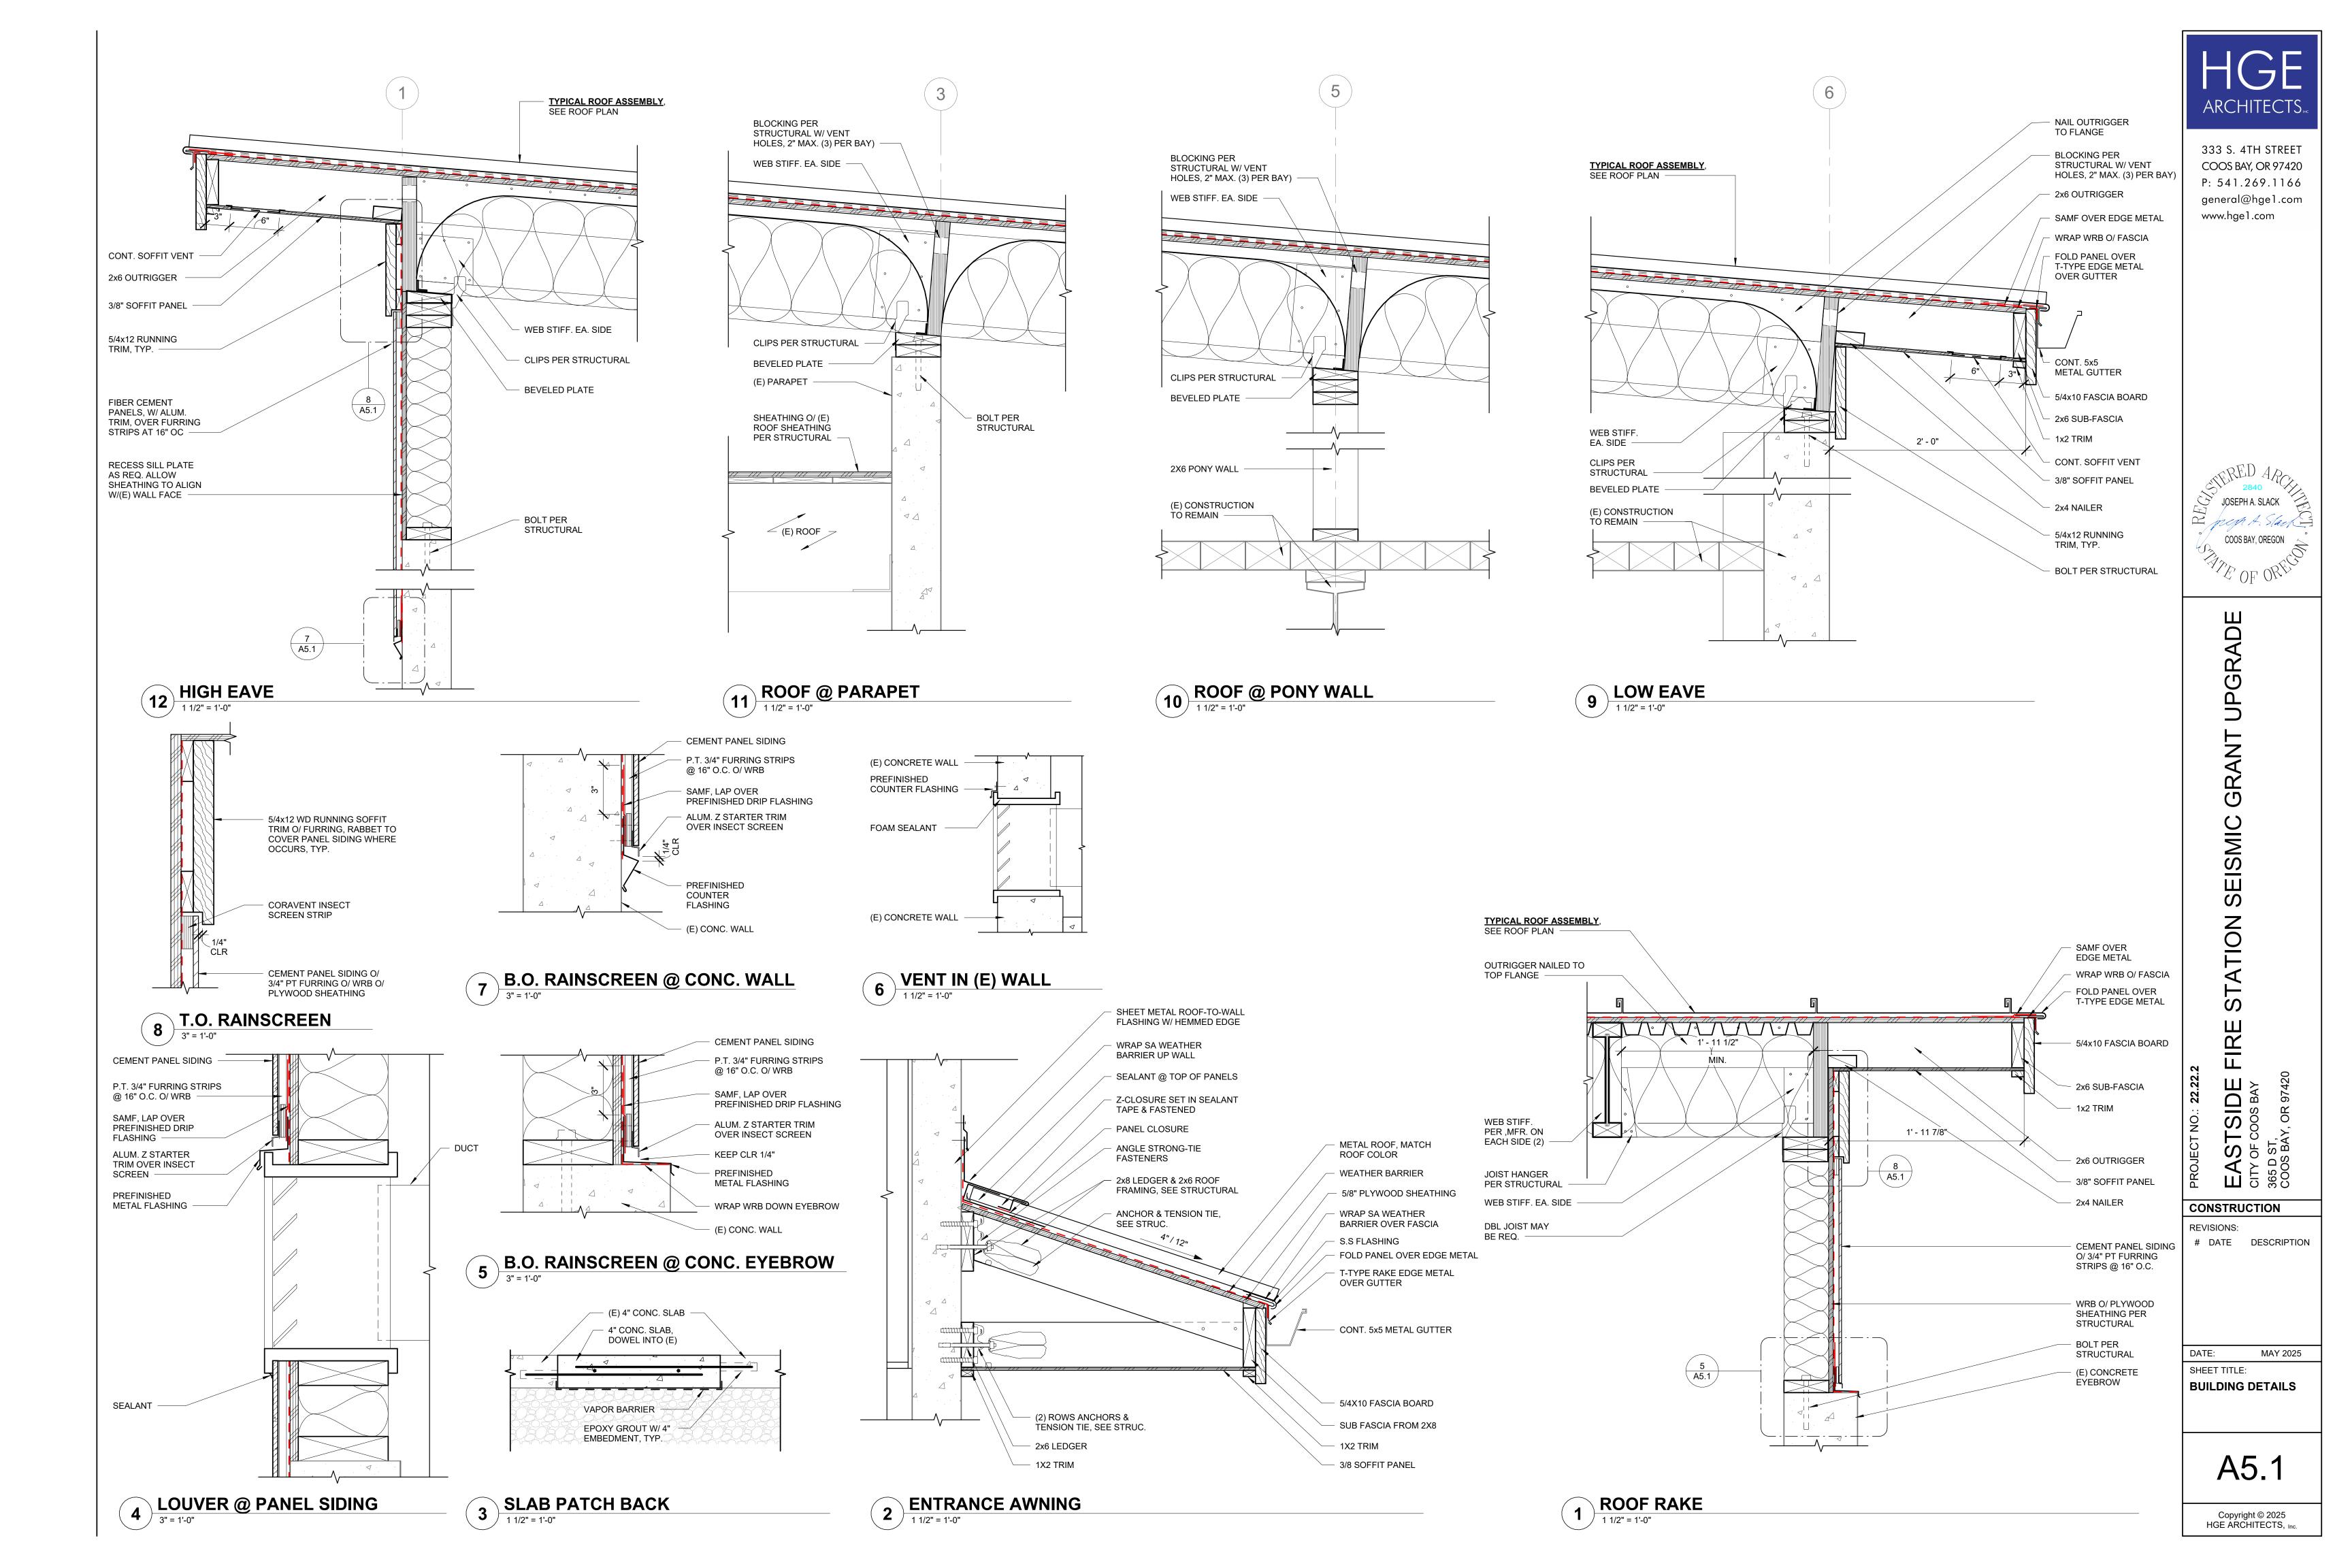


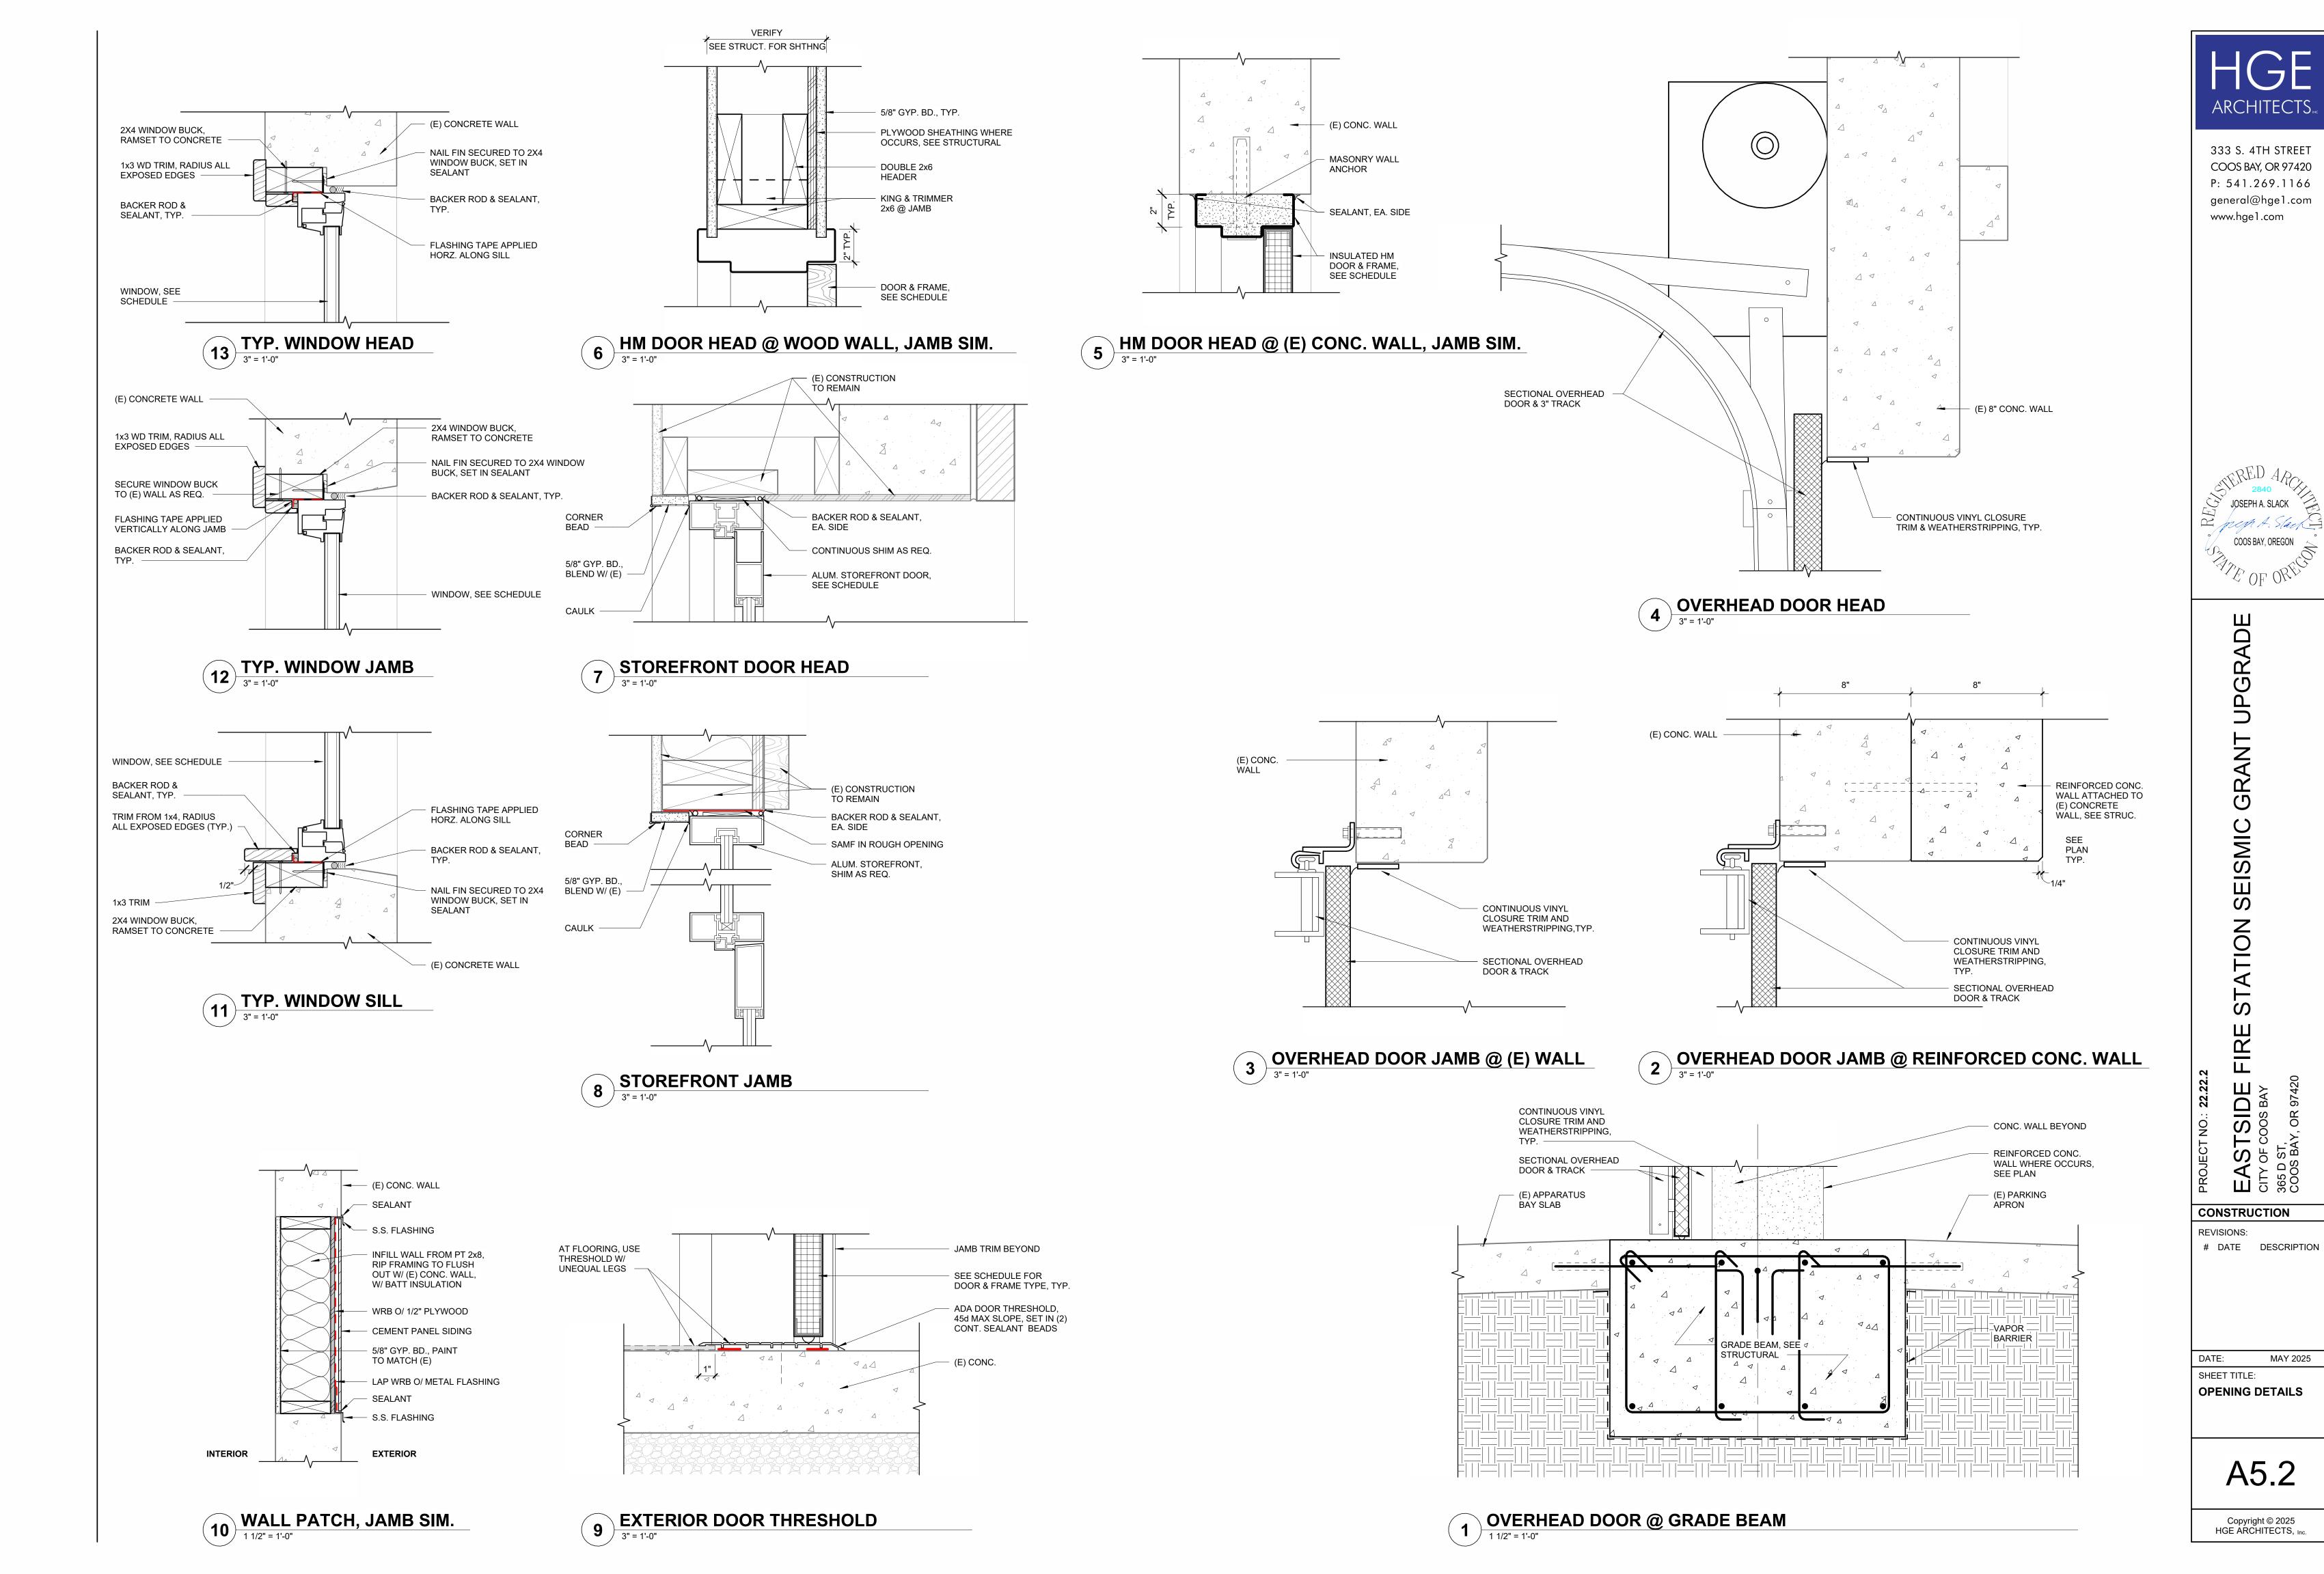


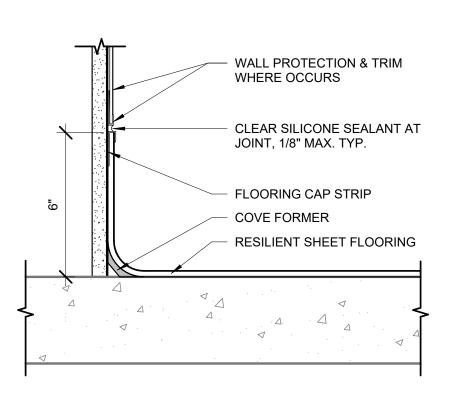




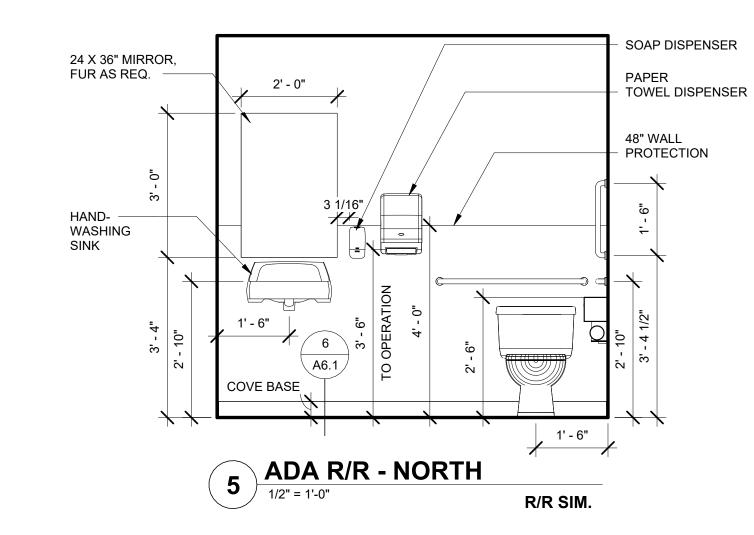


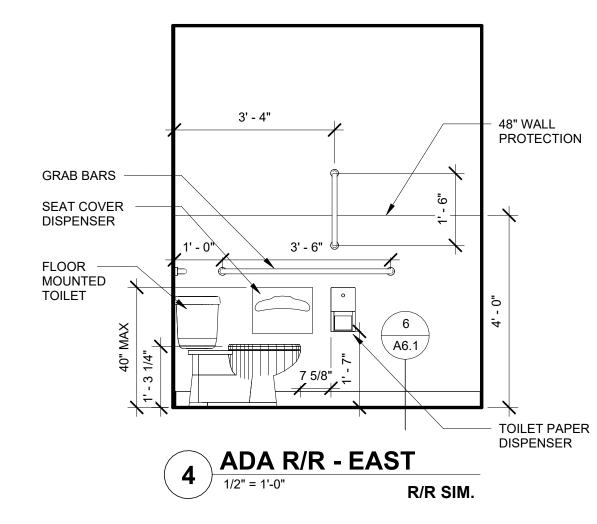


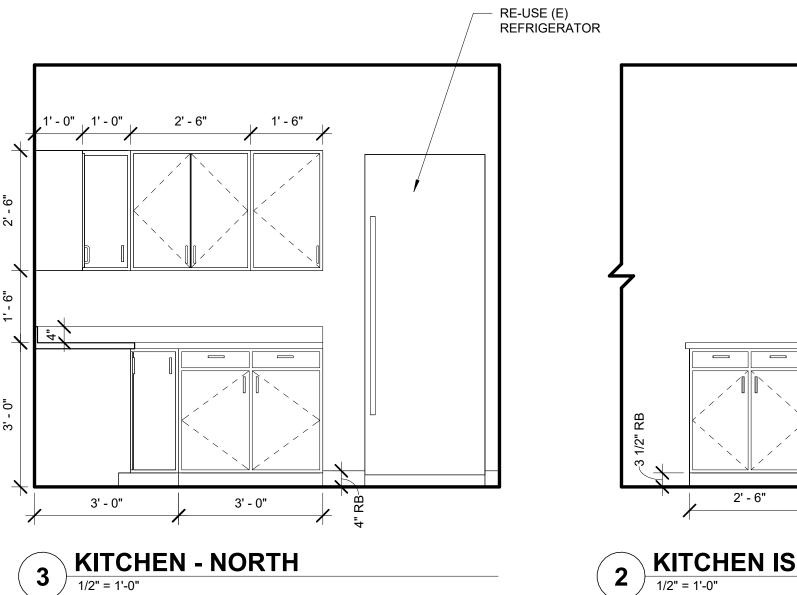



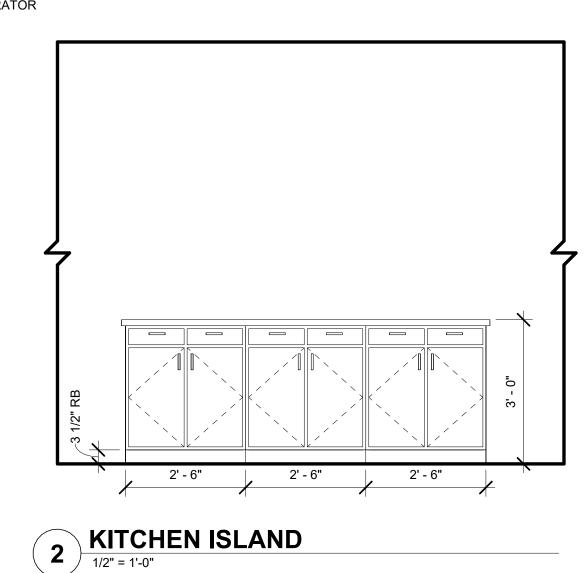

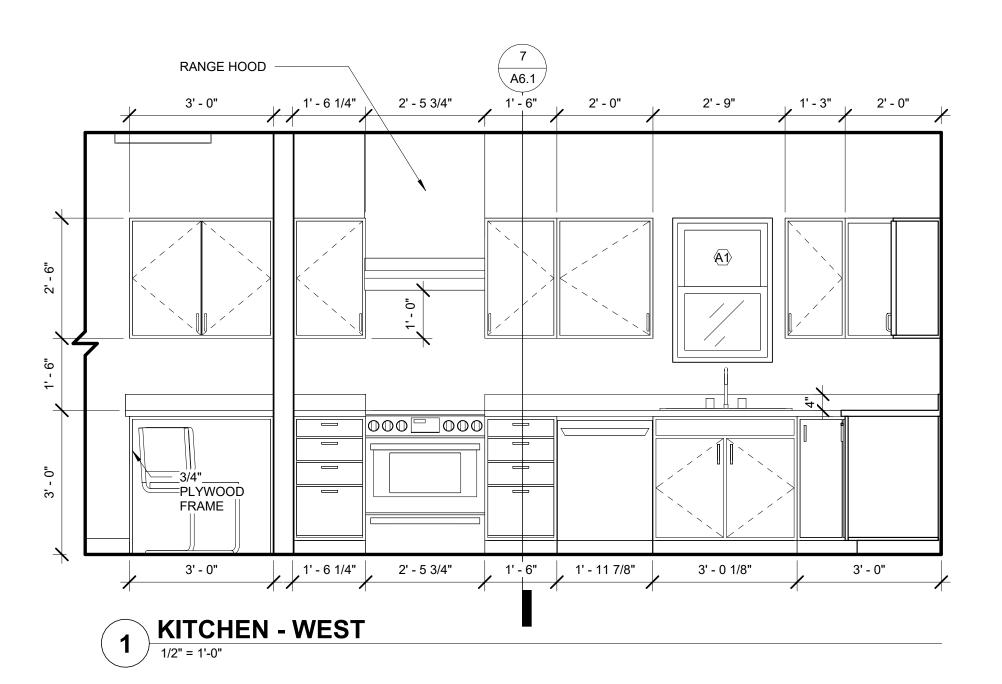

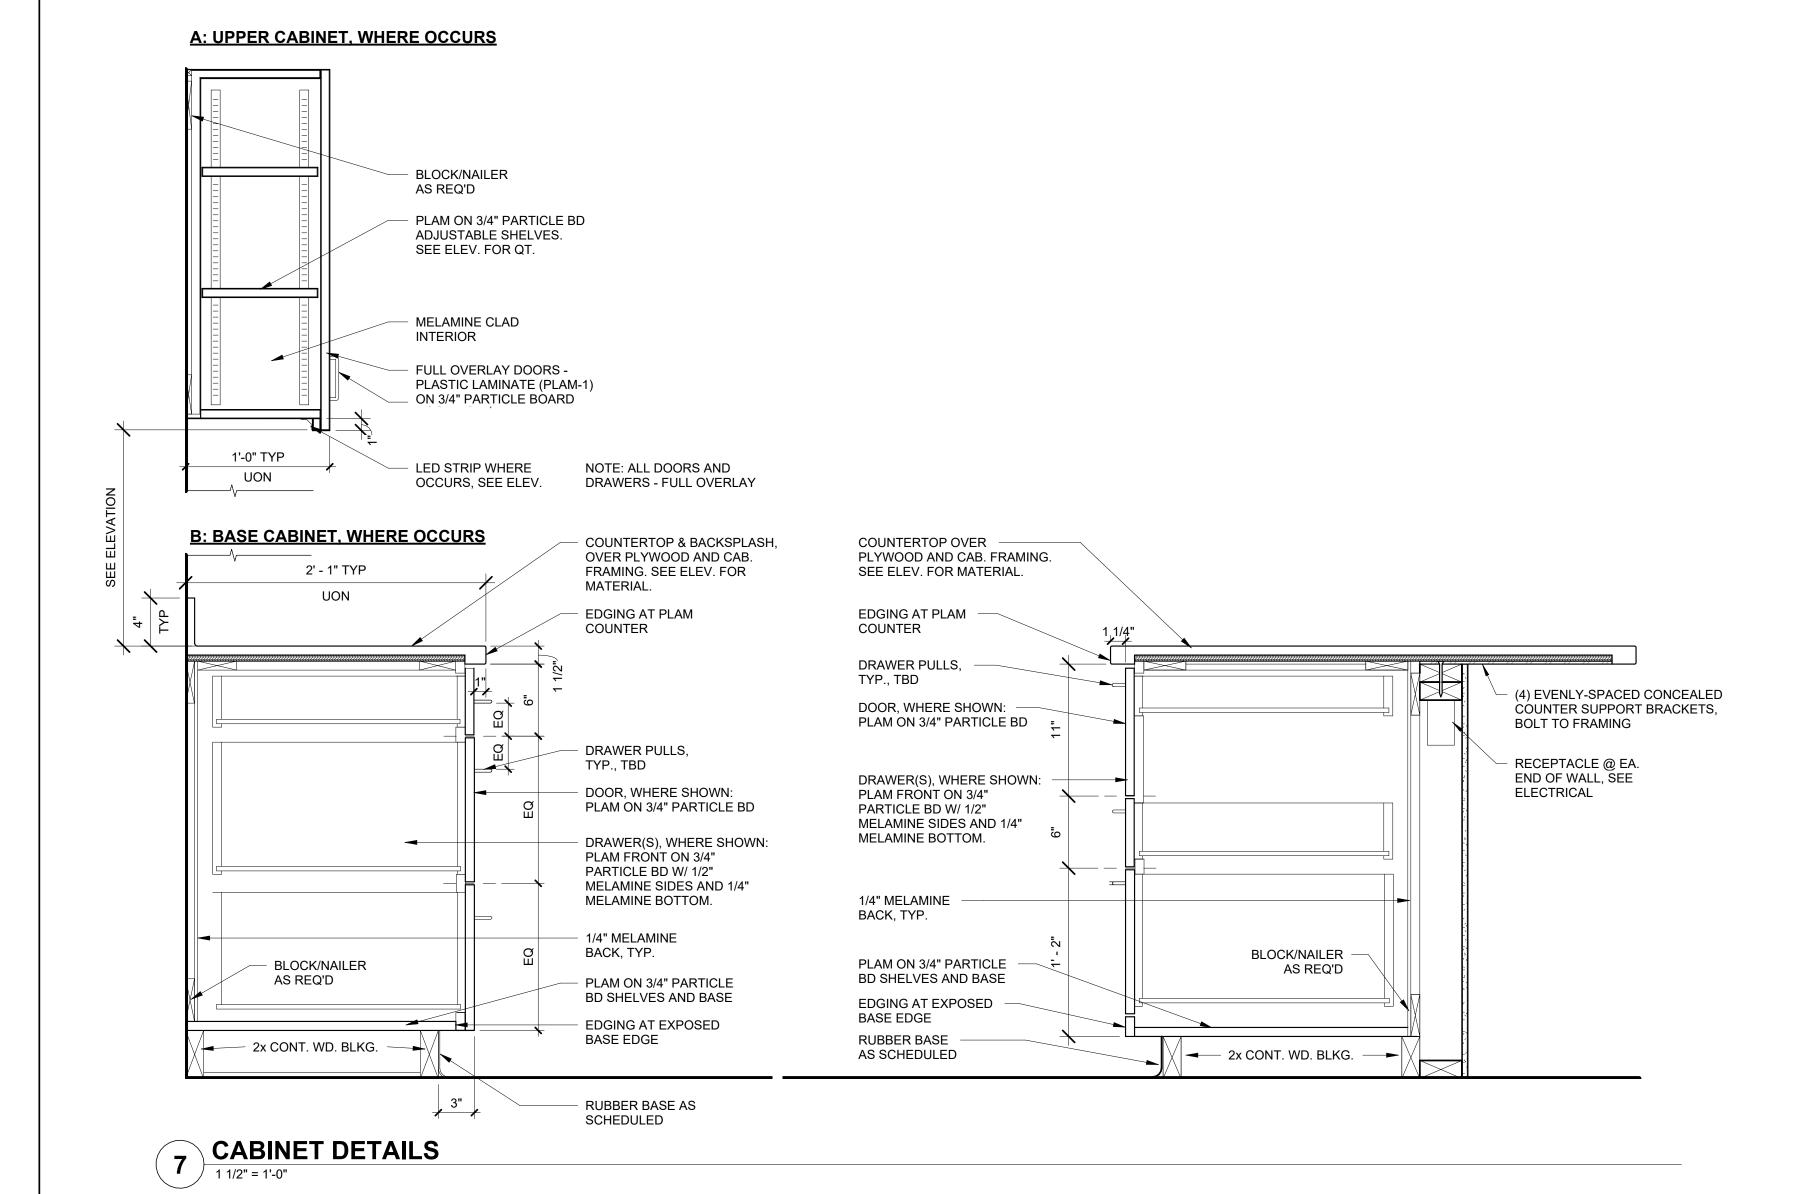

FIRE TSIDE COOS BAY လွှဲ မ CONSTRUCTION REVISIONS: # DATE DESCRIPTION DATE: MAY 2025 SHEET TITLE: INTERIOR **ELEVATIONS**

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com

www.hge1.com

JOSEPH A. SLACK

ADE

GRAN⁻

A6.1

CRED APO	
2840	
JOSEPH A. SLACK	
& men A. Slaufi	
COOS BAY, OREGON	
OF OREC	

UPGRADE GRANT SEISMIC FIRE

EASTSIDE I CITY OF COOS BAY 365 D ST, COOS BAY, OR 97420 CONSTRUCTION

REVISIONS: # DATE DESCRIPTION

MAY 2025 SHEET TITLE: SCHEDULES

Copyright © 2025 HGE ARCHITECTS, Inc.

FINISH LEGEND

ACT	ACOUSTIC CEILING TILE
CONC.	CONCRETE
FRP-1	FIBER REINFORCED POLYMER BOARD
GYP	GYPSUM BOARD
PT-1	PAINT COLOR TBD TYPICAL WALL
PT-2	PAINT COLOR TBD TYPICAL CEILING
PT-3	PAINT COLOR TBD EXTERIOR CONC. WALLS
PT-4	PAINT COLOR TBD EXTERIOR PANEL SIDING
LVT	LUXURY VINYL TILE FLOORII
RES	RESILIENT SHEET FLOORING & COVE BASE

ROOM NAME	ROOM NO.	FLOOR FINISH	BASE	NORTH WALL	SOUTH WALL	EAST WALL	WEST WALL	CEILING FINISH	NOTES
HALLWAY	1	LVT	RBR	PT-1	PT-1	PT-1	GYP / PT-1	GYP / PT-2	
CUST.	2	-	-	-	-	-	-	-	EXISTING TO REMAIN
CONFERENCE	3	LVT	RBR	PT-1	PT-1	GYP / PT-1	PT-1	GYP / PT-2 / ACT	
ADA R/R	4	RES	RES	FRP-1 / PT-1	FRP-1 / PT-1	FRP-1 / PT-1	FRP-1 / PT-1	GYP / PT-2	
R/R	5	-	-	-	-	-	-	GYP / PT-2	EXISTING FLOOR & WALL FINISHES TO REMAIN
STORAGE	6	LVT	RBR	PT-1	PT-1	PT-1	PT-1	GYP / PT-2	
STORAGE	7	LVT	RBR	PT-1	GYP / PT-1	GYP / PT-1	PT-1	OPEN TO STRUC.	
APPARATUS BAY	8	CONC.	-	PT-1	PT-1	PT-1	PT-1	-	
STAIR	21	LVT @ LANDING	RBR	PT-1	PT-1	PT-1	PT-1	PT-2	
DAY ROOM	22	LVT	RBR	PT-1	PT-1	PT-1	PT-1	GYP / PT-2	
KITCHEN	23	LVT	RBR	PT-1	PT-1	PT-1	PT-1	GYP / PT-2	
R/R	24	RES	RES	-	-	-	-	-	EXISTING TO REMAIN
DORM 1	25	LVT	RBR	PT-1	PT-1	PT-1	PT-1	GYP / PT-2	
DORM 2	26	LVT	RBR	PT-1	PT-1	PT-1	PT-1	GYP / PT-2	
DORM 3	27	LVT	RBR	PT-1	PT-1	PT-1	PT-1	GYP / PT-2	

ROOM FINISH SCHEDULE

SEE SPECIFICATIONS FOR MORE

RESILIENT RUBBER BASE, 4"

				SEE SCHED.
SEE	SEE SCHED.	SEE SCHED.	SEE SCHED.	FIXED
SCHED.	ĘQ ĘQ	EQ	EQ	CHED.
			EQ.	SEE SCHED.
SEE SCHED.	SEE SCHED.	SEE SCHED	SEE SCHED	GLASS S.
	33 - 9 - 8	33-9-8	. 10	PANELS
Α	В	C	D	OH
FLUSH DOOR	VISION GLASS DOOR	HALF GLASS DOOR	FULL GLASS DOOR	OVERHEAD SECTIONAL

DOOR LEGEND

	DOOR SCHEDULE								
DOOR NO.	ROOM NAME	SIZE (WxH)	TYPE	DOOR MATERIAL	FRAME MATERIAL	HARDWARE GROUP	NOTES		
1	HALLWAY	3' - 0" X 6' - 9 1/2"	D	ALUM. / GLASS	ALUM.	HW-28	NOTES 1, 2		
1B	HALLWAY	3' - 0" X 6' - 8"	С	WD / GLASS	HM	HW-45	NOTES 1, 2		
1C	HALLWAY	3' - 0" X 6' - 8"	С	WD / GLASS	HM	HW-45	NOTES 1, 2		
1D	HALLWAY	3' - 0" X 6' - 8"	Α	HM	HM	HW-55	EXTERIOR; NOTES 1, 2		
2	CUST.	2' - 6" X 6' - 8"	(E)	(E)	(E)	-	NOTE 3		
4	ADA R/R	3' - 0" X 6' - 8"	Α	WD	HM	HW-5			
5	R/R	3' - 0" X 6' - 8"	Α	WD	HM	HW-5	NOTE 2		
6	STORAGE	3' - 0" X 6' - 8"	Α	WD	HM	HW-45	NOTES 1, 2		
7	STORAGE	3' - 0" X 6' - 8"	Α	WD	HM	HW-20			
8A	APPARATUS BAY	12' - 0" X 12' - 0"	ОН	MANUF.	MANUF.	-	SECTIONAL DOOR; NOTE 2		
8B	APPARATUS BAY	12' - 0" X 12' - 0"	OH	MANUF.	MANUF.	-	SECTIONAL DOOR; NOTE 2		
8C	APPARATUS BAY	12' - 0" X 12' - 0"	ОН	MANUF.	MANUF.	-	SECTIONAL DOOR; NOTE 2		
8D	APPARATUS BAY	3' - 0" X 6' - 8"	Α	HM	HM	HW-55	EXTERIOR; NOTES 1, 2		
21	STAIR	3' - 0" X 6' - 8"	С	WD / GLASS	HM	HW-45	NOTE 1		
24	R/R	2' - 6" X 6' - 8"	(E)	(E)	(E)	-	NOTE 3		
25	DORM 1	2' - 6" X 6' - 8"	(E)	(E)	(E)	-	NOTE 3		
26	DORM 2	2' - 6" X 6' - 8"	(E)	(E)	(E)	-	NOTE 3		
27	DORM 3	2' - 6" X 6' - 8"	(E)	(E)	(E)	-	NOTE 3		

DOOR SCHEDULE NOTES:

1. KEYPAD ACCESS CONTROL, SEE SPECIFICATIONS.

VERIFY EXISTING OPENING HEIGHT, WIDTH, AND JAM
EXISTING TO REMAIN. PAINT DOOR & FRAME.

WINDOW SCHEDULE									
MARK	MARK SIZE (WxH) COUNT TYPE NOTES								
A1	2' - 0 7/8" X 3' - 0"	2	SINGLE HUNG	NOTES 1 & 2					
A2	2' - 0 7/8" X 3' - 0"	2	SINGLE HUNG	FROSTED PRIVACY GLASS; NOTES 1 & 2					
В	8' - 0" X 4' - 0"	1	FIXED	NOTE 1					
С	6' - 0" X 4' - 0"	1	HORIZ. SLIDER	NOTES 1 & 2					
D	6' - 0" X 3' - 0"	1	HORIZ. SLIDER	NOTES 1 & 2					

WINDOW SCHEDULE NOTES:

1. VERIFY EXISTING OPENING HEIGHTS & WIDTHS.
2. PROVIDE INSECT SCREEN.

01.00.00 GENERAL REQUIREMENTS

COMPLIANCE WITH THE ENTIRE STANDARD.

- 1. GOVERNING CODE: THE DESIGN AND CONSTRUCTION OF THIS PROJECT IS GOVERNED BY THE "OREGON STRUCTURAL SPECIALTY CODE (OSSC)," 2022 EDITION, HEREAFTER REFERRED TO AS THE OSSC, AS ADOPTED AND MODIFIED BY THE CITY OF COOS BAY, OR UNDERSTOOD TO BE THE AUTHORITY HAVING
- 2. REFERENCE STANDARDS: REFER TO CHAPTER 35 OF THE 2022 OSSC. WHERE OTHER STANDARDS ARE NOTED IN THE DRAWINGS, USE THE LATEST EDITION OF THE STANDARD UNLESS A SPECIFIC DATE IS INDICATED. REFERENCE TO A SPECIFIC SECTION IN A CODE DOES NOT RELIEVE THE CONTRACTOR FROM
- 3. **DEFINITIONS**: THE FOLLOWING DEFINITIONS COVER THE MEANINGS OF CERTAIN TERMS USED IN THESE
- 3.1. "ARCHITECT/ENGINEER" THE ARCHITECT OF RECORD AND THE STRUCTURAL ENGINEER OF
- 3.2. "STRUCTURAL ENGINEER OF RECORD" (SER) THE STRUCTURAL ENGINEER WHO IS LICENSED TO STAMP AND SIGN THE STRUCTURAL DOCUMENTS FOR THE PROJECT. THE SER IS RESPONSIBLE FOR THE DESIGN OF THE PRIMARY STRUCTURAL SYSTEM.
- 3.3. "SUBMIT FOR REVIEW" SUBMIT TO THE ARCHITECT/SER FOR REVIEW PRIOR TO FABRICATION OR
- 3.4. "PER PLAN" INDICATES REFERENCES TO THE STRUCTURAL PLANS, ELEVATIONS, AND STRUCTURAL GENERAL NOTES.
- 3.5. "SEISMIC FORCE RESISTING SYSTEM" (SFRS) A RECOGNIZED STRUCTURAL SYSTEM OF COMPONENTS (BEAMS, BRACES, DRAGS, STRUTS, COLLECTORS, DIAPHRAGMS, COLUMNS, WALLS, ETC.) OF THE PRIMARY STRUCTURE THAT ARE SPECIALLY DESIGNED AND PROPORTIONED TO RESIST EARTHQUAKE-INDUCED GROUND MOTIONS AND MAINTAIN STABILITY OF THE STRUCTURE FABRICATION AND INSTALLATION OF COMPONENTS DESIGNATED AS PART OF THE SFRS REQUIRE THE GENERAL CONTRACTOR, SUBCONTRACTOR, OR SUPPLIER WHO IS RESPONSIBLE FOR ANY PORTION OF SFRS FABRICATION OR INSTALLATION TO COMPLY WITH SPECIAL REQUIREMENTS (INCLUDING, BUT NOT LIMITED TO, MATERIAL CONTROL, COMPLIANCE CERTIFICATIONS, PERSONNEL QUALIFICATIONS, DOCUMENTATION, REPORTING REQUIREMENTS, ETC.) AND TO PROVIDE THE REQUIRED QUALITY CONTROL INCLUDING THE REQUIRED COORDINATION OF SPECIAL INSPECTIONS (QUALITY ASSURANCE - QA). SPECIAL PROVISIONS APPLY TO ANY MEMBER DESIGNATED AS PART OF THE SFRS. REFER TO PLANS, ELEVATIONS, DETAILS, DESIGN CRITERIA, AND SYMBOLS AND LEGENDS FOR APPLICABLE MEMBERS AND CONNECTIONS.
- 3.6. "SPECIALTY STRUCTURAL ENGINEER" (SSE) A PROFESSIONAL ENGINEER (PE OR SE), LICENSED IN THE STATE IN WHICH THE PROJECT IS LOCATED (TYPICALLY NOT THE SER), WHO PERFORMS SPECIALTY STRUCTURAL ENGINEERING SERVICES FOR SELECTED SPECIALTY-ENGINEERED ELEMENTS IDENTIFIED IN THE CONTRACT DOCUMENTS AND WHO HAS EXPERIENCE AND TRAINING IN THE SPECIALTY. DOCUMENTS STAMPED AND SIGNED BY THE SSE SHALL BE COMPLETED BY, OR UNDER, THE DIRECT SUPERVISION OF THE SSE.
- 3.7. "BIDDER-DESIGNED" COMPONENTS OF THE STRUCTURE THAT REQUIRE THE GENERAL CONTRACTOR, SUBCONTRACTOR, OR SUPPLIER WHO IS RESPONSIBLE FOR THE DESIGN, FABRICATION, AND INSTALLATION OF SPECIALTY-ENGINEERED ELEMENTS IDENTIFIED IN THE CONTRACT DOCUMENTS TO RETAIN THE SERVICES OF AN SSE. SUBMITTALS OF "BIDDER-DESIGNED" ELEMENTS SHALL BE STAMPED AND SIGNED BY THE SSE.
- 4. SPECIFICATIONS: REFER TO THE PROJECT SPECIFICATIONS ISSUED AS PART OF THE CONTRACT DOCUMENTS FOR INFORMATION SUPPLEMENTAL TO THESE DRAWINGS
- 5. OTHER DRAWINGS: REFER TO THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, CIVIL AND PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION INCLUDING, BUT NOT LIMITED TO, DIMENSIONS, ELEVATIONS, SLOPES, DOOR AND WINDOW OPENINGS, NON-BEARING WALLS, STAIRS, FINISHES, DRAINS, WATERPROOFING, RAILINGS, CURTAIN WALLS, ELEVATORS, CURBS, DEPRESSIONS, MECHANICAL UNIT LOCATIONS, AND OTHER NON-STRUCTURAL ITEMS.
- 6. STRUCTURAL DETAILS: THE STRUCTURAL DRAWINGS ARE INTENDED TO SHOW THE GENERAL CHARACTER AND EXTENT OF THE PROJECT AND ARE NOT INTENDED TO SHOW ALL DETAILS OF THE WORK. USE ENTIRE DETAIL SHEETS AND SPECIFIC DETAILS REFERENCED IN THE PLANS AS "TYPICAL" WHEREVER THEY APPLY. SIMILARLY, USE DETAILS ON ENTIRE SHEETS WITH "TYPICAL" IN THE NAME
- 7. STRUCTURAL RESPONSIBILITIES: THE SER IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE PRIMARY STRUCTURE IN ITS COMPLETED FORM.
- 8. COORDINATION: THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING DETAILS AND ACCURACY OF THE WORK, CONFIRMING AND CORRELATING ALL QUANTITIES AND DIMENSIONS, SELECTING FABRICATION PROCESSES, TECHNIQUES OF ASSEMBLY, AND PERFORMING WORK IN A SAFE AND SECURE MANNER.
- 9. EXISTING CONDITIONS: INFORMATION SHOWN ON THE DRAWINGS RELATED TO EXISTING CONDITIONS REPRESENT THE PRESENT KNOWLEDGE BUT WITHOUT GUARANTEE OF ACCURACY. REPORT CONDITIONS THAT CONFLICT WITH CONTRACT DOCUMENTS TO THE ARCHITECT OR SER. DO NOT DEVIATE FROM THE CONTRACT DOCUMENTS WITHOUT WRITTEN DIRECTION FROM THE ARCHITECT AND/OR SER. ALL EXISTING DIMENSIONS AND INFORMATION SHALL BE FIELD VERIFIED PRIOR TO FABRICATION AS REQUIRED TO COORDINATE WITH NEW CONSTRUCTION.
- 10. NEW CONSTRUCTION: THE CONTRACTOR SHALL REMOVE ALL INTERFERING ITEMS FOR NEW CONSTRUCTION AND SHALL REPAIR OR REPLACE ALL REMOVED ITEMS TO MATCH THE EXISTING CONDITIONS IN ACCORDANCE WITH THE ARCHITECTURAL DRAWINGS. NEW CONSTRUCTION ELEMENTS SHALL BE DESIGNED AND INSTALLED PER THE CURRENT IBC AS ALLOWED BY THE OSSC.
- 11. PRE-CONSTRUCTION MEETINGS: THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING PRE-CONSTRUCTION MEETINGS PRIOR TO COMMENCING WORK. PRE-CON MEETINGS, SCHEDULED APPROXIMATELY TWO WEEKS PRIOR TO THE START OF THE RELEVANT WORK, ARE REQUIRED FOR THE FOLLOWING PHASES OF CONSTRUCTION: STRUCTURAL STEEL, WOOD FRAMING, ATTENDEES FOR PRE-CONSTRUCTION MEETING ARE TO INCLUDE THE CONTRACTOR, RELEVANT SUBCONTRACTORS. FABRICATORS, INSPECTORS, ARCHITECT/SER, AND A REPRESENTATIVE OF THE AHJ WHERE REQUIRED. MEETING AGENDAS ARE TO INCLUDE REVIEW OF THE WORK SCOPE, PROJECT SCHEDULE RELEVANT TO THE WORK, CONTACT INFORMATION OF RESPONSIBLE PARTIES, INSPECTION POINTS, REVIEW OF MATERIALS AND ANY SPECIAL CASES OR ISSUES, PROCEDURES FOR CLARIFICATIONS IF REQUIRED, TESTING AND ACCEPTANCE, ETC.
- 12. MEANS, METHODS, AND SAFETY REQUIREMENTS: THE CONTRACTOR IS RESPONSIBLE FOR THE MEANS AND METHODS OF CONSTRUCTION AND ALL JOB-RELATED SAFETY STANDARDS SUCH AS OSHA AND DOSH (DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH). THE CONTRACTOR IS RESPONSIBLE FOR MEANS AND METHODS OF CONSTRUCTION RELATED TO THE INTERMEDIATE STRUCTURAL CONDITIONS (I.E., MOVEMENT OF THE STRUCTURE DUE TO MOISTURE AND THERMAL EFFECTS, CONSTRUCTION SEQUENCE, TEMPORARY BRACING, ETC.).
- 13. BRACING/SHORING DESIGN ENGINEER: THE CONTRACTOR SHALL, AT THEIR DISCRETION, EMPLOY AN SSE FOR THE DESIGN OF ANY TEMPORARY BRACING AND SHORING. SUBMIT CONSTRUCTION SEQUENCE TO ARCHITECT/ENGINEER FOR REVIEW.
- 14. TEMPORARY SHORING, BRACING: THE CONTRACTOR IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE STRUCTURE DURING CONSTRUCTION AND SHALL PROVIDE TEMPORARY SHORING. BRACING, AND OTHER ELEMENTS REQUIRED TO MAINTAIN STABILITY UNTIL THE STRUCTURE IS COMPLETE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO BE FAMILIAR WITH THE WORK REQUIRED IN THE CONSTRUCTION DOCUMENTS AND THE REQUIREMENTS FOR EXECUTING IT PROPERLY.
- 15. CONSTRUCTION LOADS: LOADS ON THE STRUCTURE DURING CONSTRUCTION SHALL NOT EXCEED THE DESIGN LOADS AS NOTED IN DESIGN CRITERIA AND LOADS SECTION OF THESE GENERAL NOTES OR THE CAPACITY OF PARTIALLY COMPLETED CONSTRUCTION AS DETERMINED BY THE CONTRACTOR'S SSE FOR
- 16. CHANGES IN LOADING: THE CONTRACTOR HAS THE RESPONSIBILITY TO NOTIFY THE SER OF ANY ARCHITECTURAL, MECHANICAL, ELECTRICAL, OR PLUMBING LOAD IMPOSED ONTO THE STRUCTURE THAT DIFFERS FROM, OR THAT IS NOT DOCUMENTED ON, THE ORIGINAL CONTRACT DOCUMENTS (ARCHITECTURAL, STRUCTURAL, MECHANICAL, ELECTRICAL, OR PLUMBING DRAWINGS). PROVIDE DOCUMENTATION OF THE LOCATION, LOAD, SIZE, AND ANCHORAGE OF ALL UNDOCUMENTED LOADS IN EXCESS OF 400 LB. PROVIDE MARKED-UP STRUCTURAL PLANS INDICATING THE LOCATIONS OF ANY NEW EQUIPMENT OR LOADS. SUBMIT THESE PLANS TO THE ARCHITECT/ENGINEER FOR REVIEW PRIOR TO INSTALLATION.
- 17. NOTE PRIORITIES: PLAN AND DETAIL NOTES AND SPECIFIC LOADING DATA PROVIDED ON INDIVIDUAL PLANS AND DETAIL DRAWINGS SUPPLEMENTS INFORMATION IN THESE GENERAL NOTES.
- 18. DISCREPANCIES: IN CASE OF DISCREPANCIES BETWEEN THE GENERAL NOTES, SPECIFICATIONS PLANS/DETAILS, OR REFERENCE STANDARDS, THE ARCHITECT/ENGINEER SHALL DETERMINE WHICH SHALL GOVERN. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER BEFORE PROCEEDING WITH THE WORK. SHOULD ANY DISCREPANCY BE FOUND IN THE CONTRACT DOCUMENTS. THE CONTRACTOR WILL BE DEEMED TO HAVE INCLUDED IN THE PRICE THE MOST EXPENSIVE WAY OF COMPLETING THE WORK UNLESS PRIOR TO THE SUBMISSION OF THE PRICE. THE CONTRACTOR ASKS FOR A DECISION FROM THE ARCHITECT AS TO WHICH SHALL GOVERN. ACCORDINGLY, ANY CONFLICT IN OR BETWEEN THE CONTRACT DOCUMENTS SHALL NOT BE A BASIS FOR ADJUSTMENT IN THE CONTRACT PRICE.
- 19. SITE VERIFICATION: THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE. CONFLICTS BETWEEN THE DRAWINGS AND ACTUAL SITE CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER BEFORE PROCEEDING WITH THE WORK.

- 20. ADJACENT UTILITIES: THE CONTRACTOR SHALL DETERMINE THE LOCATION OF ALL ADJACENT UNDERGROUND UTILITIES PRIOR TO EARTHWORK, FOUNDATION WORK, SHORING AND EXCAVATION. ANY UTILITY INFORMATION SHOWN ON THE DRAWINGS AND DETAILS IS APPROXIMATE AND NOT NECESSARILY
- 21. ALTERNATES: ALTERNATE PRODUCTS OF SIMILAR STRENGTH, NATURE, AND FORM FOR SPECIFIED ITEMS MAY BE SUBMITTED WITH ADEQUATE TECHNICAL DOCUMENTATION (PROPER TEST REPORT, ETC.) TO THE ARCHITECT/ENGINEER FOR REVIEW. ALTERNATE MATERIALS THAT ARE SUBMITTED WITHOUT ADEQUATE TECHNICAL DOCUMENTATION OR THAT SIGNIFICANTLY DEVIATE FROM THE DESIGN INTENT OF MATERIALS SPECIFIED MAY BE RETURNED WITHOUT REVIEW. ALTERNATES THAT REQUIRE SUBSTANTIAL EFFORT TO REVIEW WILL NOT BE REVIEWED UNLESS AUTHORIZED BY THE OWNER.
- 22. NARRATIVE: THE FOLLOWING ITEMS WILL BE REPAIRED, MODIFIED, OR ADDED FOR THIS PROJECT 22.1. THE BUILDING IS A TWO STORY REINFORCED CONCRETE WALL BUILDING WITH WOOD FRAMING AT THE SECOND STORY FLOOR, ROOF AN PARTITION WALLS BUILT IN THE 1950. THE SEISMIC UPGRADE PROPOSED IN THESE PLANS ARE TO REMEDY TIER 1 DEFICIENCIES DESCRIBED IN THE DCI ENGINEERS REPORT DATED 01/04/2024.

23. ADDITIONS/ALTERATIONS/REPAIRS:

- 23.1. ADDITIONS, ALTERATIONS, AND/OR REPAIRS TO THE EXISTING STRUCTURE HAVE BEEN ANALYZED FOR ADDITIONAL LOADING AND/OR MODIFICATION DUE TO THE ADDITION, ALTERATION, OR REPAIR.
- 23.2. ALL AFFECTED EXISTING MEMBERS HAVE BEEN ANALYZED OR REINFORCED AS REQUIRED PER THE
- 23.3. ALL DEMOLITION OR REMOVAL OF ARCHITECTURAL, MECHANICAL, OR STRUCTURAL ELEMENTS SHALL NOT DAMAGE STRUCTURAL ITEMS TO REMAIN.

01.10.00 DESIGN CRITERIA AND LOADS

1. OCCUPANCY:


RISK CATEGORY OF BUILDING PER OSSC TABLE 1604.5

<u>PLAN</u>

2. WIND DESIGN: MAIN WIND FORCE RESISTING SYSTEM: ULTIMATE DESIGN WIND SPEED, VULT **EXPOSURE CATEGORY** INTERNAL PRESSURE COEFFICIENT, Cpi TOPOGRAPHIC FACTOR, Kzt WIND ANALYSIS PROCEDURE USED

135 MPH ±0.18 **ENVELOPE**

. WIND DESIGN: COMPONENTS AND CLADDING (C&C) PRESSURES FOR DESIGN (PSF, ULTIMATE):

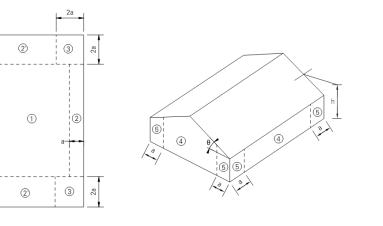

ISOMETRIC

BEARING WALL SYSTEMS

CONCRETE SHEAR WALLS

		EFFECTIVE WII	ND AREA (FT ²)		
a = 5'-0"	<u>10</u>	<u>20</u>	<u>50</u>	<u>100</u>	<u>500</u>
ZONE 1	-16 / + 16	-16 / + 16	-16 / + 16	-16 / + 16	-1 6 / + 16
ZONE 2	-39 / +16	-39 / +16	-38 / +16	-37 / +16	-37 / +16
ZONE 2'	-47 / +16	-47 / +16	-45 / +16	-45 / +16	-45 / +16
ZONE 3	-53 / +16	-48 / +16	-42 / +16	-37 / +16	-37 / +16
ZONE 3'	-74 / +16	-66 / +16	-55 / +16	-47 / +16	-47 / +16
ZONE 4	-31 / +29	-30 / +28	-28 / +26	-27 / +25	-24 / +22
ZONE 5	-38 / +29	-36 / +28	-33 / +26	-30 / +25	-24 / +22

- 3.1. COMPONENTS AND CLADDING WIND PRESSURES ARE BASED ON ASCE 7 CHAPTER 30 PART 1 "LOW-
- 3.2. COMPONENTS AND CLADDING ZONE LOCATIONS ARE BASED ON ASCE 7 FIGURE 30.3-5A FOR MONOSLOPE ROOFS $3^{\circ} < \Theta \le 10^{\circ}$.
- 3.3. COMPONENTS AND CLADDING ZONE LOCATIONS ARE BASED ON ASCE 7 FIGURE 30.3-1 FOR WALLS 3.4. ALL PARAPET COMPONENTS AND CLADDING WIND PRESSURES SHALL BE DETERMINED THROUGH ASCE 7 FIGURE 30.6-1

4. SEISMIC DESIGN:

SEISMIC DESIGN CATEGORY, SDC SITE CLASS PER IEBC SECTION 301.1.4.2 AND ASCE 41 CHAPTER 2.4 BASIC SAFETY EARTHQUAKES (BSE) BSE-1E, LIFE SAFETY MAPPED RESPONSE ACCELERATION (SHORT PERIOD), Sxs MAPPED RESPONSE ACCELERATION (1-SECOND PERIOD), S_{X1} 0.082g BSE-2E, IMMEDIATE OCCUPANCY MAPPED RESPONSE ACCELERATION (SHORT PERIOD), Sxs MAPPED RESPONSE ACCELERATION (1-SECOND PERIOD), Sx1 SEISMIC ANALYSIS PROCEDURE USED LINEAR STATIC

5. SNOW LOAD:

7. DESIGN DEAD LOADS:

BASIC STRUCTURAL SYSTEM

SEISMIC FORCE RESISTING SYSTEM

FLAT ROOF SNOW LOAD, Pf 25 PSF [NOTE 5.1] SNOW DRIFT LOADING REQUIRED BY AHJ? SNOW LOAD IMPORTANCE FACTOR, Is 1.20 [NOTE 5.3] GROUND SNOW LOAD, Po 1 PSF SNOW EXPOSURE FACTOR, Ce 0.9 THERMAL FACTOR, Ct

SEE ROOF PLAN FOR DRIFT LOADING 5.1. SNOW LOAD IS UN-REDUCIBLE AND INCLUDES 5 PSF RAIN-ON-SNOW SURCHARGE WHERE GROUND SNOW LOAD IS 20 PSF OR LESS, BUT NOT ZERO, PER ASCE 7 SECTION 7.10.

5.2. SNOW LOAD BASED ON ASCE FIGURE 7-1. 5.3. SNOW LOAD IMPORTANCE FACTOR PER ASCE 7 TABLE 1.5-2.

 DESIGN LIVE LOADS: SEE STRUCTURAL LOADING PLANS FOR AREA LOADS AND LINE LOADS. LOADS LISTED BELOW ARE FOR MISCELLANEOUS ITEMS.

INTERIOR WALLS AND PARTITIONS 5 (APPLIED HORIZONTALLY) 20 PSF (REDUCIBLE) OR 300 LB [NOTE 6.1]. SEE SECTION 5 FOR SNOW LOAD

ROOF DEAD LOAD (IN ADDITION TO STRUCTURE SELF-WEIGHT) ROOFING

ROOF, LIVE/SNOW/WIND LOAD (RLL)

01.20.00 SUBMITTALS

8. DEFLECTION LIMITS FOR SSE / BIDDER-DESIGNED ELEMENTS: ROOF MEMBERS, DEAD + LIVE/SNOW/WIND, TOTAL LOAD (TL)

8.1. MAXIMUM VERTICAL DEFLECTION IS WHICHEVER CRITERIA YIELDS LESS DEFLECTION. L IS THE CLEAR SPAN LENGTH IN INCHES.

8.2. WIND LOAD IS REDUCIBLE TO 0.42 * THE COMPONENT AND CLADDING (C&C) LOADS PER TABLE 1604.3

REQUIRED FOR ITEMS NOTED IN THE INDIVIDUAL MATERIALS SECTIONS OF THESE GENERAL NOTES AND FOR BIDDER-DESIGNED ELEMENTS.

SUBMITTAL REVIEW PERIOD: SUBMITTALS SHALL BE MADE IN TIME TO PROVIDE A MINIMUM OF TWO WEEKS OR TEN WORKING DAYS FOR REVIEW BY THE ARCHITECT/ENGINEER PRIOR TO THE ONSET OF FABRICATION.

SUBMIT FOR REVIEW: SUBMITTALS OF SHOP DRAWINGS, PRODUCT DATA, AND MILL TESTS ARE

- GENERAL CONTRACTOR'S PRIOR REVIEW: PRIOR TO SUBMISSION TO THE ARCHITECT/ENGINEER, THE CONTRACTOR SHALL REVIEW THE SUBMITTAL FOR COMPLETENESS. DIMENSIONS AND QUANTITIES ARE NOT REVIEWED BY THE SER; THEREFORE, THEY MUST BE VERIFIED BY THE GENERAL CONTRACTOR. THE CONTRACTOR SHALL PROVIDE ANY NECESSARY DIMENSIONAL DETAILS REQUESTED BY THE DETAILER AND PROVIDE THE CONTRACTOR'S REVIEW STAMP AND SIGNATURE BEFORE FORWARDING TO THE
- 4. SHOP DRAWING REVIEW: ONCE THE CONTRACTOR HAS COMPLETED THEIR REVIEW, THE SER WILL REVIEW THE SUBMITTAL FOR GENERAL CONFORMANCE WITH THE DESIGN CONCEPT AND THE CONTRACT DOCUMENTS OF THE BUILDING AND WILL STAMP THE SUBMITTAL ACCORDINGLY. MARKINGS OR COMMENTS SHALL NOT BE CONSTRUED AS RELIEVING THE CONTRACTOR FROM COMPLIANCE WITH THE PROJECT PLANS AND SPECIFICATIONS, NOR DEPARTURES THERE FROM. THE SER WILL RETURN SUBMITTALS IN THE FORM IN WHICH THEY ARE SUBMITTED (EITHER HARD COPY OR ELECTRONIC). FOR HARD COPY SUBMITTALS, THE CONTRACTOR IS RESPONSIBLE FOR SUBMITTING THE REQUIRED NUMBER OF COPIES TO THE SER FOR REVIEW.
- SHOP DRAWING DEVIATIONS: WHEN SHOP DRAWINGS (COMPONENT DESIGN DRAWINGS) DIFFER FROM OR ADD TO THE REQUIREMENTS OF THE STRUCTURAL DRAWINGS, THEY SHALL BE DESIGNED AND STAMPED BY THE RESPONSIBLE SSE.

01.30.00 DEFERRED SUBMITTALS

- 1. BIDDER-DESIGNED ELEMENTS: SUBMIT "BIDDER-DESIGNED" DEFERRED SUBMITTALS TO THE ARCHITECT AND SER FOR REVIEW. THE DEFERRED SUBMITTALS SHALL ALSO BE SUBMITTED TO THE CITY FOR APPROVAL IF REQUIRED BY THE CITY. DESIGN OF PREFABRICATED, "BIDDER-DESIGNED," MANUFACTURED, PRE-ENGINEERED, OR OTHER FABRICATED PRODUCTS SHALL COMPLY WITH THE FOLLOWING REQUIREMENTS:
- 1.1. DESIGN CONSIDERS TRIBUTARY DEAD, LIVE, WIND, AND EARTHQUAKE LOADS IN COMBINATIONS
- 1.2. DESIGN WITHIN THE DEFLECTION LIMITS NOTED IN THESE GENERAL NOTES AND AS SPECIFIED OR REFERENCED IN THE OSSC.
- 1.3. DESIGN SHALL CONFORM TO THE SPECIFICATIONS AND REFERENCE STANDARDS OF THE
- 1.4. SUBMITTAL SHALL INCLUDE:
 - 1.4.1. CALCULATIONS PREPARED, STAMPED, AND SIGNED BY THE SSE DEMONSTRATING CODE
 - 1.4.2. ENGINEERED COMPONENT DESIGN DRAWINGS ARE PREPARED, STAMPED, AND SIGNED BY
 - 1.4.3. PRODUCT DATA, TECHNICAL INFORMATION AND MANUFACTURER'S WRITTEN REQUIREMENTS,
 - AND AGENCY APPROVALS AS APPLICABLE. 1.4.4. THE SSE MAY SUBMIT TO THE ARCHITECT/ENGINEER A REQUEST TO UTILIZE RELEVANT ALTERNATE DESIGN CRITERIA OF SIMILAR NATURE AND GENERAL EQUIVALENCY WHICH IS

DOCUMENTATION OF DESIGN. 2. GENERAL CONTRACTOR'S PRIOR REVIEW:

2.1. ONCE THE CONTRACTOR HAS COMPLETED THEIR REVIEW OF THE SSE COMPONENT DRAWINGS, THE SER WILL REVIEW THE SUBMITTAL FOR GENERAL CONFORMANCE WITH THE DESIGN OF THE BUILDING AND WILL STAMP THE SUBMITTAL ACCORDINGLY.

RECOGNIZED BY THE CODE AND ACCEPTABLE TO THE AHJ. SUBMIT ADEQUATE

- 2.2. REVIEW OF THE SSE'S SHOP DRAWINGS (COMPONENT DESIGN DRAWINGS) IS FOR COMPLIANCE WITH DESIGN CRITERIA AND COMPATIBILITY WITH THE DESIGN OF THE PRIMARY STRUCTURE AND DOES NOT RELIEVE THE SSE OF RESPONSIBILITY FOR THAT DESIGN
- 2.3. ALL NECESSARY BRACING, TIES, ANCHORAGE, AND PROPRIETARY PRODUCTS SHALL BE FURNISHED AND INSTALLED PER MANUFACTURER'S INSTRUCTIONS OR THE SSE'S DESIGN DRAWINGS AND CALCULATIONS
- 2.4. BIDDER-DESIGNED ELEMENTS INCLUDE BUT ARE NOT LIMITED TO:
- 2.4.1. FRP 2.4.2. MECHANICAL, ELECTRICAL, PLUMBING, AND SPRINKLER HANGER PLANS
- 2.4.4. FAÇADE ACCESS EQUIPMENT / LIFELINE SUPPORTS

01.40.00 INSPECTIONS, QUALITY ASSURANCE, AND TEST **REQUIREMENTS**


- 1. INSPECTIONS: FOUNDATIONS, FOOTINGS, AND UNDER SLAB SYSTEMS AND FRAMING ARE SUBJECT TO INSPECTION BY THE BUILDING OFFICIAL IN ACCORDANCE WITH OSSC SECTION 110.3. THE CONTRACTOR SHALL COORDINATE ALL REQUIRED INSPECTIONS WITH THE BUILDING OFFICIAL.
- 2. SPECIAL INSPECTIONS, VERIFICATIONS, AND TESTS: SPECIAL INSPECTIONS, VERIFICATIONS, AND TESTING SHALL BE DONE IN ACCORDANCE WITH OSSC CHAPTER 17. THE STATEMENT AND SCHEDULES OF SPECIAL INSPECTIONS LISTED IN THESE DRAWINGS, AND THE AHJ STATEMENT OF SPECIAL INSPECTION AND/OR STATEMENT OF STRUCTURAL OBSERVATIONS.

3. STRUCTURAL OBSERVATION:

- 3.1. STRUCTURAL OBSERVATION FOR THIS PROJECT IS REQUIRED PER OSSC SECTION 1704.6. THE CONTRACTOR SHALL NOTIFY THE SER IN A TIMELY MANNER TO ALLOW REQUIRED STRUCTURAL OBSERVATIONS TO OCCUR. REPORTS WILL BE DISTRIBUTED TO THE ARCHITECT, CONTRACTOR. SPECIAL INSPECTOR, AND AHJ.
 - 3.1.1. THE FREQUENCY AND EXTENT OF OBSERVATIONS IS AT THE DISCRETION OF THE STRUCTURAL OBSERVER.
- 3.1.2. ONLY SIGNIFICANT STAGES OF CONSTRUCTION IDENTIFIED BY THE STRUCTURAL OBSERVER REQUIRE OBSERVATION. 3.1.3. FOR REPETITIVE OR SIMILAR STRUCTURAL ELEMENTS IDENTIFIED AS SIGNIFICANT, ONLY THE
- FIRST ELEMENT OF A STAGE REQUIRES OBSERVATION UNLESS NOTED OTHERWISE. 3.1.4. THE FOLLOWING SIGNIFICANT STAGES OF CONSTRUCTION REQUIRE OBSERVATION:
- 3.1.4.1. PRIOR TO FOUNDATION CONCRETE PLACEMENT
- 3.1.4.2. AFTER ROOF DIAPHRAGM IS COMPLETE PRIOR TO ROOFING
- 4. CONTRACTOR RESPONSIBILITY: PRIOR TO ISSUANCE OF THE BUILDING PERMIT, THE CONTRACTOR IS REQUIRED TO PROVIDE THE AHJ A SIGNED, WRITTEN ACKNOWLEDGEMENT OF THE CONTRACTOR'S RESPONSIBILITIES ASSOCIATED WITH THE STATEMENT OF SPECIAL INSPECTIONS, PREVIOUSLY REFERENCED, ADDRESSING THE REQUIREMENTS LISTED IN OSSC SECTION 1704.4. THE CONTRACTOR IS REFERRED TO OSSC SECTIONS 1705.13.5 AND 1705.13.6 FOR ARCHITECTURAL AND MEP BUILDING SYSTEMS THAT MAY BE SUBJECT TO ADDITIONAL INSPECTIONS (BASED ON THE BUILDING'S DESIGNATED SEISMIC DESIGN CATEGORY LISTED IN THE DESIGN CRITERIA AND LOADS SECTION OF THESE GENERAL NOTES), INCLUDING ANCHORAGE OF HVAC DUCTWORK CONTAINING HAZARDOUS MATERIALS, PIPING SYSTEMS AND MECHANICAL UNITS CONTAINING FLAMMABLE, COMBUSTIBLE, OR HIGHLY TOXIC MATERIALS, ELECTRICAL EQUIPMENT USED FOR EMERGENCY OR STANDBY POWER, EXTERIOR WALL PANELS, AND SUSPENDED CEILING SYSTEMS.

02.00.00 SOILS AND FOUNDATION

- 1. REFERENCE STANDARDS: CONFORM TO OSSC CHAPTER 18 "SOILS AND FOUNDATIONS"
- 2. GEOTECHNICAL REPORT: RECOMMENDATIONS CONTAINED IN GEOTECHNICAL INVESTIGATION REPORT AND SITE SEISMIC HAZARD STUDY EASTSIDE FIRE STATION #3 IMPROVEMENTS REPORT NO. 10-242116-001 BY EARTH ENGINEERS DATED 02/07/2025 WERE USED FOR DESIGN.
- 3. CONTRACTOR'S RESPONSIBILITIES: CONTRACTOR SHALL BE RESPONSIBLE TO REVIEW THE GEOTECHNICAL REPORT AND SHALL FOLLOW THE RECOMMENDATIONS SPECIFIED THEREIN INCLUDING. BUT NOT LIMITED TO, SUBGRADE PREPARATIONS, PILE INSTALLATION PROCEDURES, GROUND WATER MANAGEMENT, AND STEEP SLOPE BEST MANAGEMENT PRACTICES.

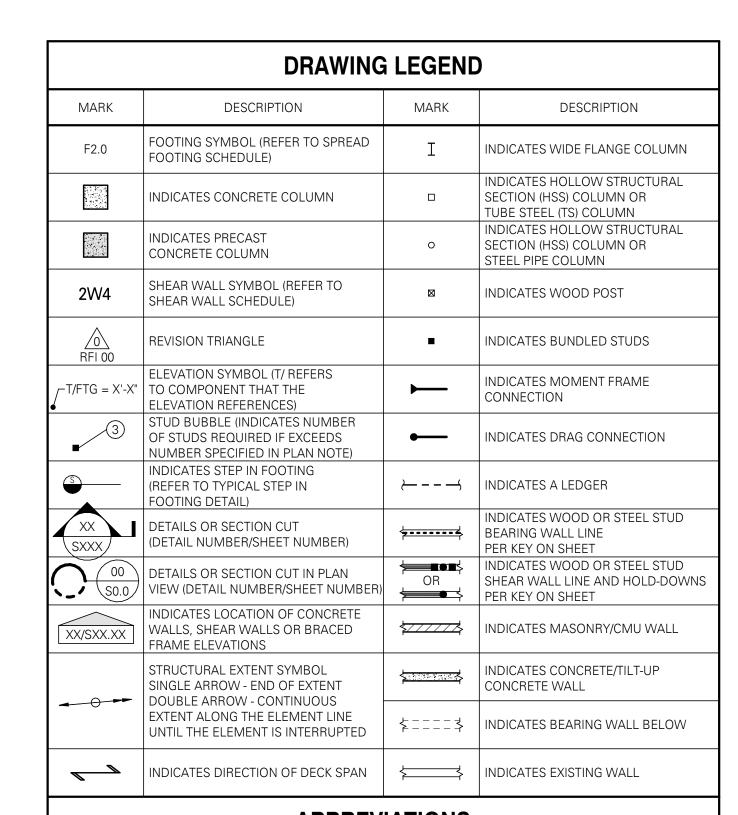

ABBREVIATIONS

EXCAV Excavation

Angle

PLF


Pounds Per Linear Foot

L	Angle	EXCAV	Excavation	PLF	Pounds Per Linear Foot
AB	Anchor Bolt	FB	Factory-Built	PLWD	Plywood
ADDL	Additional	FD	Floor Drain	PREFAB	Prefabricated
ADH	Adhesive	FDN	Foundation	PSF	Pounds per Square Foot
ALT	Alternate	FIN	Finish	PSI	Pounds Per Square Inch
ARCH	Architectural	FLR	Floor	PSL	Parallel Strand Lumber
B or BOT	Bottom	FRP	Fiberglass Reinforced Plastic	P-T	Post-Tensioned
B/	Bottom Of	FRT	Fire Retardant Treated	PT	Pressure Treated
BLDG	Building	FTG	Footing	R	Radius
BLKG	Blocking	F/	Face of	RD	Roof Drain
BMU	Brick Masonry Unit	GA	Gage	REF	Refer/Reference
	•				
BP	Baseplate	GALV	Galvanized	REINF	Reinforcing
BRBF	Buckling Restrained	GEOTECH	Geotechnical	REQD	Required
	Braced Frame	GL	Glue Laminated Timber	RET	Retaining
BRG	Bearing	GWB	Gypsum Wall Board	SB	Site-Built
BTWN	Between	HDR	Header	SCBF	Special Concentric
				JCDI	
C	Camber	HF	Hem-Fir	001155	Braced Frame
СВ	Castellated Beam	HGR	Hanger	SCHED	Schedule
C'BORE	Counterbore	HD	Hold-down	SER	Structural Engineer of
CL or Q	Centerline	HORIZ	Horizontal		Record
CLT	Cross-Laminated Timber	HP	High Point	SFRS	Seismic Force-
				01 110	
CIP	Cast in Place	HSS = TS	(Hollow Structural Section)	01.171.16	Resisting System
CFS	Cold Formed Steel	IBC	International Building Code	SHTHG	Sheathing
CJ	Construction or	ID	Inside Diameter	SIM	Similar
	Control Joint	IE	Invert Elevation	SLBB	Short Leg Back-to-Back
CJP	Complete Joint	iF	Inside Face	SMF	Special Moment Frame
COI	•	INT			
0.5	Penetration		Interior	SOG	Slab on Grade
CLR	Clear	k	Kips	SP	Southern Pine
CLG	Ceiling	KSF	Kips Per Square Foot	SPEC	Specification
CMU	Concrete Masonry Unit	LF	Lineal Foot	SQ	Square
COL	Column	LL	Live Load	SR	Studrail
CONC	Concrete	LLBB		SF	Square Foot
			Long Leg Back-to-Back		
CONN	Connection	LLH	Long Leg Horizontal	SST	Stainless Steel
CONST	Construction	LLV	Long Leg Vertical	STAGG	Stagger/Staggered
CONT	Continuous	LP	Low Point	STD	Standard
C'SINK	Countersink	LONGIT	Longitudinal	STIFF	Stiffener
CTRD	Centered	LSL	Laminated Strand Lumber	STL	Steel
DIA	Diameter	LVL	Laminated Veneer Lumber	STRUCT	Structural
DB	Drop Beam	MAS	Masonry	SWWJ	Solid Web Wood Joist
DBA	Deformed Bar Anchor	MAX	Maximum	SYM	Symmetrical
DBL	Double	MECH	Mechanical	T	Тор
DEMO	Demolish	MEP	Mechanical, Electrical,	T/	Top Of
		·V:L1			
DEV	Development		Plumbing	T&B	Top & Bottom
DF	Douglas Fir	MEZZ	Mezzanine	TC AX LD	Top Chord Axial Load
DIAG	Diagonal	MFR	Manufacturer	TCX	Top Chord Extension
DIST	Distributed	MIN	Minimum	TDS	Tie Down System
DL	Dead Load	MISC	Miscellaneous	T&G	Tongue & Groove
DN	Down	NIC	Not In Contract	THKND	Thickened
DO	Ditto	NLT	Nail-Laminated Timber	THRD	Threaded
DP	Depth/Deep	NTS	Not To Scale	THRU	Through
DWG	Drawing	OC	On Center	TRANSV	Transverse
(E)	Existing	OCBF	Ordinary Concentric Braced	TYP	Typical
	<u> </u>	ומטט			* *
EA	Each	0.0	Frame	UNO	Unless Noted Otherwis
EF	Each Face	OD	Outside Diameter	URM	Unreinforced Masonry
EL	Elevation	OF	Outside Face		Unit
ELEC	Electrical	OPNG	Opening	VERT	Vertical
ELEV	Elevator	OPP	Opposite	W	Wide
EMBED	Embedment	OWSJ	Open Web Steel Joist	W/	With
EQ	Equal	OWWJ	Open Web Wood Joist	W/O	Without
EQUIP	Equipment	PL	Plate	WHS	Welded Headed Stud
EW	Each Way	PAF	Powder Actuated Fastener	WP	Working Point
EXP	Expansion	PC	Precast	WWF	Welded Wire Fabric
EXP EXP JT					
FXP II	Expansion Joint	PERP	Perpendicular	±	Plus or Minus
EXT	Exterior	PJP	Partial Joint Penetration		

EAST SIDE FIRE STATION STRUCTURAL SHEET LIST

SHEET NUMBER	SHEET TITLE			
S1.1	STRUCTURAL - GENERAL NOTES, LEGEND, AND ABBREVIATIONS			
S1.2	STRUCTURAL - GENERAL NOTES CONTINUED			
S1.3	STRUCTURAL - GENERAL NOTES CONTINUED			
S1.4	STRUCTURAL - SPECIAL INSPECTIONS			
S2.1	STRUCTURAL - FIRST FLOOR FOUNDATION PLAN			
S2.2	STRUCTURAL - SECOND FLOOR FRAMING PLAN			
S2.3	STRUCTURAL - LOW ROOF FRAMING PLAN			
S2.4	STRUCTURAL - UPPER ROOF FRAMING PLAN			
S3.1	STRUCTURAL - ELEVATIONS			
S3.2	STRUCTURAL - ELEVATIONS			
S4.1	STRUCTURAL - FOUNDATION DETAILS			
S4.2	FOUNDATION DETAILS			
S5.1	STRUCTURAL - FRAMING DETAILS			
S6.0	STRUCTURAL - FRAMING DETAILS			
S7.0	STRUCTURAL - FRAMING DETAILS			
Sheet Total: 15				

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hgel.com



 \bigcirc

CONSTRUCTION REVISIONS:

DATE DESCRIPTION

DATE: APRIL 2025 SHEET TITLE: STRUCTURAL **GENERAL NOTES.** LEGEND, AND **ABBREVIATIONS**

5. **PILE TESTING**:

- 5.1. 10% (2 MINIMUM) OF THE PILES SHOULD BE PROOF TESTED IN TENSION TO 200% OF THE DESIGN LOAD SHOWN ON PLAN. THE GEOTECHNICAL ENGINEER SHALL SELECT PILES TO BE PROOF TESTED. PROOF TESTING MUST BE OBSERVED AND RECORDED BY THE GEOTECHNICAL ENGINEER.
- 5.2. ALL LOADING, TESTING, AND MEASURING EQUIPMENT SHOULD BE PROVIDED BY THE PILE CONTRACTOR AND APPROVED BY THE GEOTECHNICAL ENGINEER. THE LOADING AND MEASURING EQUIPMENT SHOULD MEET THE REQUIREMENTS SPECIFIED IN ASTM TEST METHOD D1143
- 5.3. PROOF LOAD SHALL BE MAINTAINED FOR 10 MINUTES. DISPLACEMENT (CREEP) OF THE PILES SHALL BE RECORDED AT 0, 1, 2, 3, 4, 5, 6, 7, 8, 9, AND 10 MINUTES AND A PLOT MADE AGAINST THE LOG OF TIME. IF THE PILE DISPLACEMENT BETWEEN 1 AND 10 MINUTES EXCEEDS 0.04 INCH THE PROOF LOAD SHALL BE MAINTAINED FOR AN ADDITIONAL 50 MINUTES AND DISPLACEMENT RECORDED AT 20, 30, 40, 50 AND 60 MINUTES.
- 5.4. ACCEPTANCE THE PILES WILL BE CONSIDERED ACCEPTABLE IF THE MEASURED DISPLACEMENT DOES NOT EXCEED 0.04 INCH IN THE MAXIMUM LOAD PROOF TEST FOR THE 10-MINUTE HOLD. FOR THE A 60-MINUTE HOLD, THE CREEP MOVEMENT SHALL NOT EXCEED 0.08IN DURING THE MAXIMUM
- 5.5. ALL LOADS SHOULD BE MAINTAINED WITHIN 5% OF THE INTENDED LOAD. ONCE THE MAXIMUM LOADING CONDITION IS REACHED, UNLOADING SHOULD BE ACCOMPLISHED IN TWO INCREMENTS: 50% AND 0% OF THE MAXIMUM LOAD.

03.20.00 CONCRETE REINFORCEMENT

1. **REFERENCE STANDARDS:** CONFORM TO:

- 1.1. ACI 301 "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE," SECTION 3 "REINFORCEMENT AND REINFORCEMENT SUPPORTS"
- 1.2. ACI SP-66 "ACI DETAILING MANUAL"
- 1.3. CRSI MSP "MANUAL OF STANDARD PRACTICE"
- 1.4. ANSI/AWS D1.4 "STRUCTURAL WELDING CODE REINFORCING STEEL"
- 1.5. OSSC CHAPTER 19 "CONCRETE"
- 1.6. ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE"
- 1.7. ACI 117 "SPECIFICATIONS FOR TOLERANCES FOR CONCRETE CONSTRUCTION AND MATERIALS"

- 2.1. CONFORM TO ACI 301 SECTION 3.1.2. SUBMIT PLACING DRAWINGS SHOWING FABRICATION DIMENSIONS AND PLACEMENT LOCATIONS OF REINFORCEMENT AND REINFORCEMENT SUPPORTS.
- 3. MATERIALS:

REINFORCING BARS [NOTE 3.1] SMOOTH WELDED WIRE FABRIC DEFORMED WELDED WIRE FABRIC BAR SUPPORTS

ASTM A615, GRADE 60, DEFORMED BARS ASTM A1064 ASTM A1064 CRSI MSP CHAPTER 3 16 GAGE OR HEAVIER, BLACK ANNEALED

- 3.1. ASSUME GRADE 60 REINFORCEMENT UNLESS NOTED OTHERWISE ON PLAN. REFERENCE PLANS FOR HIGH STRENGTH REINFORCING LOCATIONS, INDICATED BY (GR 80) OR (GR 100).
- 4. EARTHQUAKE REQUIREMENTS: LONGITUDINAL BARS IN DUCTILE FRAMES AND SHEAR WALLS AND COUPLING BEAMS OF SHEAR WALLS. SHALL CONFORM TO ASTM A706, GRADE 60 OR SHALL CONFORM TO
- 4.1. WELDING: WELDING IS NOT PERMITTED EXCEPT AS SPECIFIED IN THE DRAWINGS. WELD IN ACCORDANCE WITH AWS D1.4.
- 4.2. MILL TESTS: SUBMIT MILL CERTIFICATES INDICATING PHYSICAL AND CHEMICAL PROPERTIES
- 4.3. YIELD STRENGTH: ACTUAL YIELD STRENGTH, BASED ON MILL TESTS, DOES NOT EXCEED THE SPECIFIED YIELD STRENGTH BY MORE THAN 18,000 PSI. (RETESTS SHALL NOT EXCEED THIS VALUE BY MORE THAN AN ADDITIONAL 3,000 PSI.)
- 4.4. ULTIMATE STRENGTH: THE RATIO OF THE ACTUAL TENSILE STRENGTH TO THE ACTUAL YIELD
- 4.5. STRAIN: MINIMUM ELONGATION IN 8" SHALL BE AT LEAST:
- 4.5.1. 14% FOR BAR SIZES #3 THROUGH #6
- 4.5.2. 12% FOR BAR SIZES #7 THROUGH #11 4.5.3. 10% FOR BAR SIZES #14 AND #18
- 5. FABRICATION: CONFORM TO ACI 301 SECTION 3.2.2 AND ACI SP-66.
- 6. WELDING: BARS SHALL NOT BE WELDED UNLESS AUTHORIZED, WHEN AUTHORIZED, CONFORM TO ACI 301
- SECTION 3.2.2.2 AND AWS D1.4, AND PROVIDE ASTM A706, GRADE 60 REINFORCEMENT.
- 7. PLACING: CONFORM TO ACI 301 SECTION 3.3.2. PLACING TOLERANCES SHALL CONFORM TO ACI 117.
- 8. CONCRETE COVER: CONFORM TO THE FOLLOWING COVER REQUIREMENTS UNLESS NOTED OTHERWISE ON PLAN:

CONCRETE CAST AGAINST EARTH CONCRETE EXPOSED TO EARTH OR WEATHER 1-1/2" TIES IN COLUMNS AND BEAMS BARS IN SLABS 3/4" BARS IN WALLS

- 9. SPLICES: CONFORM TO ACI 301 SECTION 3.3.2.7. REFER TO TYPICAL LAP SPLICE AND DEVELOPMENT LENGTH SCHEDULE IN THESE DRAWINGS FOR TYPICAL REINFORCEMENT SPLICES. REFER TO "COLUMN VERTICAL REINFORCING SPLICE SCHEDULE" AND "SHEAR WALL REINFORCING SPLICE SCHEDULE" IN THESE DRAWINGS FOR THOSE SPECIFIC ELEMENTS. SPLICES INDICATED ON INDIVIDUAL SHEETS SHALL CONTROL OVER THE SCHEDULE. MECHANICAL CONNECTIONS MAY BE USED WHEN APPROVED BY THE SER. FOR REINFORCING WITHIN THE LATERAL SYSTEM SHEAR WALLS AND REINFORCING CONNECTING THE DIAPHRAGM SLAB TO THE LATERAL SYSTEM. MECHANICAL SPLICE STRENGTH IS INCREASED TO DEVELOP 125% OF THE SPECIFIED TENSILE STRENGTH OF THE SPLICES BAR.
- 10. FIELD BENDING: CONFORM TO ACI 301 SECTION 3.3.2.8. BAR SIZES #3 THROUGH #5 MAY BE FIELD BENT COLD THE FIRST TIME. SUBSEQUENT BENDS AND OTHER BAR SIZES REQUIRE PREHEATING. DO NOT TWIST BARS, BARS SHALL NOT BE BENT PAST 45°.

03.30.00 CAST-IN-PLACE CONCRETE

- 1. **REFERENCE STANDARDS:** CONFORM TO:
- 1.1. ACI 301 "SPECIFICATIONS FOR STRUCTURAL CONCRETE"
- 1.2. OSSC CHAPTER 19 "CONCRETE"
- 1.3. ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE"
- 1.4. ACI 117 "SPECIFICATIONS FOR TOLERANCES FOR CONCRETE CONSTRUCTION AND MATERIALS"
- 2. FIELD REFERENCE: THE CONTRACTOR SHALL KEEP A COPY OF ACI FIELD REFERENCE MANUAL SP-15. 3. CONCRETE MIXTURES: CONFORM TO ACI 301 SECTION 4 AND OSSC SECTION 1904.1.
- 4. MATERIALS: CONFORM TO ACI 301 SECTION 4.2.1 FOR REQUIREMENTS FOR CEMENTITIOUS MATERIALS, AGGREGATES, MIXING WATER, AND ADMIXTURES.

5. SUBMITTALS:

5.1. PROVIDE ALL SUBMITTALS REQUIRED BY ACI 301 SECTION 4.1.2. SUBMIT MIX DESIGNS FOR EACH MIX IN THE TABLE BELOW. SUBSTANTIATING STRENGTH RESULTS FROM PAST TESTS SHALL NOT BE

6. MIX DESIGN REQUIREMENTS [NOTES 7.1 TO 7.11, TYPICAL UNO]

OLDER THAN 24 MONTHS PER ACI 318 SECTION 26.4.3.1(B).

FOOTINGS STRENGTH, f' TEST AGE NOMINAL MAXIMUM AGGREGATE INTERIOR SLABS ON GRADE

4,000 PSI 56 DAYS

TEST AGE NOMINAL MAXIMUM AGGREGATE SHEAR WALLS STRENGTH, f'c TEST AGE

28 DAYS 6,000 PSI 56 DAYS NOMINAL MAXIMUM AGGREGATE

7. MIX DESIGN REQUIREMENT NOTES:

STRENGTH, f'

7.1. W/C RATIO: WATER-CEMENTITIOUS MATERIAL RATIOS SHALL BE BASED ON THE TOTAL WEIGHT OF CEMENTITIOUS MATERIALS. MAXIMUM RATIOS ARE CONTROLLED BY STRENGTH NOTED IN THE TABLE OF MIX DESIGN REQUIREMENTS AND DURABILITY REQUIREMENTS GIVEN IN ACI 318 SECTION 19.3. W/C RATIOS MAY BE EXCEEDED WITH APPROVAL OF SER AS LONG AS POTENTIAL SHRINKAGE IMPACTS ARE ACCOUNTED FOR.

3,000 PSI

7.2. CEMENTITIOUS MATERIALS: 7.2.1. DCI ENCOURAGES THE REDUCTION OF CEMENT CONTENT AND/OR THE USE OF ALTERNATE CEMENTITIOUS MATERIALS. WHERE REQUIREMENTS OF THIS SECTION PROHIBIT INCLUSION

OF ANY OF THESE MIXES, CONTACT DCI FOR FURTHER COORDINATION.

- 7.2.2. CEMENTITIOUS MATERIALS SHALL CONFORM TO THE RELEVANT ASTM STANDARDS LISTED IN ACI 318 SECTION 26.4.1.1.1(A). 7.2.3. FOR CONCRETE USED IN ELEVATED FLOORS, MINIMUM CEMENTITIOUS MATERIALS CONTENT SHALL CONFORM TO ACI 301 TABLE 4.2.1.1(B). ACCEPTANCE OF LOWER CEMENT CONTENT IS
- CONTINGENT ON PROVIDING SUPPORTING DATA TO THE SER FOR REVIEW AND ACCEPTANCE 7.2.4. CEMENT REPLACEMENT: THE USE OF FLY ASH, OTHER POZZOLANS, SILICA FUME, OR SLAG SHALL CONFORM TO ACI 318 SECTIONS 19.3.2 AND 26.4.2.2. SUPPLEMENTAL CEMENTITIOUS MATERIAL (SCM) QUANTITIES SHALL MEET REQUIREMENTS OUTLINED IN THE TABLE BELOW APPROACHING MAXIMUM CEMENT REPLACEMENT LIMITS MAY AFFECT CONCRETE SETTING TIME AND STRENGTH GAIN. CONTRACTOR AND SUPPLIER SHALL COORDINATE ON MIX DESIGNS WITH REGARD TO SCHEDULE, WORKABILITY, SHRINKAGE, AND FINISHABILITY REQUIREMENTS. WHERE SCM QUANTITIES DO NOT MEET THE FOLLOWING REQUIREMENTS, SUBMIT FOR SER APPROVAL. CONCERNS BY THE CONSTRUCTION TEAM WITH THE MIX DESIGN PROVIDED HEREIN SHALL BE BROUGHT TO THE SER'S ATTENTION IN THE MIX DESIGN SUBMITTAL PRIOR TO POURING CONCRETE.

REPLACEMENT	FOUNDATION	<u>SLABS</u>	WALLS/COLUMNS
MAXIMUM	70%	25%	50%
PREFERRED MINIMUM	25%	15%	25%

- 7.3. GENERAL CONTRACTOR SHALL COORDINATE MEANS AND METHODS NECESSARY TO SUPPORT EXTENDED TEST AGES INCLUDING, BUT NOT LIMITED TO, DELAYED STRENGTH GAIN, SHORING SEQUENCING, MODULUS OF ELASTICITY REQUIREMENTS, DEFLECTION, AND APPEARANCE.
- 7.4. AIR CONTENT: CONFORM TO ACI 318 SECTION 19.3.3.1. MINIMUM STANDARDS FOR EXPOSURE CLASS ARE NOTED IN THE TABLE. IF FREEZING AND THAWING CLASS IS NOT NOTED, AIR CONTENT GIVEN IS THAT REQUIRED BY THE SER. TOLERANCE IS ±1-1/2%. AIR CONTENT SHALL BE MEASURED AT POINT
- 7.5. AGGREGATES SHALL CONFORM TO ASTM C33. LIGHTWEIGHT AGGREGATES SHALL CONFORM TO
- ASTM C330. INSULATING LIGHTWEIGHT AGGREGATES SHALL CONFORM TO ASTM C332. 7.6. SLUMP: CONFORM TO ACI 301 SECTION 4.2.2.1. SLUMP SHALL BE DETERMINED AT POINT OF
- 7.7. CHLORIDE CONTENT: CONFORM TO ACI 318 TABLE 19.3.2.1
- 7.8. NON-CHLORIDE ACCELERATOR: NON-CHLORIDE ACCELERATING ADMIXTURE MAY BE USED IN
- CONCRETE PLACED AT AMBIENT TEMPERATURES BELOW 50°F AT THE CONTRACTOR'S OPTION. 7.9. ACI 318 SECTION 19.3.1.1 EXPOSURE CLASSES SHALL BE ASSUMED TO BE F0 UNLESS DIFFERENT EXPOSURE CLASSES ARE LISTED IN THE TABLE OF MIX DESIGN REQUIREMENTS THAT MODIFY
- 7.10. RECYCLED CARBON DIOXIDE (CO2) IS PERMISSIBLE TO BE INJECTED INTO THE MIX AS AN INGREDIENT DURING MIXING, SUCH THAT CO2 IS CHEMICALLY MINERALIZED INTO CONCRETE. CO2
- INJECTED INTO THE MIX MUST BE POST-INDUSTRIAL CO₂ SOURCED FROM AN EMITTER. 7.11. MODULUS OF ELASTICITY SHALL BE A MINIMUM OF 57,000 * √fc FOR ALL MIX DESIGNS
- 7.12. CORROSION INHIBITING ADMIXTURE: BEAMS AND PILE CAPS WITH A MARINE EXPOSURE SHALL CONTAIN 4-1/2 GALLONS OF CALCIUM NITRITE PER CUBIC YARD. TOPPING SLABS EXPOSED TO DEICING SALTS SHALL CONTAIN 2-1/2 GALLONS OF CALCIUM NITRITE PER CUBIC YARD.

8. STRENGTH TESTING AND ACCEPTANCE:

- 8.1. TESTING: OBTAIN SAMPLES AND CONDUCT TESTS IN ACCORDANCE WITH ACI 301 SECTION 1.7.3.3. ADDITIONAL SAMPLES MAY BE REQUIRED TO OBTAIN CONCRETE STRENGTHS AT ALTERNATE
- INTERVALS THAN SHOWN BELOW AND SHOULD BE STANDARD CURED PER ACI SECTION 26.5.3.2 8.1.1. CURE FOUR CYLINDERS FOR 28-DAY TEST AGE. TEST ONE CYLINDER AT 7 DAYS, TEST TWO CYLINDERS AT 28 DAYS, AND HOLD ONE CYLINDER IN RESERVE FOR USE AS THE ENGINEER DIRECTS. AFTER 56 DAYS, UNLESS NOTIFIED BY THE ENGINEER TO THE CONTRARY, THE RESERVE CYLINDER MAY BE DISCARDED WITHOUT BEING TESTED FOR SPECIMENS MEETING 28-DAY STRENGTH REQUIREMENTS.
- 8.1.2. CURE FIVE CYLINDERS FOR 56-DAY TEST AGE. TEST ONE AT 7 DAYS, ONE AT 28 DAYS, TWO AT 56 DAYS AND HOLD ONE CYLINDER IN RESERVE FOR USE AS THE ENGINEER DIRECTS. AFTER 72 DAYS, UNLESS NOTIFIED BY THE ENGINEER TO THE CONTRARY, THE RESERVE CYLINDER MAY BE DISCARDED WITHOUT BEING TESTED FOR SPECIMENS MEETING 56-DAY STRENGTH
- 8.1.3. CURE SIX CYLINDERS FOR 90-DAY TEST AGE. TEST ONE AT 7 DAYS, ONE AT 28 DAYS, ONE AT 56 DAYS, TWO AT 90 DAYS, AND HOLD ONE CYLINDER IN RESERVE FOR USE AS THE ENGINEER DIRECTS. AFTER 106 DAYS, UNLESS NOTIFIED BY THE ENGINEER TO THE CONTRARY, THE RESERVE CYLINDER MAY BE DISCARDED WITHOUT BEING TESTED FOR SPECIMENS MEETING 90-DAY STRENGTH REQUIREMENTS.
- 8.1.4. THE NUMBER OF CYLINDERS INDICATED ABOVE REFERENCE 6"x12" CYLINDERS. IF 4"x8" CYLINDERS ARE TO BE USED, ADDITIONAL CYLINDERS MUST BE CURED FOR TESTING OF THREE CYLINDERS AT TEST AGE PER THE TABLE OF MIX DESIGN REQUIREMENTS IN THESE GENERAL NOTES.
- 8.2. ACCEPTANCE:
- 8.2.1. STRENGTH IS SATISFACTORY WHEN THE AVERAGES OF ALL SETS OF THREE CONSECUTIVE TESTS EQUAL OR EXCEED THE SPECIFIED STRENGTH AND NO INDIVIDUAL TEST FALLS BELOW THE SPECIFIED STRENGTH BY MORE THAN 500 PSI.
- 8.2.2. A "TEST" FOR ACCEPTANCE IS THE AVERAGE STRENGTH OF TWO 6"x12" CYLINDERS OR THREE 4"x8" CYLINDERS TESTED AT THE SPECIFIED TEST AGE.
- 9. MEASURING, MIXING, AND DELIVERY: CONFORM TO ACI 301 SECTION 4.3.
- 10. HANDLING, PLACING, CONSTRUCTING AND CURING: CONFORM TO ACI 301 SECTION 5. IN ADDITION, HOT WEATHER CONCRETING SHALL CONFORM TO ACI 305R AND COLD WEATHER CONCRETING SHALL CONFORM TO ACI 306R.
- 11. POST-INSTALLED ANCHORS TO CONCRETE: ANCHOR LOCATION, TYPE, DIAMETER, AND EMBEDMENT SHALL BE AS INDICATED ON DRAWINGS. REFERENCE THE POST-INSTALLED ANCHORS SECTION OF THESE GENERAL NOTES FOR APPLICABLE POST-INSTALLED ANCHOR ADHESIVES. ANCHORS SHALL BE INSTALLED AND INSPECTED IN STRICT ACCORDANCE WITH THE APPLICABLE ICC-EVALUATION SERVICE REPORT (ESR). SPECIAL INSPECTION SHALL BE PER THE TESTS AND INSPECTIONS SECTION OF THESE GENERAL NOTES.

05.05.19 POST-INSTALLED ANCHORS (INTO CONCRETE AND <u>MASONRY)</u>

1. **REFERENCE STANDARDS:** CONFORM TO:

- 1.1. OSSC CHAPTER 19 "CONCRETE"
- 1.2. ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE"
- 1.3. OSSC CHAPTER 21 "MASONRY"
- 1.4. TMS 402 "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES"

2. POST-INSTALLED ANCHORS: INSTALL ONLY WHERE SPECIFICALLY SHOWN IN THE DETAILS OR ALLOWED BY THE SER. ALL POST-INSTALLED ANCHOR TYPES AND LOCATIONS SHALL BE APPROVED BY THE SER AND SHALL HAVE A CURRENT ICC-ESR THAT PROVIDES RELEVANT DESIGN VALUES NECESSARY TO VALIDATE THE AVAILABLE STRENGTH EXCEEDS THE REQUIRED STRENGTH. SUBMIT CURRENT MANUFACTURER'S DATA AND ICC-ESR TO THE SER FOR APPROVAL REGARDLESS OF WHETHER OR NOT IT IS A PRE-APPROVED ANCHOR. ANCHORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH ICC-ESR AND THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS (MPII) IN CONJUNCTION WITH EDGE DISTANCE, SPACING, AND EMBEDMENT DEPTH AS INDICATED ON THE DRAWINGS. THE CONTRACTOR SHALL ARRANGE FOR A MANUFACTURER'S FIELD REPRESENTATIVE TO PROVIDE INSTALLATION TRAINING FOR ALL PRODUCTS TO BE USED PRIOR TO THE COMMENCEMENT OF WORK. ONLY TRAINED INSTALLERS SHALL PERFORM POST-INSTALLED ANCHOR INSTALLATION. A RECORD OF TRAINING SHALL BE KEPT ON SITE AND BE MADE AVAILABLE TO THE SER AS REQUESTED. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS SHALL BE PERFORMED BY A CERTIFIED ADHESIVE ANCHOR INSTALLER (AAI) AS CERTIFIED THROUGH ACI/CRSI OR AN APPROVED EQUIVALENT. PROOF OF CURRENT CERTIFICATION SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL PRIOR TO COMMENCEMENT OF INSTALLATION. NO REINFORCING BARS SHALL BE DAMAGED DURING INSTALLATION OF POST-INSTALLED ANCHORS. SPECIAL INSPECTION SHALL BE PER THE TESTS AND INSPECTIONS SECTION OF THESE GENERAL NOTES. ANCHOR TYPE, DIAMETER, AND EMBEDMENT SHALL BE AS

2.1. ADHESIVE ANCHORS: THE FOLLOWING ADHESIVE-TYPE ANCHORING SYSTEMS HAVE BEEN USED IN THE DESIGN AND SHALL BE USED FOR ANCHORAGE TO CONCRETE OR MASONRY AS APPLICABLE AND IN ACCORDANCE WITH THE CORRESPONDING CURRENT ICC ESR REPORT. REFERENCE THE CORRESPONDING ICC-ESR FOR REQUIRED MINIMUM AGE OF CONCRETE, CONCRETE TEMPERATURE RANGE, MOISTURE CONDITION, LIGHT WEIGHT CONCRETE, AND HOLE DRILLING AND PREPARATION REQUIREMENTS. DRILLED-IN ANCHOR EMBEDMENT LENGTHS SHALL BE AS SHOWN ON DRAWINGS OR NOT LESS THAN SEVEN TIMES THE ANCHOR NOMINAL DIAMETER (7D). ADHESIVE ANCHORS ARE TO BE INSTALLED IN CONCRETE AGED A MINIMUM OF 21 DAYS UNLESS OTHERWISE SPECIFIED IN

DEWALT "PURE 220+" - ICC-ESR 5144 FOR ANCHORAGE TO CONCRETE

2.2. SCREW ANCHORS: THE FOLLOWING SCREW TYPE ANCHOR IS PRE-APPROVED FOR ANCHORAGE TO CONCRETE IN ACCORDANCE WITH ASTM C1892 TESTING PRINCIPLES: SIMPSON "TITEN HD" - ICC-ESR 2713 FOR CARBON STEEL TO CONCRETE, ICC-ESR 1056 FOR MASONRY ONLY, IAPMO 493 FOR STAINLESS STEEL TO CONCRETE

05.12.00 STRUCTURAL STEEL

- 1. **REFERENCE STANDARDS:** CONFORM TO:
- 1.1. OSSC CHAPTER 22 "STEEL"
- 1.2. ANSI/AISC 303 "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES"
- 1.3. AISC "MANUAL OF STEEL CONSTRUCTION"
- 1.4. ANSI/AISC 360 "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS"
- 1.5. AWS D1.1 "STRUCTURAL WELDING CODE STEEL"
- 1.6. RCSC "SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH-STRENGTH BOLTS"

2. SUBMITTALS: SUBMIT THE FOLLOWING DOCUMENTS TO THE SER FOR REVIEW:

- 2.1. SHOP DRAWINGS COMPLYING WITH AISC 360 SECTIONS M1 AND N3 AND AISC 303 SECTION 4.
- 2.2. ERECTION DRAWINGS COMPLYING AISC 360 SECTIONS M1 AND N3 AND AISC 303 SECTION 4.
- 2.3. WELD PROCEDURE SPECIFICATIONS (WPS'S) FOR SHOP AND FIELD WELDING 2.4. MANUFACTURER'S CERTIFICATES OF CONFORMANCE FOR ELECTRODES, FLUXES, AND GASES
- (WELDING CONSUMABLES). 3. COPIES: MAKE COPIES OF THE FOLLOWING DOCUMENTS AVAILABLE UPON REQUEST TO THE SER OR
- OWNER'S INSPECTION AGENCY IN ELECTRONIC OR PRINTED FORM PRIOR TO FABRICATION PER AISC 360 SECTION N3.2 REQUIREMENTS:
- 3.1. FABRICATOR'S WRITTEN QUALITY CONTROL MANUAL THAT INCLUDES, AS A MINIMUM:
- 3.1.1. MATERIAL CONTROL PROCEDURES
- 3.1.2. INSPECTION PROCEDURES
- 3.1.3. NON-CONFORMANCE PROCEDURES
- 3.2. STEEL AND ANCHOR ROD SUPPLIERS' MATERIAL TEST REPORTS (MTRS) INDICATING COMPLIANCE WITH SPECIFICATIONS.
- 3.3. FASTENER MANUFACTURER'S CERTIFICATION DOCUMENTING CONFORMANCE WITH THE
- 3.4. FILLER METAL MANUFACTURER'S PRODUCT DATA FOR SMAW, FCAW, AND GMAW INDICATING:
- 3.4.1. PRODUCT SPECIFICATION COMPLIANCE
- 3.4.2. RECOMMENDED WELDING PARAMETERS 3.4.3. RECOMMENDED STORAGE AND EXPOSURE REQUIREMENTS INCLUDING BAKING
- 3.4.4. LIMITATIONS OF USE 3.5. WELDED HEADED (SHEAR) STUD ANCHORS MANUFACTURER'S CERTIFICATION INDICATING THEY
- MEET SPECIFICATIONS. 3.6. PROCEDURE QUALIFICATION RECORDS (PQRS) FOR WPS'S THAT ARE NOT PREQUALIFIED IN
- ACCORDANCE WITH AWS. 3.7. WELDING PERSONNEL PERFORMANCE QUALIFICATION RECORDS (WPQRS) AND CONTINUITY RECORDS CONFORMING TO AWS STANDARDS
- 4. MATERIALS: STRUCTURAL STEEL MATERIALS SHALL CONFORM TO MATERIALS AND REQUIREMENTS LISTED IN AISC 360 SECTION A3 INCLUDING, BUT NOT LIMITED TO:

\overline{ASTM} A500. GRADE C. $F_v = 50$ KSI SQUARE/RECT HSS

5. FABRICATION:

- 5.1. CONFORM TO AISC 360 SECTION M2 AND AISC 303 SECTION 6.
- 5.2. QUALITY CONTROL (QC) SHALL CONFORM TO:
- 5.2.1. AISC 360 CHAPTER N
- 5.2.2. AISC 303 SECTION 8 5.2.3. FABRICATOR AND ERECTOR SHALL ESTABLISH AND MAINTAIN WRITTEN QC PROCEDURES
- PER AISC 360 SECTION N3. 5.2.4. FABRICATOR SHALL PERFORM SELF-INSPECTIONS PER AISC 360 SECTION N5 TO ENSURE THAT THEIR WORK IS PERFORMED IN ACCORDANCE WITH CODE OF STANDARD PRACTICE, THE AISC SPECIFICATION, CONTRACT DOCUMENTS, AND THE APPLICABLE BUILDING CODE.
- 5.2.5. QC INSPECTIONS MAY BE COORDINATED WITH QUALITY ASSURANCE (QA) INSPECTIONS PER AISC 360 SECTION N5.3 WHERE FABRICATORS QA PROCEDURES PROVIDE THE NECESSARY BASIS FOR MATERIAL CONTROL, INSPECTION, AND CONTROL OF THE WORKMANSHIP EXPECTED BY THE SPECIAL INSPECTOR.

6. WELDING:

- 6.1. WELDING SHALL CONFORM TO AWS D1.1 WITH PREQUALIFIED WELDING PROCESSES EXCEPT AS MODIFIED BY AISC 360 SECTION J2 WELDERS SHALL BE QUALIFIED IN ACCORDANCE WITH AWS D1.1 REQUIREMENTS
- 6.2. USE 70 KSI STRENGTH, LOW-HYDROGEN TYPE ELECTRODES (E7018) OR E71T AS APPROPRIATE FOR THE PROCESS SELECTED.
- 6.3. WELDING OF HIGH-STRENGTH ANCHOR RODS IS PROHIBITED UNLESS APPROVED BY ENGINEER.

6.4. WELDING OF HEADED STUD ANCHORS SHALL BE IN ACCORDANCE WITH AWS D1.1 CHAPTER 7.

7. PROTECTIVE COATING REQUIREMENTS: 7.1. SHOP PAINTING: CONFORM TO AISC 360 SECTION M3 AND AISC 303 SECTION 6.5 UNLESS OTHERWISE SPECIFIED BY THE PROJECT SPECIFICATIONS.

7.2. STEEL NEED NOT BE PRIMED OR PAINTED UNLESS NOTED OTHERWISE ON PLAN OR IN THE PROJECT

SPECIFICATIONS. CONFORM TO AISC 360 SECTION M3 AND AISC 303 SECTION 6.5 UNLESS A MULTI-COAT SYSTEM IS REQUIRED PER THE PROJECT SPECIFICATIONS. 8. ARCHITECTURALLY EXPOSED STRUCTURAL STEEL: STEEL IDENTIFIED BY THE ARCHITECT ON THE

ARCHITECTURAL DRAWINGS AS ARCHITECTURALLY EXPOSED STRUCTURAL STEEL (AESS) SHALL

06.11.00 WOOD FRAMING

CONFORM TO AISC 303 SECTION 10.

- 1. **REFERENCE STANDARDS:** CONFORM TO:
- 1.1. OSSC CHAPTER 23 "WOOD"

- 1.2. ANSI/AWC NDS "NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION WITH NDS
- SUPPLEMENT"
- 1.3. ANSI/AWC SDPWS "SPECIAL DESIGN PROVISIONS FOR WIND AND SEISMIC"
- 1.4. APA PDS "PANEL DESIGN SPECIFICATION" 1.5. APA REPORT TT-045B "MINIMUM NAIL PENETRATION FOR WOOD STRUCTURAL PANEL CONNECTIONS SUBJECT TO LATERAL LOADS"
- 1.6. APA REPORT TT-061C "1-5/16" THICK I-JOIST FLANGES AND DIAPHRAGM NAIL PENETRATION"

- 2.1. SUBMIT SHOP DRAWINGS TO THE ARCHITECT/ENGINEER FOR REVIEW. SHOP DRAWINGS SHALL INCLUDE MEMBER SIZE, SPACING, CAMBER, MATERIAL TYPE, GRADE, SHOP AND FIELD ASSEMBLY DETAILS AND CONNECTIONS, AND TYPES AND LOCATION OF BOLTS AND OTHER FASTENERS. SUPPLY SHOP DRAWINGS FOR THE FOLLOWING: 2.1.1. LSL MEMBERS
- 2.1.2. TAPERED AND PARALLEL WOOD I JOISTS (SOLID WEB-WOOD JOISTS) 2.2. SOFTWOOD LUMBER, SOFTWOOD PLYWOOD, ORIENTED STRAND BOARD, GLUED LAMINATED TIMBER, LAMINATED VENEER LUMBER, LAMINATED STRAND LUMBER, AND WOOD I-JOISTS. EPDS MUST CONFORM TO ISO 14025 AND EN 15804 OR ISO 21930 AND HAVE AT LEAST A CRADLE-TO-GATE
- IDENTIFICATION: ALL SAWN LUMBER AND PRE-MANUFACTURED WOOD PRODUCTS SHALL BE IDENTIFIED BY THE GRADE MARK OR A CERTIFICATE OF INSPECTION ISSUED BY THE CERTIFYING AGENCY.

4.1. SAWN LUMBER: CONFORM TO GRADING RULES OF WWPA, WCLIB OR NLGA AND REQUIREMENTS BELOW. FINGER JOINTED STUDS ACCEPTABLE AT INTERIOR WALLS ONLY.

WALL STUD/TOP AND BOTTOM PLATES 2x4, 3x4, 2x6, 3x6 DOUG FIR LARCH SILL PLATES (AT CONCRETE) PT DOUG FIR LARCH NO. 2 2x4, 3x4, 2x6, 3x6 4x4, 4x6, 4x8 DOUG FIR LARCH NO. 2 FLOORS OR ROOF JOISTS 2x6 THROUGH 2x16 DOUG FIR LARCH NO. 2

4.2. WOOD STRUCTURAL SHEATHING (PLYWOOD): WOOD APA-RATED STRUCTURAL SHEATHING INCLUDES: ALL VENEER PLYWOOD, ORIENTED STRAND BOARD, WAFERBOARD, PARTICLEBOARD, T1-11 SIDING, AND COMPOSITES OF VENEER AND WOOD-BASED MATERIAL WITH T&G JOINT. ARCHITECT MAY DISALLOW OSB. CONFIRM WITH ARCHITECT. CONFORM TO "STRUCTURAL PLYWOOD" BASED ON PRODUCT STANDARD PS 1-19 BY THE U.S. DEPT. OF COMMERCE, AND "PERFORMANCE STANDARD FOR WOOD STRUCTURAL PANELS" BASED ON PRODUCT STANDARD PS 2-18 BY THE U.S. DEPT. OF COMMERCE AND "PANEL DESIGN SPECIFICATION" BASED ON APA D510 BY THE ENGINEERED WOOD ASSOCIATION. UNLESS NOTED OTHERWISE, SHEATHING SHALL COMPLY WITH THE FOLLOWING TABLE:

4.3. WOOD STRUCTURAL SHEATHING (PLYWOOD) - MINIMUM THICKNESS AND APA RATING REQUIREMENTS

4.3.1. ALL EXPOSURES TO BE CATEGORY 1

4.3.2. UNLESS NOTED OTHERWISE ON PLAN, INSTALL ROOF AND FLOOR PANELS WITH LONG DIMENSION ACROSS SUPPORTS AND WITH PANEL CONTINUOUS OVER TWO OR MORE SPANS. END JOINTS SHALL OCCUR OVER SUPPORTS

- 4.4. TIMBER CONNECTORS: SHALL BE "STRONG TIE" BY SIMPSON COMPANY AS SPECIFIED IN THEIR LATEST CATALOG. ALTERNATE CONNECTORS BY OTHER MANUFACTURERS MAY BE SUBSTITUTED PROVIDED THEY HAVE CURRENT ICC APPROVAL FOR EQUIVALENT OR GREATER LOAD CAPACITIES AND ARE REVIEWED AND APPROVED BY THE SER PRIOR TO ORDERING. CONNECTORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTRUCTIONS. WHERE CONNECTOR STRAPS CONNECT TWO MEMBERS, PLACE HALF OF THE NAILS OR BOLTS IN EACH MEMBER. WHERE CONNECTORS ARE IN EXPOSED EXTERIOR APPLICATIONS IN CONTACT WITH PRESERVATIVE TREATED WOOD (PT) OTHER THAN CCA, CONNECTORS SHALL BE EITHER BATCH HOT-DIPPED GALVANIZED (HDG), MECHANICALLY GALVANIZED (ASTM B695, CLASS 55 MINIMUM) STAINLESS STEEL, OR PROVIDED WITH 1.85 OZ/SF OF ZINC GALVANIZING EQUAL TO OR BETTER THAN SIMPSON ZMAX FINISH.
- 4.4.1. WHERE STRAPS ARE USED AS HOLD-DOWNS, NAIL STRAPS TO WOOD FRAMING JUST PRIOR TO DRYWALL APPLICATION. AS LATE AS POSSIBLE IN THE FRAMING PROCESS TO ALLOW THE WOOD TO SHRINK AND THE BUILDING TO SETTLE. PREMATURE NAILING OF THE STRAP MAY LEAD TO STRAP BUCKLING AND POTENTIAL FINISH DAMAGE. 4.5. FASTENERS (NAILS, BOLTS, SCREWS, ETC.) ATTACHING TIMBER CONNECTORS (JOIST HANGERS, POST CAPS AND BASES, ETC.) TO PT WOOD SHALL HAVE SIMILAR CORROSION RESISTANCE
- TO PT WOOD SHALL BE CORROSION RESISTANT; NAILS AND LAG BOLTS SHALL BE EITHER HDG (ASTM A153) OR STAINLESS STEEL. VERIFY THE SUITABILITY OF THE FASTENER PROTECTION/COATING WITH THE WOOD TREATMENT CHEMICAL MANUFACTURER/SUPPLIER.

PROPERTIES (MATCHING PROTECTIVE TREATMENTS) AS THE PROTECTED CONNECTOR. FASTENERS

(NAILS, BOLTS, SCREWS, ETC.) ATTACHING SAWN TIMBER MEMBERS OR SHEATHING (SHEAR WALLS)

4.5.1. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING

4.8. ENGINEERED WOOD PRODUCTS (TRUSJOIST) - REQUIREMENTS:

- 4.6. LAG SCREWS/BOLTS: CONFORM TO ASTM A307 AND NDS CHAPTER 12. 4.6.1. LAG SCREW INSTALLATION SHALL CONFORM TO NDS SECTION 12.1.4 INCLUDING REQUIRED
- DRILLED LEAD AND/OR CLEARANCE HOLES. 4.7. NAILS AND STAPLES: CONFORM TO ASTM F1667 AND OSSC SECTIONS 2303.6 AND 2304.10.

 $E (10^6 F_b (PSI) F_v (PSI) F_c // (PSI)$ 1,700 425 1.835 LSL RIMBOARD OR STAIR 1-1/2" STRINGER RIMBOARD

- 5. NAILING REQUIREMENTS: CONFORM TO OSSC SECTION 2304.10. UNLESS NOTED OTHERWISE ON PLAN, NAIL PER OSSC TABLE 2304.10.2. NAILING FOR ROOFS/FLOORS AND DIAPHRAGMS/SHEAR WALLS SHALL BE PER DRAWINGS. NAILS SHALL BE DRIVEN FLUSH AND SHALL NOT FRACTURE THE SURFACE OF SHEATHING, ALTERNATE NAILS MAY BE USED BUT ARE SUBJECT TO REVIEW AND APPROVAL BY THE SER. SUBSTITUTION OF STAPLES FOR THE NAILING OF RATED SHEATHING IS SUBJECT TO REVIEW BY THE SER
- 6. STANDARD LIGHT-FRAME CONSTRUCTION: UNLESS NOTED OTHERWISE ON PLAN, CONSTRUCTION SHALL
- CONFORM TO OSSC SECTION 2308. 7. MOISTURE CONTENT: THE CONTRACTOR SHALL MAKE PROVISIONS DURING HANDLING AND CONSTRUCTION TO PREVENT THE STRUCTURAL WOOD MEMBERS FROM EXCEEDING THE APPROPRIATE MOISTURE CONTENT LIMITS. THE MOISTURE CONTENT FOR SOLID SAWN WOOD MATERIAL USED FOR THIS PROJECT SHALL NOT EXCEED 19%. THE MOISTURE CONTENT FOR ENGINEERED WOOD PRODUCTS, LAMINATED LUMBER AND SHEATHING SHALL NOT EXCEED THE LIMITS REQUIRED BY THE MANUFACTURER OR 12%, WHICHEVER IS LESS. THE MOISTURE CONTENT LIMITS MAY BE MORE STRINGENT FOR PARTICULAR PRODUCT REQUIREMENTS (E.G., FINISHES, CLADDING, INSULATION SYSTEMS, ETC.). THE CONTRACTOR SHALL REFER TO THE ARCHITECT'S DRAWINGS, PROJECT SPECIFICATIONS, OR INSTALLER/PRODUCT REQUIREMENTS FOR ADDITIONAL REQUIREMENTS.

8. STORAGE AND HANDLING:


PRIOR TO CONSTRUCTION.

- 8.1. ALL STORAGE AND HANDLING IS TO BE A MEANS AND METHODS PROVIDED BY THE CONTRACTOR. THE CONTRACTOR IS TO DETERMINE THE BEST PRACTICES IN ORDER TO AVOID DAMAGE TO THE MEMBERS DURING STORAGE, SUCH AS FUNGAL GROWTH AND EXPOSURE TO WEATHER CONDITIONS. THE FOLLOWING ARE SUGGESTIONS TO AID THE CONTRACTOR. ALL MATERIALS SHOULD BE STORED LEVEL ON SITE AND MUST BE RAISED OFF THE GROUND A MINIMUM OF 6" BY MEANS OF BLOCKING AND SEPARATING SPACERS. IT IS RECOMMENDED THAT THE MATERIALS ARE COVERED WITH AN ADDITIONAL OPAQUE WATERPROOF MATERIAL (I.E. GOOD QUALITY TARPAULIN). WHEN MEMBERS ARE WRAPPED IN POLY OR ANOTHER MATERIAL WHICH MAY INHIBIT AIR FLOW. THE MATERIAL SHOULD HAVE SLOTS OR PERFORATIONS TO ALLOW FOR AIR FLOW AND PREVENT THE ACCUMULATION OF WATER AND/OR CONDENSATION. ENSURE THAT ALL EXPOSED MEMBERS ARE PROTECTED. PROTECTIVE MATERIAL SHOULD BE REMOVED ONLY AFTER THE ROOF OR STRUCTURE PROVIDING COVER IS INSTALLED. MEMBERS SHOULD BE CONSTANTLY PROTECTED FROM WEATHER DURING TRANSPORTATION, STORAGE, AND ERECTION.
- 8.2. FOR INTERIOR GLULAM MEMBERS, THE HEAT IN THE BUILDING SHOULD BE GRADUALLY INCREASED OVER A TWO-TO-THREE-WEEK PERIOD IN ORDER TO PROVIDE A GRADUAL CHANGE IN MOISTURE CONTENT. DO NOT DIRECT ANY FORCED AIR HEATING SYSTEMS ONTO THE GLULAM MEMBERS. IT IS RECOMMENDED TO APPLY THE FINAL FINISH TO THE GLULAM MEMBER BEFORE HEAT IS APPLIED.
- 8.3. MEMBERS THAT ARE TO BE EXPOSED TO VIEW IN THE FINISHED STRUCTURE SHOULD BE HANDLED USING NYLON OR FABRIC SLINGS TO PREVENT SURFACE DAMAGE. THE CONTRACTOR SHOULD ALSO USE MEANS TO PROTECT CORNERS OF MEMBERS TO PREVENT CRUSHING DURING TRANSPORTATION, STORAGE, AND ERECTION. ALL BOLTS SHOULD BE GALVANIZED OR MADE SURE THAT THEY ARE FREE OF OIL TO PREVENT STAINING. GLULAM MEMBERS SHOULD BE TREATED AND STAINED PER THE ARCHITECT OF RECORD'S RECOMMENDATIONS. THE FOLLOWING ARE PROVIDED IN ORDER TO HELP GUIDE THE CONTRACTOR IN THE BEST PRACTICES TO PRESERVE THE QUALITY OF WOOD PRODUCTS. THESE NOTES ARE NOT INTENDED TO BE COMPREHENSIVE AND AN END ALL SOLUTION AND SHOULD BE TAKEN UNDER CONSIDERATION BY THE CONTRACTOR AND SUPPLEMENTED AS NECESSARY.

ARCHITECTS

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com





CONSTRUCTION REVISIONS: # DATE DESCRIPTION

APRIL 2025 DATE: SHEET TITLE: **STRUCTURAL**

GENERAL NOTES

CONTINUED

50.00.00 SPECIAL INSPECTIONS

1. THE FOLLOWING STATEMENT AND SCHEDULES OF INSPECTIONS ARE THOSE SPECIAL INSPECTIONS AND TESTS THAT SHALL BE PERFORMED FOR THIS PROJECT. SPECIAL INSPECTORS SHALL REFERENCE THESE PLANS AND OSSC CHAPTER 17 FOR ALL SPECIAL INSPECTION REQUIREMENTS. THE OWNER SHALL RETAIN AN "APPROVED AGENCY" PER OSSC SECTION 1703 TO PROVIDE SPECIAL INSPECTIONS FOR THIS PROJECT. SPECIAL INSPECTORS SHALL BE QUALIFIED PERSONS PER OSSC SECTION 1704.2.4. SPECIAL INSPECTION REPORTS SHALL BE PROVIDED ON A WEEKLY BASIS. SUBMIT COPIES OF ALL INSPECTION REPORTS TO THE ARCHITECT/ENGINEER AND THE AUTHORITY HAVING JURISDICTION FOR REVIEW. IN ADDITION TO SPECIAL INSPECTION REPORTS AND TESTS, SUBMIT REPORTS AND CERTIFICATES NOTED IN OSSC SECTION 1704.5 TO THE AUTHORITY HAVING JURISDICTION. FINAL SPECIAL INSPECTION REPORTS WILL BE REQUIRED BY EACH SPECIAL INSPECTION FIRM PER OSSC SECTION 1704.2.4.

2. STATEMENT OF SPECIAL INSPECTIONS:

- 2.1. THIS STATEMENT OF SPECIAL INSPECTIONS HAS BEEN WRITTEN WITH THE UNDERSTANDING THAT THE BUILDING OFFICIAL WILL:
- 2.1.1. REVIEW AND APPROVE THE QUALIFICATIONS OF THE SPECIAL INSPECTOR. 2.1.2. MONITOR THE SPECIAL INSPECTION ACTIVITY ON THE PROJECT SITE TO ENSURE THAT SPECIAL INSPECTORS ARE QUALIFIED AND PERFORMING THEIR DUTY AS STATED WITHIN THIS
- 2.1.3. REVIEW ALL SPECIAL INSPECTION REPORTS SUBMITTED TO THEM BY THE SPECIAL
- 2.1.4. PERFORM INSPECTIONS AS REQUIRED BY OSSC SECTION 110.3.
- 2.2. THE FOLLOWING SPECIAL INSPECTIONS ARE APPLICABLE TO THIS PROJECT:

SPECIAL INSPECTIONS FOR STANDARD BUILDINGS (PER OSSC SECTION 1705.1) REQUIRED SPECIAL INSPECTIONS FOR SEISMIC RESISTANCE (PER OSSC SECTION 1705.13) REQUIRED

3. SPECIAL INSPECTION OF SHOP FABRICATED, GRAVITY LOAD-BEARING MEMBERS AND ASSEMBLIES:

- 3.1. SPECIAL INSPECTION OF SHOP FABRICATED, GRAVITY LOAD-BEARING MEMBERS AND ASSEMBLIES SHALL BE VERIFIED BY THE SPECIAL INSPECTOR AS STATED IN SECTION 1704.2.5.
- 3.2. INCLUDE THE FOLLOWING:
- 3.2.1. PRIOR TO THE START OF FABRICATION: SPECIAL INSPECTOR(S), REPRESENTING THE OWNER, SHALL VISIT THE FABRICATOR'S SHOP(S) WHERE THE WORK IS TO BE PERFORMED, AND VERIFY THAT THE FABRICATOR MAINTAINS DETAILED FABRICATION AND QUALITY CONTROL PROCEDURES THAT PROVIDE A BASIS FOR INSPECTION, CONTROL OF WORKMANSHIP, MATERIAL CONTROL, AND FABRICATOR'S ABILITY TO CONFORM TO APPROVED CONSTRUCTION DOCUMENTS AND REFERENCED STANDARDS.
- 3.2.2. FABRICATOR SHALL HAVE AVAILABLE FOR INSPECTOR'S REVIEW DETAILED PROCEDURES FOR MATERIAL CONTROL THAT DEMONSTRATE THE FABRICATOR'S ABILITY TO MAINTAIN SUITABLE RECORDS AND PROCEDURES SUCH THAT, AT ANY TIME DURING THE FABRICATION PROCESS. THE MATERIAL SPECIFICATION, GRADE, AND APPLICABLE TEST REPORTS FOR PRIMARY LOAD-CARRYING MEMBERS ARE CAPABLE OF BEING DETERMINED.

4. STRUCTURAL STEEL: PER OSSC SECTION 1705.2.1

4.1. A QUALIFIED SPECIAL INSPECTOR OF AN "APPROVED AGENCY" PROVIDING QUALITY ASSURANCE (QA) SPECIAL INSPECTIONS FOR THE PROJECT SHALL REVIEW AND CONFIRM THE FABRICATOR AND ERECTOR'S QUALITY CONTROL (QC) PROCEDURES FOR COMPLETENESS AND ADEQUACY RELATIVE TO AISC 360 CHAPTER N, AISC 303, AWS D1.1, AND 2022 OSSC CODE REQUIREMENTS FOR THE FABRICATOR'S SCOPE OF WORK.

4.2. REQUIREMENTS:

- 4.2.1. QA AGENCY PROVIDING SPECIAL INSPECTIONS SHALL PROVIDE PERSONNEL MEETING THE MINIMUM QUALIFICATION REQUIREMENTS FOR INSPECTION AND NONDESTRUCTIVE TESTING (NDT) PER AISC 360 SECTION N4.
 - 4.2.1.1. QC AGENCY SHALL SUBMIT QUALIFICATION DOCUMENTS PER AISC 341 SECTION J2 ON PROJECTS SUBJECT TO SPECIAL INSPECTIONS ON SEISMIC FORCE RESISTING SYSTEMS WITH R > 3.
 - 4.2.1.2. NDT PERSONNEL SHALL BE QUALIFIED PER AISC 341 SECTION J4.
 - 4.2.1.3. PROVIDE QC AND QA INSPECTIONS PER AISC 341 SECTION J5 THROUGH J10 AS
- 4.2.2. VERIFY FABRICATOR AND ERECTOR QC PROGRAM PER AISC 360 SECTION N2.
- 4.2.3. INSPECTION OF WELDS AND BOLTS BY BOTH QC AND QA PERSONNEL SHALL BE PER THE SCHEDULE OF SPECIAL INSPECTIONS IN THESE DRAWINGS. ALL PROVISIONS OF AWS D1.1 FOR STATICALLY LOADED STRUCTURES SHALL APPLY.
- 4.2.4. NONDESTRUCTIVE TESTING (NDT) OF WELDS:
 - 4.2.4.1. NDT OF WELDED JOINTS PER AISC 360 SECTION N5
 - 4.2.4.2. RISK CATEGORY FOR DETERMINATION OF EXTENT OF NDT PER AISC 360 N5.5B IS NOTED IN THE DESIGN CRITERIA AND LOADS SECTION OF THESE GENERAL REQUIREMENTS. 4.2.4.3. NDT PERFORMED SHALL BE DOCUMENTED AND REPORTS SHALL IDENTIFY THE
 - TESTED WELD BY PIECE MARK AND LOCATION OF THE PIECE.
 - 4.2.4.4. FOR FIELD WORK, THE NDT REPORT SHALL IDENTIFY THE TESTED WELD BY LOCATION IN THE STRUCTURE, PIECE MARK AND LOCATION OF THE PIECE.
- 4.2.5. ADDITIONAL INSPECTION TASKS PER AISC 360 SECTION N5.8. 4.2.6. INSPECTION FOR COMPOSITE CONSTRUCTION SHALL BE DONE PER AISC 360 SECTION N6. 4.3. POST-INSTALLED ANCHORS TO CONCRETE AND MASONRY: SHALL COMPLY WITH OSSC SECTION 1703. INSPECTIONS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS SET FORTH IN THE
- APPROVED ICC EVALUATION SERVICE REPORT (ICC-ESR) AND AS INDICATED BY THE DESIGN REQUIREMENTS SPECIFIED ON THE DRAWINGS. REFER TO THE POST-INSTALLED ANCHORS SECTION OF THE GENERAL NOTES FOR ANCHORS THAT ARE THE BASIS OF THE DESIGN. SPECIAL INSPECTOR SHALL VERIFY ANCHORS ARE AS SPECIFIED IN THE POST-INSTALLED ANCHORS SECTION OF THE GENERAL NOTES OR AS OTHERWISE SPECIFIED ON THE DRAWINGS. SUBSTITUTIONS REQUIRE APPROVAL BY THE SER AND REQUIRE SUBSTANTIATING CALCULATIONS AND A CURRENT 2022 OSSC RECOGNIZED ICC-ESR. SPECIAL INSPECTOR SHALL DOCUMENT IN THEIR SPECIAL INSPECTION REPORT COMPLIANCE WITH EACH OF THE ELEMENTS REQUIRED WITHIN THE APPLICABLE ICC-ESR.
- 4.4. PREFABRICATED CONSTRUCTION: ALL PREFABRICATED CONSTRUCTION SHALL CONFORM TO OSSC SECTION 1703.

5. SCHEDULES OF SPECIAL INSPECTIONS: 5.1. TABLE 1705.6 - REQUIRED SPECIAL INSPECTIONS AND TESTS OF SOILS

IADLLI	705.0 - REQUIRED SPECIAL INSPECTIONS AND TESTS OF SOIL		
NO.	SPECIAL INSPECTION	CONTINUOUS	PERIODIC
1	VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE	-	X
	ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY		
2	VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH	-	X
	AND HAVE REACHED PROPER MATERIAL		
3	PERFORM CLASSIFICATION AND TESTING OF COMPACTED	-	X
	FILL MATERIALS		
4	DURING FILL PLACEMENT, VERIFY USE OF PROPER	X	-
	MATERIALS AND PROCEDURES IN ACCORDANCE WITH THE		
	PROVISIONS OF THE APPROVED GEOTECHNICAL REPORT.		
	VERIFY DENSITIES AND LIFT THICKNESSES DURING		
	PLACEMENT AND COMPACTION OF COMPACTED FILL		
5	PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT	-	Х
	SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED		
	PROPERLY		

NO.	SPECIAL INSPECTION	CONTINUOUS	PERIODIC	REFERENCE STANDARD
1	INSPECT REINFORCEMENT,	-	Χ	ACI 318 CHAPTER 20
	INCLUDING PRE-STRESSING			ACI 318 SECTIONS 25.2,
	TENDONS, AND VERIFY			25.3, & 26.6.1-26.6.3
	PLACEMENT			
2	REINFORCING BAR WELDING:	-	-	-
2a	VERIFY WELDABILITY OF	-	Χ	AWS D1.4
	REINFORCING BARS OTHER THAN			ACI 318 SECTION 26.6.4
	ASTM A706			
2b	INSPECT SINGLE PASS FILLET	-	Χ	-
	WELD MAXIMUM 5/16"			
2c	INSPECT ALL OTHER WELDS	X	-	-
3	INSPECT ANCHORS CAST IN	-	Χ	ACI 318 SECTION 17.8.2
	CONCRETE			
4	INSPECT ANCHORS POST-	-	-	-
	INSTALLED IN HARDENED			
	CONCRETE MEMBERS:			

4a	ADHESIVE ANCHORS INSTALLED IN	X	-	ACI 318 SECTION 17.8.2.4
	HORIZONTALLY OR UPWARDLY			
	INCLINED ORIENTATIONS TO			
	RESIST SUSTAINED TENSION			
41	LOADS			401040 0F0TION 47.0 0
4b	MECHANICAL ANCHORS AND	-	X	ACI 318 SECTION 17.8.2
	ADHESIVE ANCHORS NOT DEFINED IN 4a			
5	VERIFY USE OF REQUIRED DESIGN	-	X	ACI 318 CHAPTER 19
	MIX			ACI SECTIONS 26.4.3 &
				26.4.4
				OSSC SECTION 1904.1,
				1904.2
6	PRIOR TO CONCRETE PLACEMENT,	Х	-	ASTM C172 & C31
	FABRICATE SPECIMENS FOR			ACI 318 SECTIONS 26.5 8
	STRENGTH TESTS, PERFORM			26.12
	SLUMP AND AIR CONTENT TESTS,			
	AND DETERMINE THE			
	TEMPERATURE OF THE CONCRETE			
7	INSPECT CONCRETE AND	X	-	ACI 318 SECTION 26.5
	SHOTCRETE PLACEMENT FOR			
	PROPER APPLICATION			
	TECHNIQUES			
8	VERIFY MAINTENANCE OF	-	X	ACI 318 SECTIONS
	SPECIFIED CURING TEMPERATURE			26.5.3-26.5.5
11	AND TECHNIQUES			ACL 240 SECTION
14	INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF	-	X	ACI 318 SECTION
	THE CONCRETE MEMBER BEING			26.11.1.2(B)
	FORMED			

5.3. REQUIRED SPECIAL INSPECTIONS OF WOOD CONSTRUCTION

NO.	SPECIAL INSPECTION	CONTINUOUS	PERIODIC	REFERENCE STANDAR
1	HIGH LOAD DIAPHRAGMS:	-	-	OSSC SECTION 1705.5.
1a	PANEL SHEATHING FOR GRADE AND THICKNESS	Х	-	-
1b	NOMINAL SIZE OF FRAMING MEMBERS AT ADJOINING PANEL EDGES	Х	-	-
1c	NAIL AND STAPLE DIAMETERS AND LENGTHS	Х	-	-
1d	NUMBER OF FASTENER LINES, SPACING BETWEEN FASTENERS IN EACH LINE AND AT EDGE MARGINS	Х	-	-
2	METAL PLATE CONNECTED WOOD TRUSSES SPANNING 60 FEET OR GREATER: TEMPORARY INSTALLATION RESTRAINT/BRACING AND PERMANENT INDIVIDUAL TRUSS MEMBER RESTRAINT/BRACING INSTALLATION	X	-	OSSC SECTION 1705.5.
3	SHEAR WALLS (WHERE FASTENER SPACING OF THE SHEATHING IS 4 INCHES OR LESS ON CENTER):	-	-	
3a	ANCHOR BOLTS INCLUDING PROPER BOTTOM PLATE SIZES (2X AND 3X) AND PLATE WASHERS	-	Х	-
3b	HOLD-DOWNS (HD) AND CONTINUOUS ROD TIE-DOWN SYSTEMS (TDS) INCLUDING SQUASH BLOCKS AND ANCHORS TO CONCRETE	-	Х	-
3c	A35 AND LPT SHEAR CONNECTORS	-	Χ	-
3d	STRAP CONNECTORS	-	Χ	-
3e	BOUNDARY EDGE NAILING	-	Χ	-
3f	PLATE NAILING AND PANEL EDGE NAILING FOR SIZE AND SPACING	-	Х	-
3g	BLOCKING	-	Χ	-
4	BLOCKED AND UNBLOCKED DIAPHRAGMS (WHERE FASTENER SPACING OF THE SHEATHING IS 4 INCHES OR LESS ON CENTER):	-	-	
4a	BLOCKING AND STRAP CONNECTIONS	-	Х	-
4b	BOUNDARY EDGE AND PANEL SHEAR NAILING SIZE AND SPACING	-	Х	-
5	MOISTURE CONTENT OF WOOD STUDS, PLATES, BEAMS, DECKING, AND JOISTS	-	-	AS DIRECTED BY THI CONTRACTOR TO MEI MOISTURE CONTENT REQUIREMENTS
6	ROOF TRUSS 'HURRICANE CLIPS'	-	Х	_

6	ROOF TRUSS HURRICANE CLIPS	-	X	-
MINIMI	M REQUIREMENTS FOR INSPECTIONS	OF STRUCTUR	PAL STEEL CO	NSTRUCTION
NO.	SPECIAL INSPECTION	QC	QA	REFERENCE STANDARI
	INSPECTION TA			AIGO COO TABLE NE 4 4
1	WELDER QUALIFICATION RECORDS AND CONTINUITY RECORDS	Р	0	AISC 360 TABLE N5.4-1
2	WELDING PROCEDURE SPECIFICATIONS (WPS'S) AVAILABLE	Р	Р	AISC 360 TABLE N5.4-1
3	MANUFACTURING CERTIFICATIONS FOR WELDING CONSUMABLES AVAILABLE	Р	Р	AISC 360 TABLE N5.4-1
4	MATERIAL IDENTIFICATION (TYPE/GRADE)	0	0	AISC 360 TABLE N5.4-1
5	WELDER IDENTIFICATION SYSTEM	0	0	AISC 360 TABLE N5.4-1
6	FIT-UP OF GROOVE WELDS (INCLUDING JOINT GEOMETRY)	0	0	AISC 360 TABLE N5.4-1
	JOINT PREPARATION			
	DIMENSIONS (ALIGNMENT, ROOT OPENING, ROOT FACE, BEVEL)			
	CLEANLINESS (CONDITION OF STEEL SURFACES)			
	TACKING (TACK WELDING QUALITY AND LOCATION)			
	BACKING TYPE AND FIT (IF APPLICABLE)			
7	FIT-UP OF CJP GROOVE WELDS OF HSS T-, Y-, AND K-JOINTS WITHOUT BACKING (INCLUDING JOINT GEOMETRY)		0	AISC 360 TABLE N5.4-1
	JOINT PREPARATION			
	DIMENSIONS (ALIGNMENT, ROOT OPENING, ROOT FACE, BEVEL)			
	CLEANLINESS (CONDITION OF STEEL SURFACES)			
	TACKING (TACK WELDING QUALITY AND LOCATION)			
8	CONFIGURATION AND FINISH OF ACCESS HOLES	0	0	AISC 360 TABLE N5.4-1
9	FIT-UP OF FILLET WELDS	0	0	AISC 360 TABLE N5.4-1
	DIMENSIONS (ALIGNMENT, GAPS AT ROOT)			
	CLEANLINESS (CONDITION OF STEEL SURFACES)			
	TACKING (TACK WELDING QUALITY AND LOCATION)			
10	CLIECK WELDING FOLUDMENT			AICC 2CO TADLE NE 4 4

INSPECTION TASKS DURING WELDING

AISC 360 TABLE N5.4-1

AISC 360 TABLE N5.4-2

10 CHECK WELDING EQUIPMENT

1 USE OF QUALIFIED WELDERS

2	CONTROL AND HANDLING OF WELDING CONSUMABLES	0	0	AISC 360 TABLE N5.4-2
	PACKAGING			
	EXPOSURE CONTROL			
3	NO WELDING OVER CRACKED	0	0	AISC 360 TABLE N5.4-2
	TACK WELDS			AIOO OOO TARI E NE 4 O
4	ENVIRONMENTAL CONDITIONS	О	0	AISC 360 TABLE N5.4-2
	WIND SPEED WITHIN LIMITS			
	PRECIPITATION AND TEMPERATURE			
5	WPS FOLLOWED	0	0	AISC 360 TABLE N5.4-2
	SETTINGS ON WELDING EQUIPMENT			
	TRAVEL SPEED			
	SELECTED WELDING MATERIALS			
	SHIELDING GAS TYPE/ FLOWRATE			
	PREHEAT APPLIED			
	INTERPASS TEMPERATURE MAINTAINED (MIN/MAX)			
	PROPER POSITION (F, V, H,			
	OH)			
6	WELDING TECHNIQUES	0	0	AISC 360 TABLE N5.4-2
	INTERPASS AND FINAL CLEANING			
	EACH PASS WITHIN PROFILE			
	EACH PASS MEETS QUALITY REQUIREMENTS			
		TASKS AFTER V	VELDING	
1	WELDS CLEANED	0	0	AISC 360 TABLE N5.4-3
2	SIZE, LENGTH, AND LOCATIONS OF WELDS	Р	Р	AISC 360 TABLE N5.4-3
3	WELDS MEET VISUAL ACCEPTANCE CRITERIA	Р	Р	AISC 360 TABLE N5.4-3
	CRACK PROHIBITION			
	WELD/BASE-METAL FUSION			
	CRATER CROSS SECTION			
	WELD PROFILES			
	WELD SIZE			
	UNDERCUT			
	POROSITY			
4	ARC STRIKES	Р	P	AISC 360 TABLE N5.4-3
5	K-AREA	P	Р	AISC 360 TABLE N5.4-3
6	WELD ACCESS HOLES IN ROLLED HEAVY SHAPES AND BUILT-UP HEAVY SHAPES	Р	P	AISC 360 TABLE N5.4-3
7	BACKING REMOVED AND WELD	Р	Р	AISC 360 TABLE N5.4-3
	TABS REMOVED (IF REQUIRED)			AIOO OCC TABLE ME
8	REPAIR ACTIVITIES	P P	P	AISC 360 TABLE N5.4-3
9	DOCUMENT ACCEPTANCE OR REJECTION OF WELDED JOINT OR MEMBER	P	P	AISC 360 TABLE N5.4-3
10	NO PROHIBITED WELDS HAVE BEEN ADDED WITHOUT THE APPROVAL OF THE EOR	Р	Р	AISC 360 TABLE N5.4-3
L	,	I	1	

- 5.4.1. (O) OBSERVE THESE ITEMS ON A RANDOM BASIS. OPERATIONS NEED NOT BE DELAYED PENDING THESE INSPECTIONS 5.4.2. (P) - PERFORM THESE TASKS FOR EACH WELDED JOINT OR MEMBER, EACH BOLTED CONNECTION, OR EACH STEEL ELEMENT

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hgel.com **EXPIRES**: 06-25-25

CONSTRUCTION **REVISIONS:** # DATE DESCRIPTION

DATE: APRIL 2025 SHEET TITLE: STRUCTURAL **SPECIAL INSPECTIONS**

333 S. 4TH STREET COOS BAY, OR 97420

P: 541.269.1166

general@hge1.com

www.hge1.com

EXPIRES: 06-25-25

APRIL 2025 SHEET TITLE: STRUCTURAL FIRST **FLOOR** FOUNDATION PLAN

Copyright © 2025 HGE ARCHITECTS, Inc.

LEVEL 02 DARKENED LINES DESIGNATE AREA OF WORK.

(E) ROOF



- 1. STRUCTURAL GENERAL NOTES, DESIGN CRITERIA, ABBREVIATIONS AND LEGEND PER
- 2. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS. ALL EXISTING DIMENSIONS SHALL BE FIELD VERIFIED.
- 3. TYPICAL TOP OF INTERIOR (T/INTERIOR) FOOTING ELEVATION = 0'-0", UNO. TYPICAL TOP OF EXTERIOR (T/EXTERIOR) FOOTING ELEVATIONS = 0'-10", UNO.
- 4. ALL FOOTINGS AND SLABS TO BEAR ON COMPETENT NATIVE SOIL AND/OR STRUCTURAL FILL, IMPROVED SOIL. SUBGRADE PREPARATION, STRUCTURAL FILL, DRAINAGE SYSTEM, AND OTHER REQUIREMENTS PER GEOTECH REPORT AS NOTED IN THE STRUCTURAL GENERAL NOTES.
- 5. MICRO-PILES PER GENERAL NOTES. O = INDICATES MICRO-PILE AT EXISTING CONCRETE = INDICATES MICRO-PILE AT NEW GRADE BEAM


MARK LENGTH WIDTH DEPTH REINFORCING

- 6. TYPICAL DETAILS PER:
 - 1/S4.1 TYPICAL LAP SPLICE SCHEDULE AND DEVELOPMENT LENGTH SCHEDULE STANDARD HOOKS AND BAR BENDS

COMMENTS

	SPREAD FOOTIN	G SCHEDUL	E
4/S4.1	SLAB ON GRADE INFILL		

(E) F6.0	0 6'-0" 6'-0"		1'-0"	(E) (12) #6B EW	
		MICR	OPILE F	FORCES	
PILE TY	DE _		MICR	OPILE FORCES	
PILE I I		P_D	P_L	P _S BSE-2E	P _S BSE-1E
(P1)	,	35k	25k		
(P2)		8k	10k		
(P3)		15k	1k	120k	55k
(P4)	,	44k	20k		

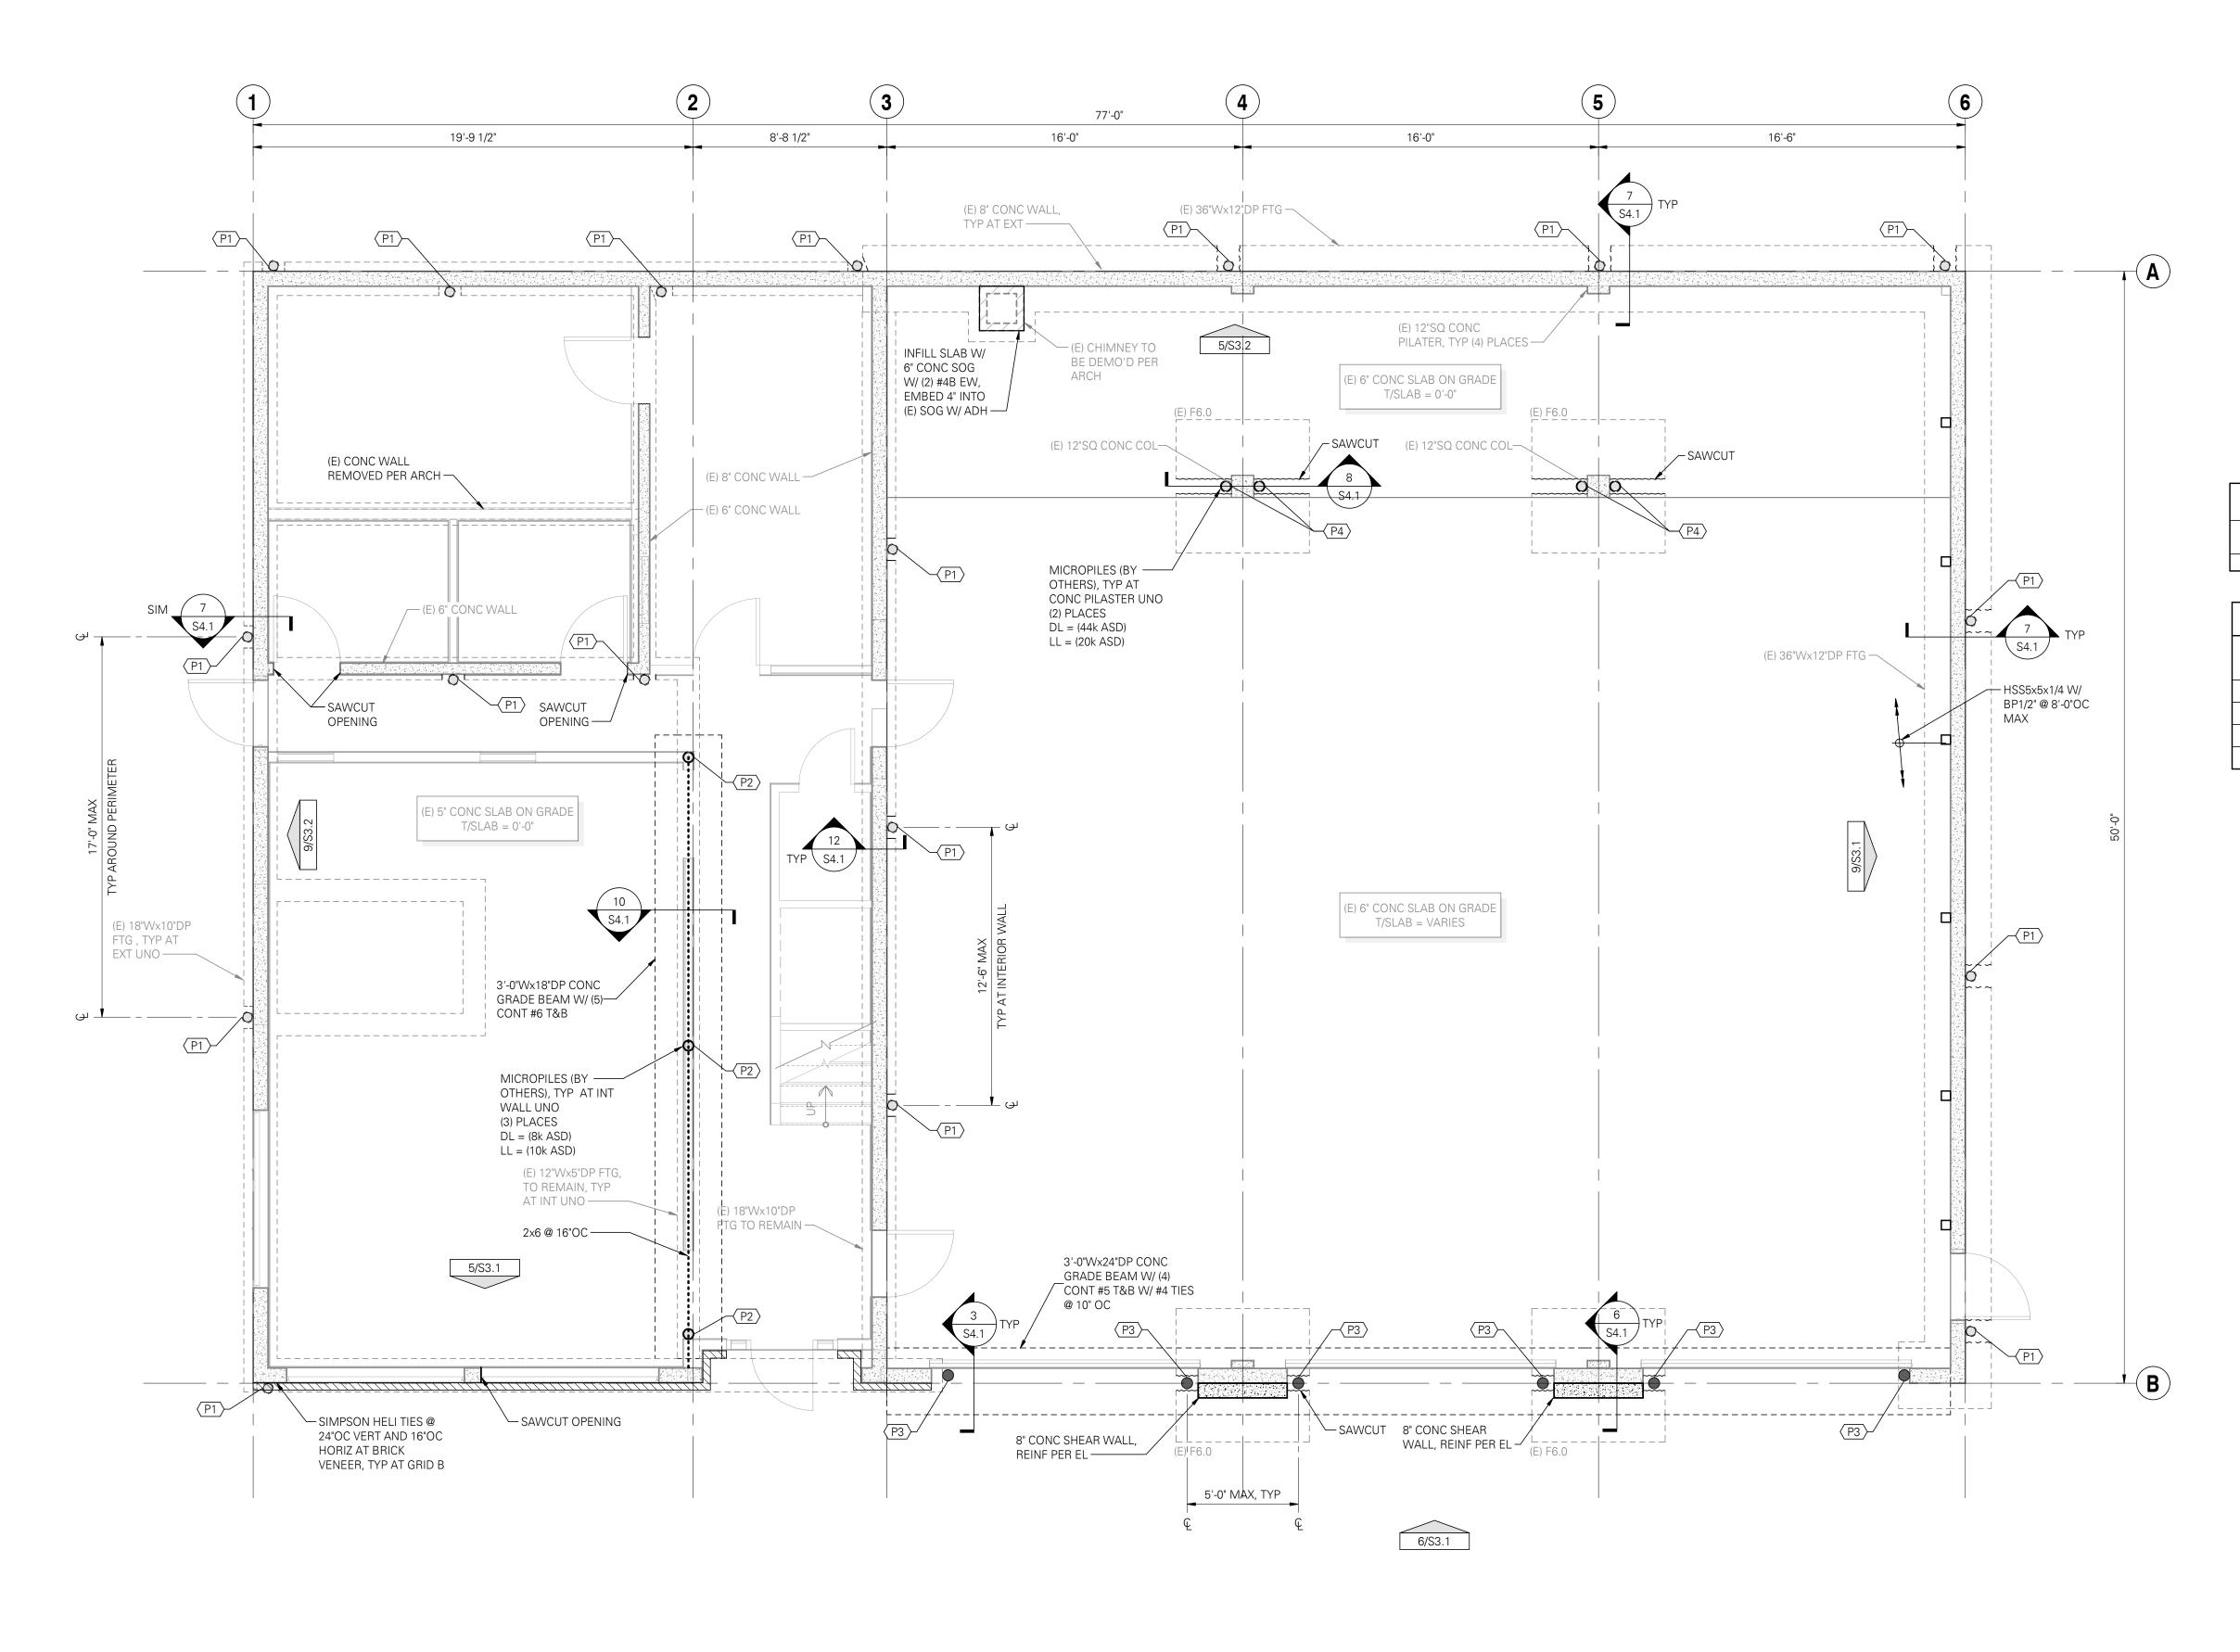

333 S. 4TH STREET COOS BAY, OR 97420

P: 541.269.1166

general@hge1.com

www.hge1.com

EASTSIDE CITY OF COOS BAY 365 D ST, COOS BAY, OR 97420

CONSTRUCTION REVISIONS: # DATE DESCRIPTION


APRIL 2025 SHEET TITLE:
STRUCTURAL
SECOND FLOOR
FRAMING PLAN

ROOF (E) ROOF

Copyright © 2025 HGE ARCHITECTS, Inc.

SECOND FLOOR FRAMING PLAN NOTE:

DARKENED LINES DESIGNATE
AREA OF WORK.

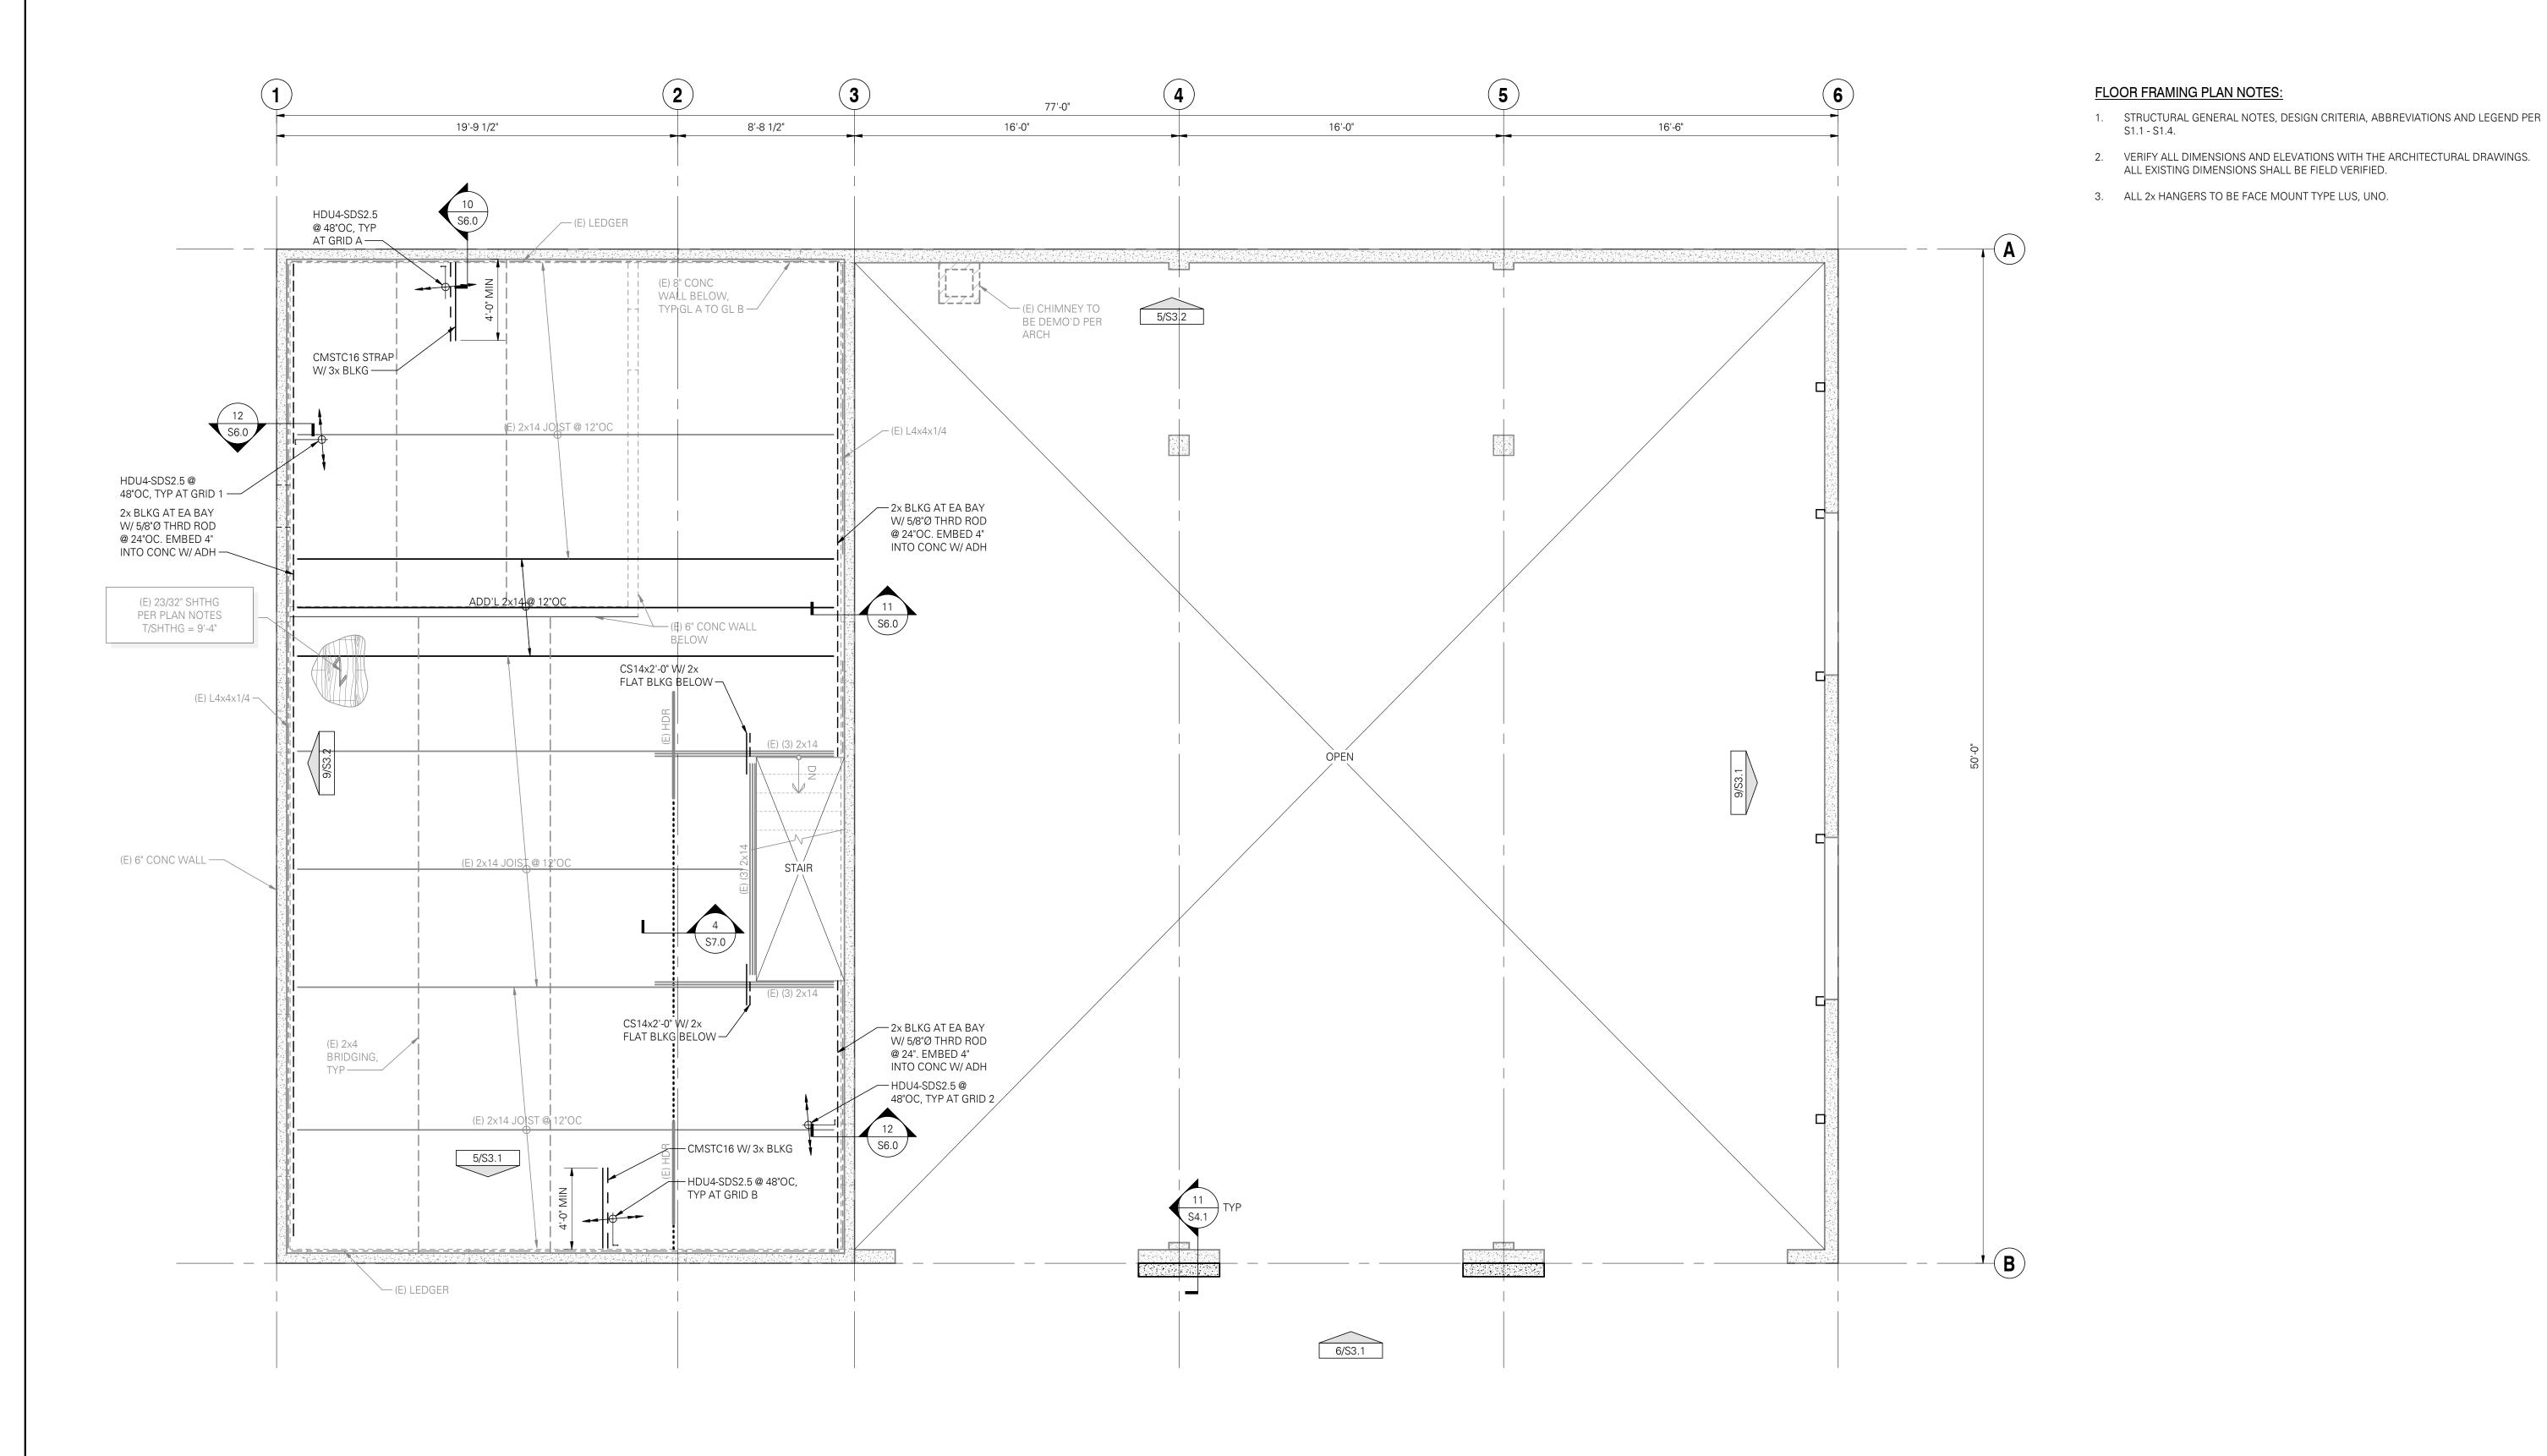

ROOF FRAMING PLAN NOTES:

1. STRUCTURAL GENERAL NOTES, DESIGN CRITERIA, ABBREVIATIONS AND LEGEND PER

333 S. 4TH STREET COOS BAY, OR 97420

P: 541.269.1166 general@hge1.com www.hge1.com

EXPIRES: 06-25-25

EASTSIDE CITY OF COOS BAY 365 D ST, COOS BAY, OR 97420

CONSTRUCTION **REVISIONS:** # DATE DESCRIPTION

APRIL 2025 SHEET TITLE:

STRUCTURAL LOW ROOF FRAMING


LEVEL 02

DARKENED LINES DESIGNATE AREA OF WORK.

LOW ROOF FRAMING PLAN

ROOF FRAMING PLAN NOTES:

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com



TSIDE COOS BAY

CONSTRUCTION **REVISIONS:**

DATE DESCRIPTION

SHEET TITLE: STRUCTURAL

ROOF (E) ROOF

DARKENED LINES DESIGNATE AREA OF WORK.

UPPER ROOF FRAMING PLAN


APRIL 2025 **UPPER ROOF** FRAMING PLAN


Copyright © 2025 HGE ARCHITECTS, Inc.

FOR PERMIT
The Contractor shall not use these dr



ARCHITECTS

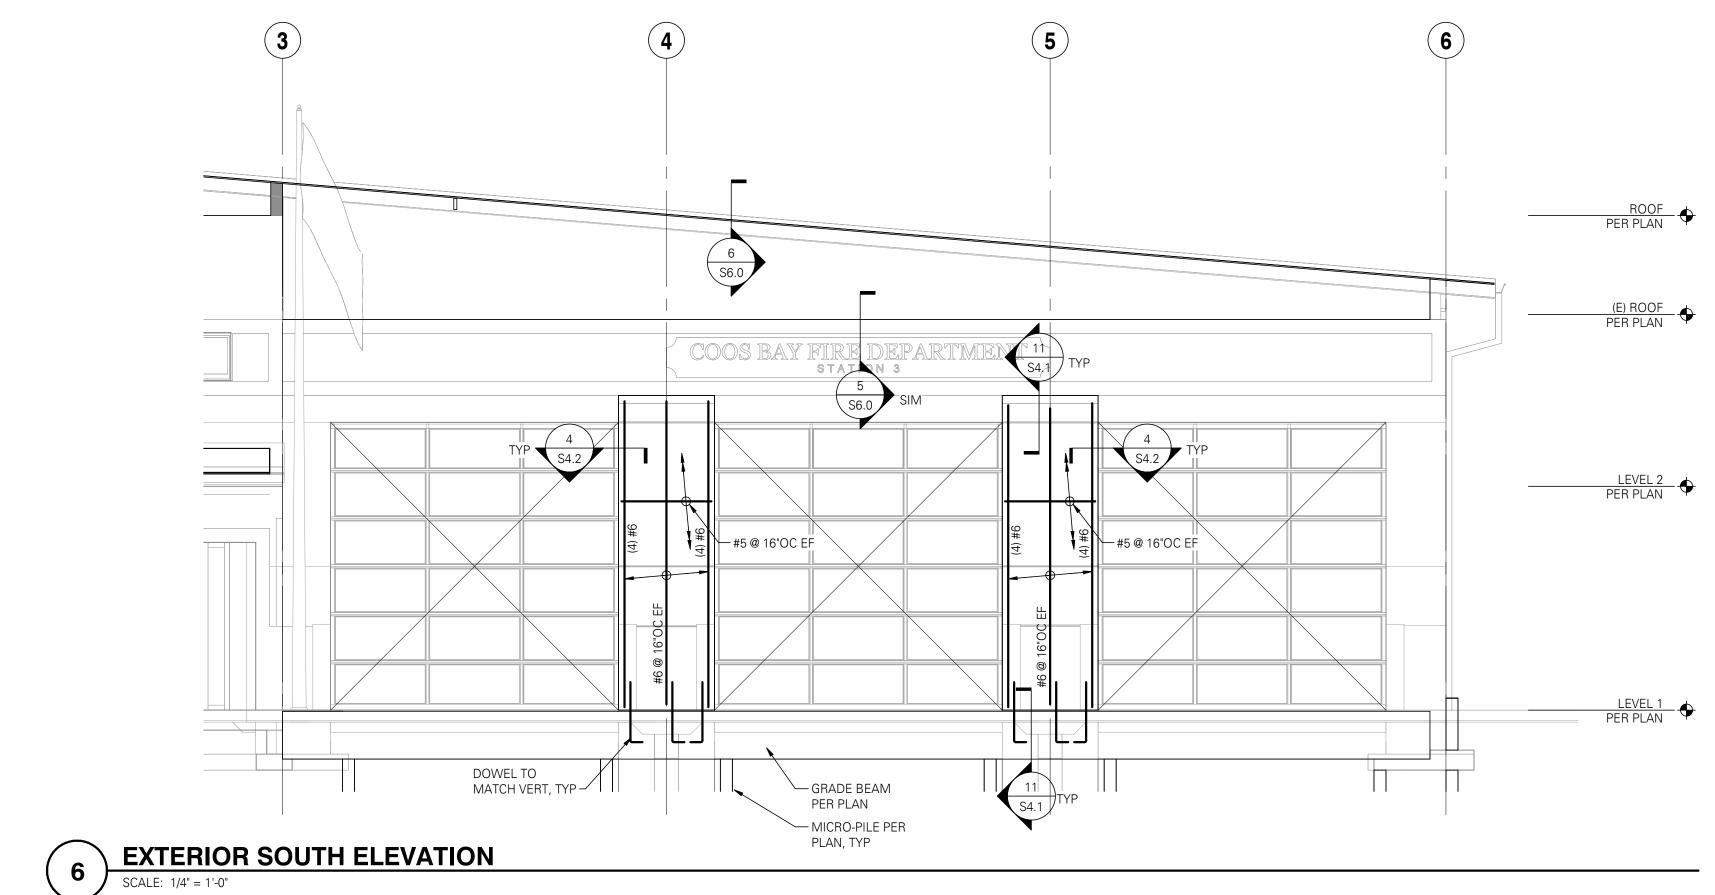

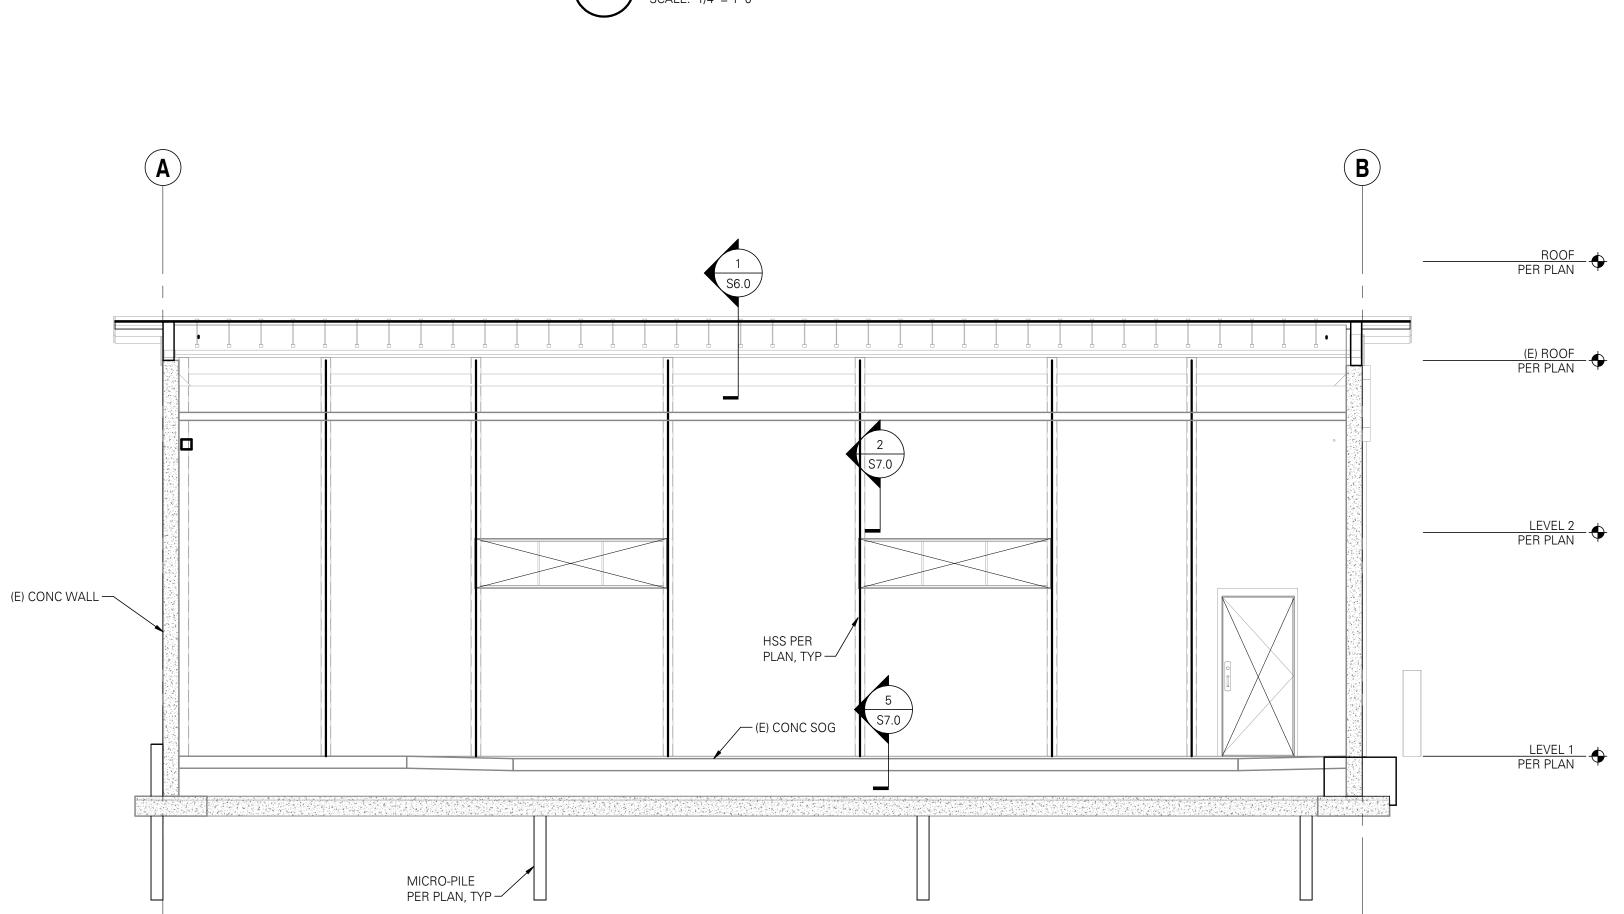

9 EAST ELEVATION

SCALE: 1/4" = 1'-0"

3

(E) CONC WALL —

SCALE: 1/4" = 1'-0"

PONY WALL
PER PLAN, TYP

FRP BY OTHERS (10K TENSION)

— FRP ANCHOR BY OTHERS

– GRADE BEAM PER PLAN

/— (E) CONC SOG

ROOF PER PLAN

(E) ROOF
PER PLAN

LEVEL 2
PER PLAN

LEVEL 1
PER PLAN

ARCHITECTS


333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166

general@hge1.com

www.hge1.com

S3.2 Copyright © 2025 HGE ARCHITECTS, Inc.

FOR PERMIT
The Contractor shall not use these dr
approval for use in construction by th

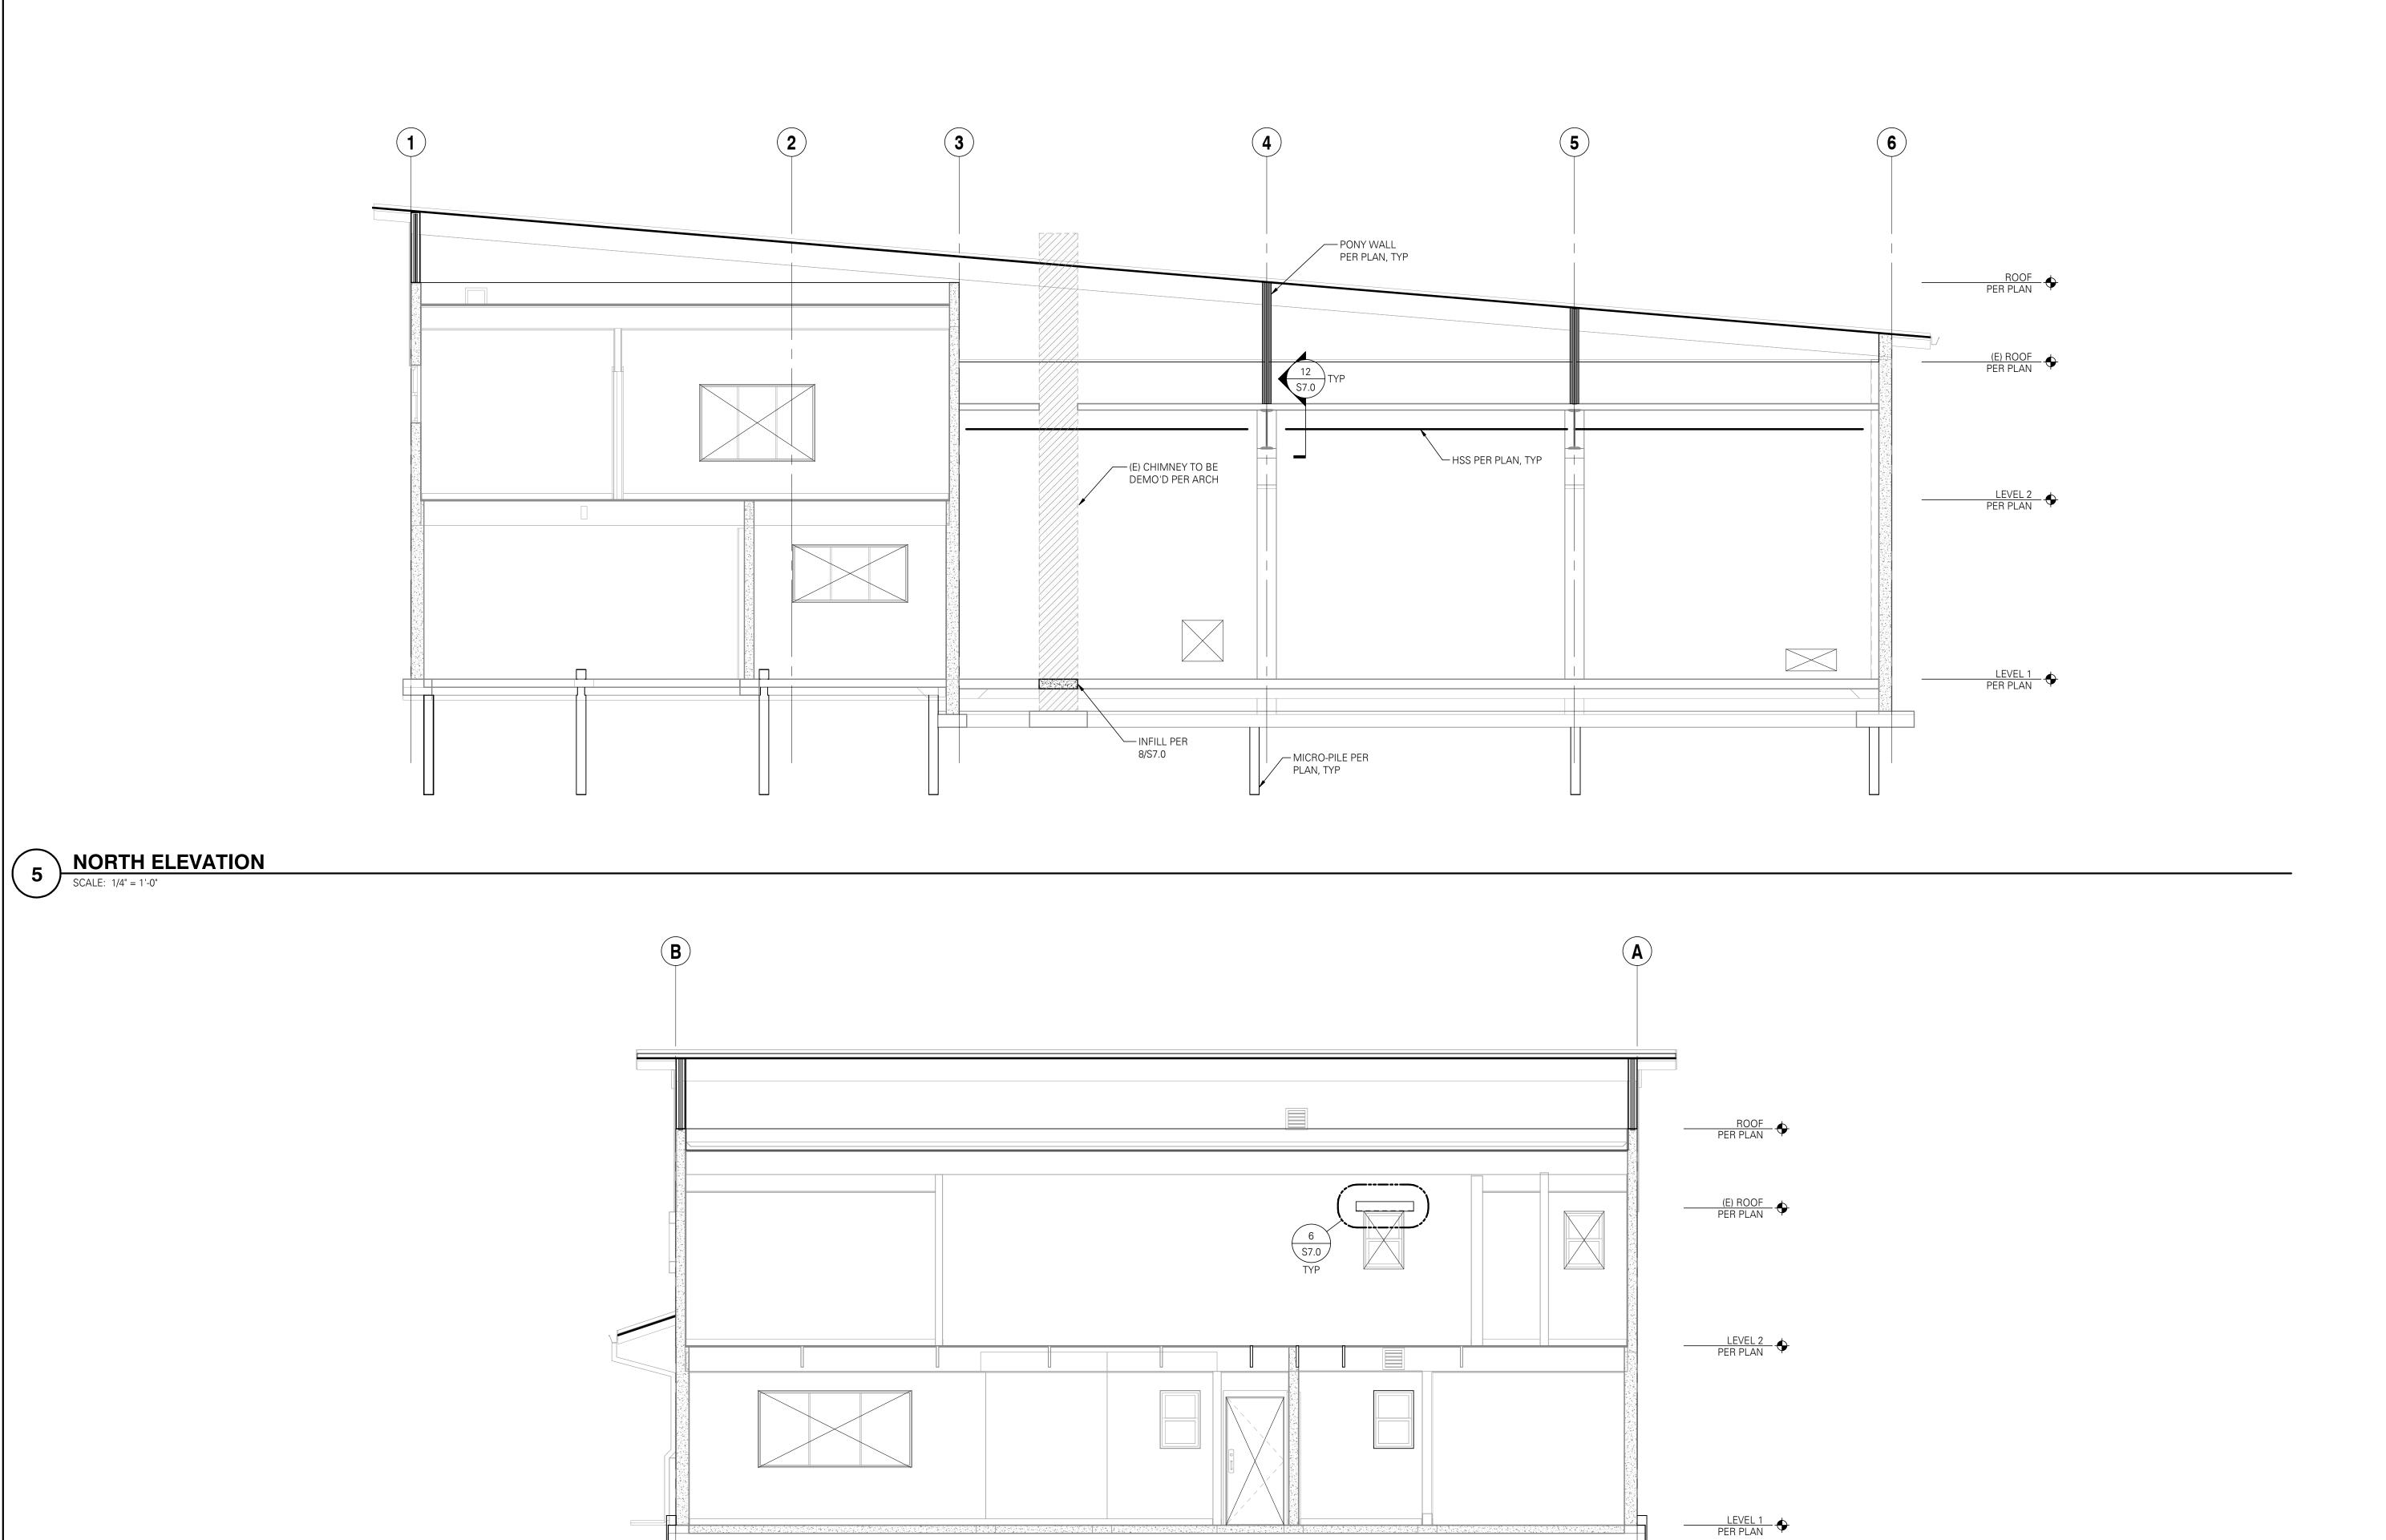

EAST ELEVATION

SCALE: 1/4" = 1'-0"

01400	G	RADE 60 RE	INFOR	CING	
BAR SIZE		ELLANEOUS BARS		P BARS e note #5)	HOOKE BARS
SIZE	Ld	Splice	Ld	Splice	Ldh
f'c = 4000	psi				
#3	15	19	19	25	7
#4	19	25	25	33	11
#5	24	31	31	41	15
#6	29	37	37	49	20
#7	42	54	54	71	25
#8	48	62	62	81	30

NOTES:

1. ALL TABULATED VALUES ARE IN INCHES.

2. VALUES FOR UNCOATED REINFORCING AND NORMAL WEIGHT CONCRETE CALCULATED PER ACI 318-19 SECTION 25.4.2.4. CALCULATIONS ASSUME THAT (Cb+Ktr)/db = 1.5, WITH CLEAR SPACING > db, CLEAR COVER > db AND MINIMUM STIRRUPS OR TIES THROUGHOUT Ld OR CLEAR SPACING > 2db AND CLEAR COVER > db.

3. DEVELOP ALL REINFORCING IN STRUCTURAL SLABS WITH MINIMUM DEVELOPMENT LENGTH Ld.

4. Ldh = DEVELOPMENT LENGTH OF BAR WITH STANDARD HOOK.

5. TOP BAR = HORIZONTAL BAR WITH MORE THAN 12" OF FRESH CONCRETE BELOW OR AS NOTED ON DOCUMENTS AS "TOP BAR".

6. LAP SPLICE OF DIFFERENT SIZED BARS TO BE THE LARGER OF Ld OF THE LARGER BAR OR SPLICE LENGTH OF THE SMALLER BAR.

8. LAP SPLICE OF DIFFERENT GRADES OF REINFORCING TO BE THE LARGER OF Ld OF THE HIGHER GRADE BAR OR SPLICE LENGTH OF THE LOWER GRADE BAR.


10. SHEAR WALL REINFORCING LAP SPLICE SCHEDULE PER 8/S5.1

TYPICAL LAP SPLICE AND **DEVELOPMENT LENGTH SCHEDULE**


D = 6d FOR #3 THRU #8 D = 8d FOR #9, #10 & #11 D = 10d FOR #14 & #18 ALL REINFORCING EXCEPT COLUMN TIES AND BEAM STIRRUPS STIRRUP OR TIE D = 4d FOR #3, #4 & #5 D = 6d FOR #6, #7 & #8 3" MIN BEAM OR COLUMN CROSSTIES BEAM STIRRUPS AND COLUMN TIES d = BAR DIAMETER, D = BEND DIAMETER

TIES AND CROSSTIES FOR SHEAR WALL BOUNDARY ELEMENTS SHALL BE DETAILED AS COLUMN TIES/CROSSTIES.


STANDARD HOOKS AND BENDS

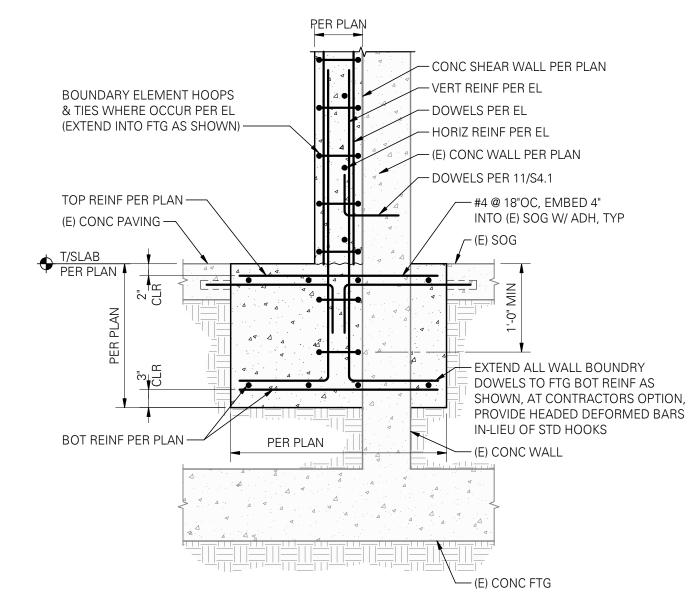


FOOTING AT CONCRETE SHEAR WALL

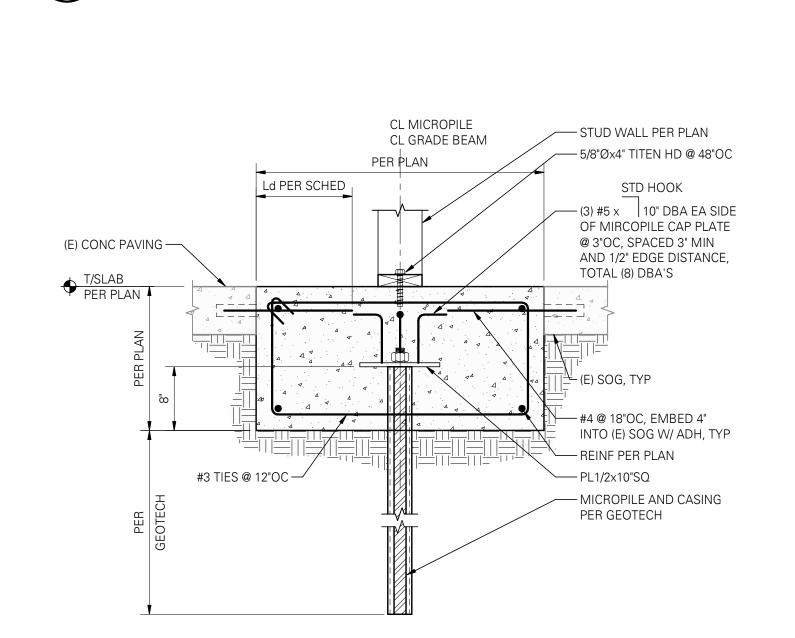


GRADE BEAM AT INTERIOR WALL

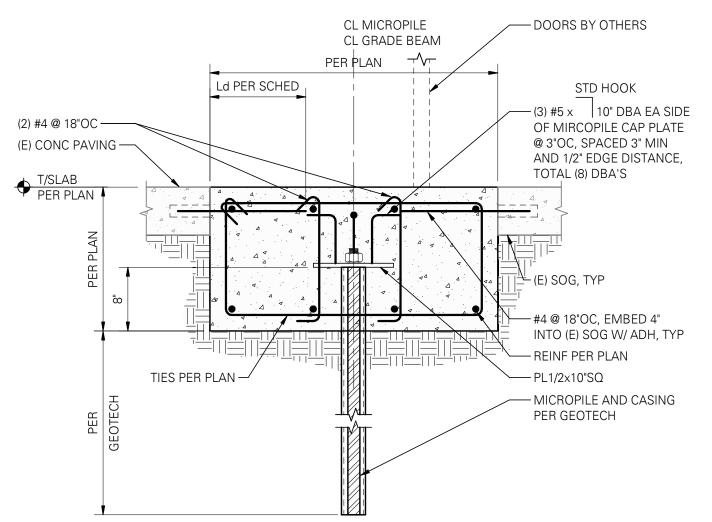


TYPICAL MICROPILE TO CONCRETE GRADE BEAM

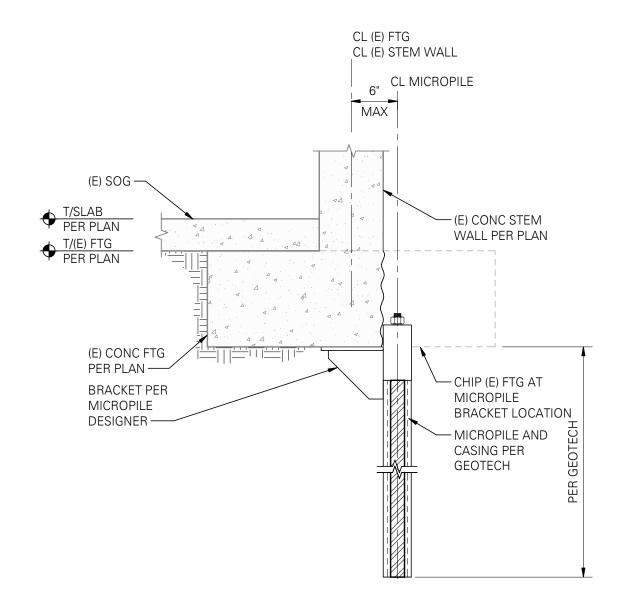


TYPICAL MICROPILE TO EXISTING CONCRETE FOOTING

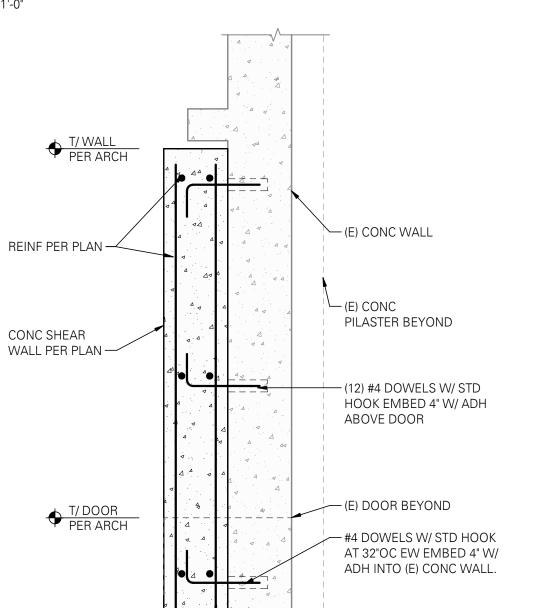


CONCRETE SHEAR WALL TO EXISTING CONCRETE WALL CONNECTION SCALE: 1" = 1'-0"

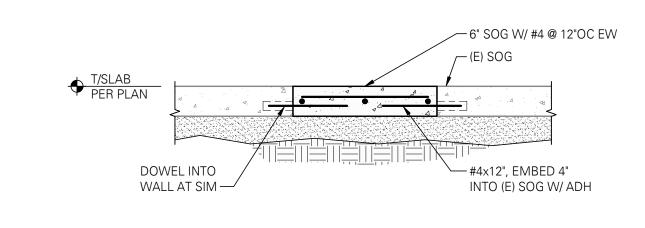

SLAB ON GRADE INFILL

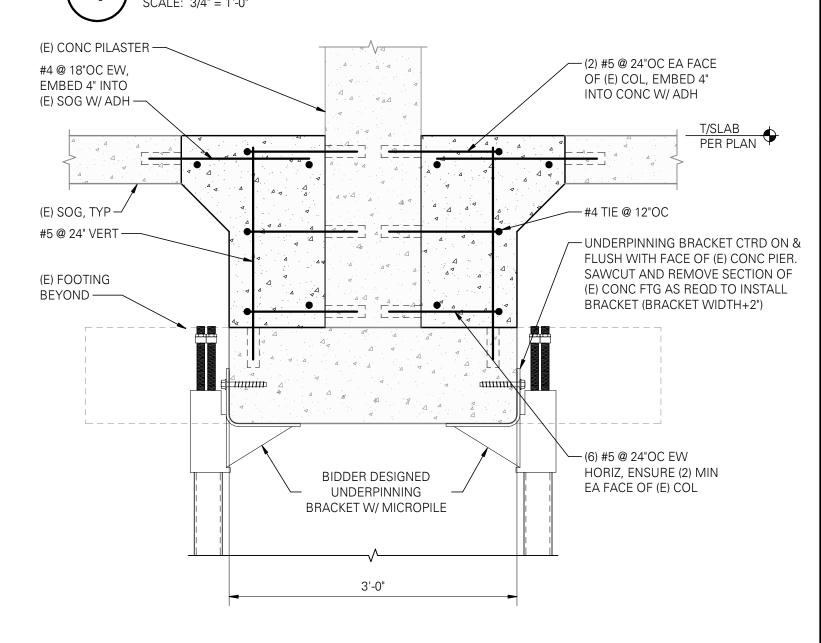

MICROPILE AT EXISTING CONCRETE PIER FOOTING

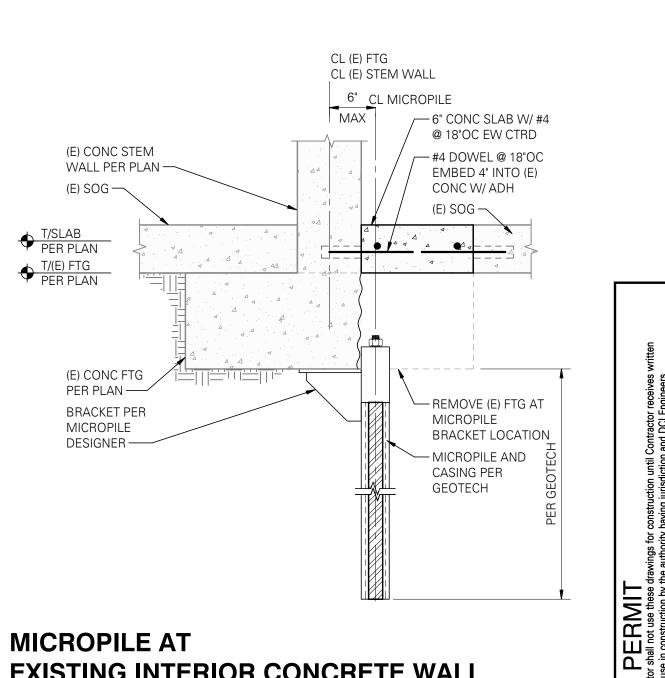

MICROPILE AT EXISTING INTERIOR CONCRETE WALL SCALE: 1" = 1'-0"

DATE: APRIL 2025 SHEET TITLE: STRUCTURAL **FOUNDATION DETAILS**

S4.1

EASTSIDE
CITY OF COOS BAY
365 D ST,
COOS BAY, OR 97420

CONSTRUCTION

DATE DESCRIPTION

REVISIONS:

333 S. 4TH STREET

COOS BAY, OR 97420

P: 541.269.1166

general@hge1.com

EXPIRES: 06-25-25

EISMIC

www.hge1.com

Copyright © 2025 HGE ARCHITECTS, Inc.

FOR



ARCHITECTS

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166

general@hge1.com

www.hge1.com


EASTSIDE | CITY OF COOS BAY 365 D ST, COOS BAY, OR 97420

CONSTRUCTION REVISIONS: # DATE DESCRIPTION

APRIL 2025 SHEET TITLE:
FOUNDATION
DETAILS

Copyright © 2025 HGE ARCHITECTS, Inc.

EXPIRES: 06-25-25

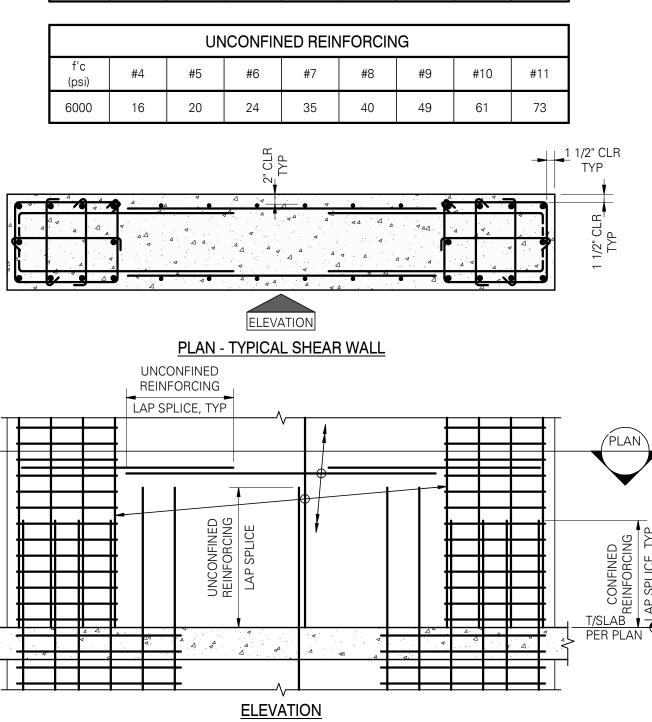

CONFINED REINFORCING

#9 #10



LAP SPLICE SCHEDULESCALE: 1/2" = 1'-0" (01404)

NOTES:

1. ALL TABULATED VALUES ARE IN INCHES.

LAP PER 8/S5.1, TYP

PLAN - CONCRETE SHEAR WALL

BOUNDARY (6 BARS)

__3/4" CHAMFER, TYP

- VERT REINF PER EL, TYP

— DOWELS W/ STD HOOK TO MATCH HORIZ REINF, TYP

— HORIZ REINF PER EL, TYP

- SHTHG PER PLAN

EDGE NAILING AT ALL

SUPPORTED PANEL EDGES & DIAPHRAGM

- FIELD NAILING AT INTERMEDIATE

- 2x BLKG AT PANEL

EDGES WHERE/IF INDICATED ON PLAN

MEMBERS

- FLR OR ROOF FRAMING

PERIMETER

SUPPORTS


STRUCTURAL FRAMING DETAILS

Copyright © 2025 HGE ARCHITECTS, Inc.

SHEAR WALL SCHEDULE - DOUG-FIR/SOUTHERN PINE


- STUD & SHTHG PER 5/8"Ø THRD ROD PLATE ATTACHMENT EMBED 6" INTO (E) PER SCHED —— CONC W/ ADH — (E) DECKING — — EDGE NAILING PER (E) CONC WALL —

PONY WALL AT EXISTING ROOF DECKING

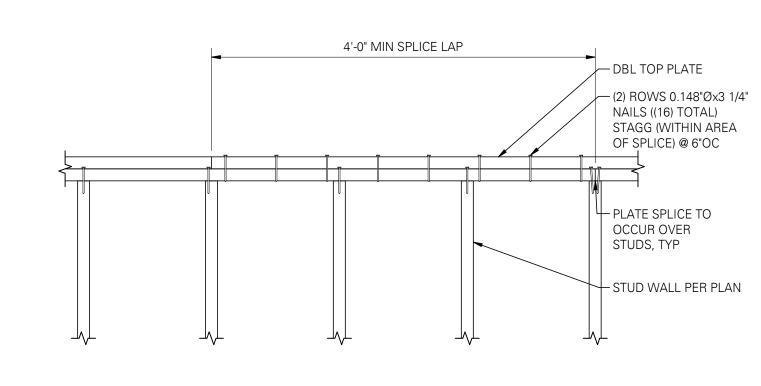

FLOOR/ROOF JOISTS NOT SHOWN FOR CLARITY.

TYPICAL PLATE SPLICE DETAIL

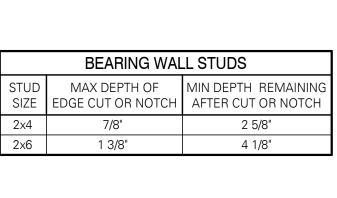

CIRCULAR NOTCH ~

VEE NOTCH —

LET-IN NOTCH -

STUD MAX DIAMETER SIZE OF BORED HOLE		MIN DEPTH REMAINING AFTER BORED HOLE				
2x4 1 3/8"		5/8" EA SIDE OF HOLE				
2x6	2 3/16"	5/8" EA SIDE OF HOLE				
NOTE: STUDS MAY NOT BE BORED IN EXCESS OF 40% OF THE STUD, IF STUDS ARE DOUBLED, BORINGS MAY BE INCREASED TO 60% OF STUD WIDTH PROVIDED NOT MORE THAN (2) SUCCESSIVE STUDS ARE BORED. BORINGS SHALL NOT BE MADE AT THE SAME SECTION						

WHERE CUT OR NOTCH HAS BEEN MADE.

BEARING WALL STUDS

BORED HOLES ARE

TO BE SPACED AT

BORED HOLES ARE

TO BE SPACED AT LEAST TWICE THE

DIAMETER OF THE

LARGEST HOLE

LEAST A STUD WIDTH

	NON-BEARING W	VALL STUDS
STUD SIZE	MAX DEPTH OF EDGE CUT OR NOTCH	MIN DEPTH REMAINING AFTER CUT OR NOTCH
2x4	1 3/8"	2 1/8"
2x6	2 3/16"	3 3/8"

	NON-BEARING W	VALL STUDS
STUD SIZE	MAX DIAMETER OF BORED HOLE	MIN DEPTH REMAINING AFTER BORED HOLE
2x4	2 1/16"	5/8" EA SIDE OF HOLE
2x6	3 1/4"	5/8" EA SIDE OF HOLE
STUD. E	MAY NOT BE BORED IN BORINGS SHALL NOT BE N WHERE CUT OR NOTO	


CUTTING AND NOTCHING WOOD STUDS

DO NOT NOTCH MORE THAN THREE ADJACENT STUDS WITHOUT REVIEW BY ENGINEER.

BORED HOLES IN WOOD STUDS

TYPICAL HOLES & NOTCHES IN WOOD STUDS

BORED HOLE NOT PERMITTED IN MORE THAN THREE ADJACENT STUDS WITHOUT REVIEW BY ENGINEER.

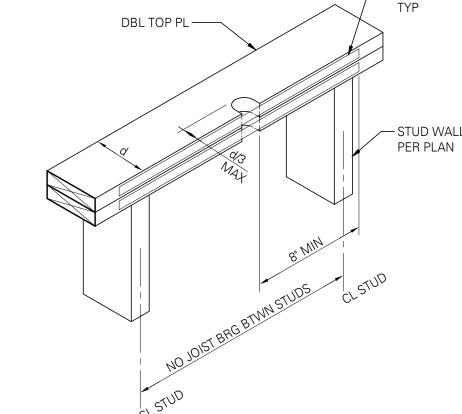

TYPICAL HOLES AND NOTCHES IN WOOD STUDS PER 9/S5.1.

TYPICAL NOTCHES AT TOP PLATES

SCALE: 1" = 1'-0"

- CTS218 STRAP,

[8] FRAMING CLIPS: A35 OR LTP5 OR APPROVED EQUIVALENT.

INFORMATION PER HOLD-DOWN DETAILS.

STUD WALL AND SHTHG

- EDGE NAILING PER SCHED

NOTES:

SHEAR WALL SCHEDULE W6 FOR 0.148"Øx 2 1/2" NAILS IN DOUG-FIR/SOUTHERN PINE (2018 IBC) [16]

RIM JOIST OR BLOCKING

BELOW [7, 8]

CLIP @ 16"OC

CLIP @ 12"OC

CLIP @ 16"OC

EACH SIDE

CLIP @ 16"OC

EACH SIDE

CONN TO TOP PLATE

1. MINIMUM EDGE DISTANCE FOR NAILS SHALL BE 3/8".

2. MINIMUM SHEATHING SHEET SIZE SHALL BE 24"x48".

4. NAILS SHALL BE COMMON WIRE TYPE OR APPROVED EQUAL

5. ADDITIONAL INFORMATION PER STRUCTURAL GENERAL NOTES.

PLAN - TYPICAL FLOOR AND

ROOF SHEATHING ATTACHMENT

3. NAILS SHALL NOT BE OVERDRIVEN.

AILING TO WOOD RIM JOIS OR BLOCKING BELOW

0.148"Øx3 1/4" @ 6"OC

0.148"Øx3 1/4" @ 4"OC

0.148"Øx3 1/4" @ 6"OC

(2) ROWS [9]

0.148"Øx3 1/4" @ 4"OC

(4) 0.131"Øx2 1/2" TOENAILS.

[6] INTERMEDIATE FRAMING TO BE 2x MINIMUM MEMBERS. ATTACH SHEATHING TO INTERMEDIATE FRAMING WITH 0.148"Øx2 1/2" NAILS AT 12"OC WHERE STUDS ARE SPACED AT

16"OC AND 0.148"Øx2 1/2" NAILS AT 6"OC WHERE STUDS ARE SPACED AT 24"OC.

[7] BASED ON 0.131"Øx1 1/2" NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE

WALL CONNECTION TO EXISTING CONCRETE

ON THIS PROJECT.

BLOCKING & STUD

SIZE AT ADJOINING

PANEL EDGES [3, 6, 14]

NAIL SIZE & SPACING

AT ALL PANEL EDGES

0.148"Øx2 1/2" @ 6"OC

0.148"Øx2 1/2" @ 4"OC

STAGGERED

0.148"Øx2 1/2" @ 3"OC

STAGGERED

0.148"Øx2 1/2" @ 2"OC

STAGGERED

[2] WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x

FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDES ARE NOT LOCATED ON

[4] PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS

INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY WINDOWS OR

[5] SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD-DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD-DOWN POSTS. ADDITIONAL

OPENINGS REQUIRE SHEATHING, SHEAR WALL NAILING, ETC ABOVE AND BELOW ALL OPENINGS).

DOORWAYS OR AS DESIGNATED ON PLANS. HOLD-DOWN REQUIREMENTS PER PLANS. (ALTERNATE NOTE: WALLS SHOWN WITH HORIZONTAL STRAPS BELOW AND/OR ABOVE

0.131"Øx2 1/2" NAILS WHERE INSTALLED OVER SHEATHING.

EXTERIOR

01430A

WALL SHEATHING

APA-RATED

15/32"

15/32"

15/32"

15/32"

THE SAME STUD.

[1] INSTALL PANELS EITHER HORIZONTALLY OR VERTICALLY.

[3] BLOCKING IS REQUIRED AT ALL PANEL EDGES.

(2) ROWS [9] [9] ANCHOR BOLTS SHALL BE SCREW ANCHOR PER GENERAL NOTES, EMBED 5" INTO EXISTING

ANCHOR BOLT TO

5/8"Ø @ 48"OC

5/8"Ø @ 32"OC

5/8"Ø @ 24"OC

5/8"Ø @ 16"OC

SILL PLATE AT

FOUNDATION [12]

CONCRETE. [10] PRESSURE TREATED MATERIAL CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTRO-PLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED

FRAMING MEMBERS. ADDITIONAL INFORMATION PER STRUCTURAL GENERAL NOTES. [11] WHERE WOOD SHEATHING (W) IS APPLIED OVER GYPSUM SHEATHING (G), CONTACT THE ENGINEER OF RECORD FOR ALTERNATE NAILING REQUIREMENTS.

[12] AT ADJOINING PANEL EDGES, (2) 2x STUDS NAILED TOGETHER MAY BE USED IN PLACE OF SINGLE 3x STUD. DOUBLE 2x STUDS SHALL BE CONNECTED TOGETHER BY NAILING THE STUDS TOGETHER WITH 3" LONG NAILS OF THE SAME SPACING AND DIAMETER AS THE PLATE NAILING, PER

[13] CONTACT THE STRUCTURAL ENGINEER OF RECORD FOR ADHESIVE OR EXPANSION BOLT


ALTERNATIVES TO CAST-IN-PLACE ANCHOR BOLTS. SPECIAL INSPECTION MAY BE REQUIRED. [14] NAIL STUDS TO 3x SILL PLATES WITH EITHER (2) 0.148"Øx4" END NAILS OR

[16] EDGE NAILS SHALL BE LOCATED 3/8" FROM PANEL EDGES.

[15] **WX** WHERE "W" INDICATES WOOD SHEATHING AND "X" INDICATES EDGE NAIL SPACING.


ADJOINING PANEL EDGE —— PANEL EDGE NAILING, TYP - NAILING TO MATCH PLATE NAILING (2) 2x STUDS

PLAN - ADJOINING PANEL EDGES

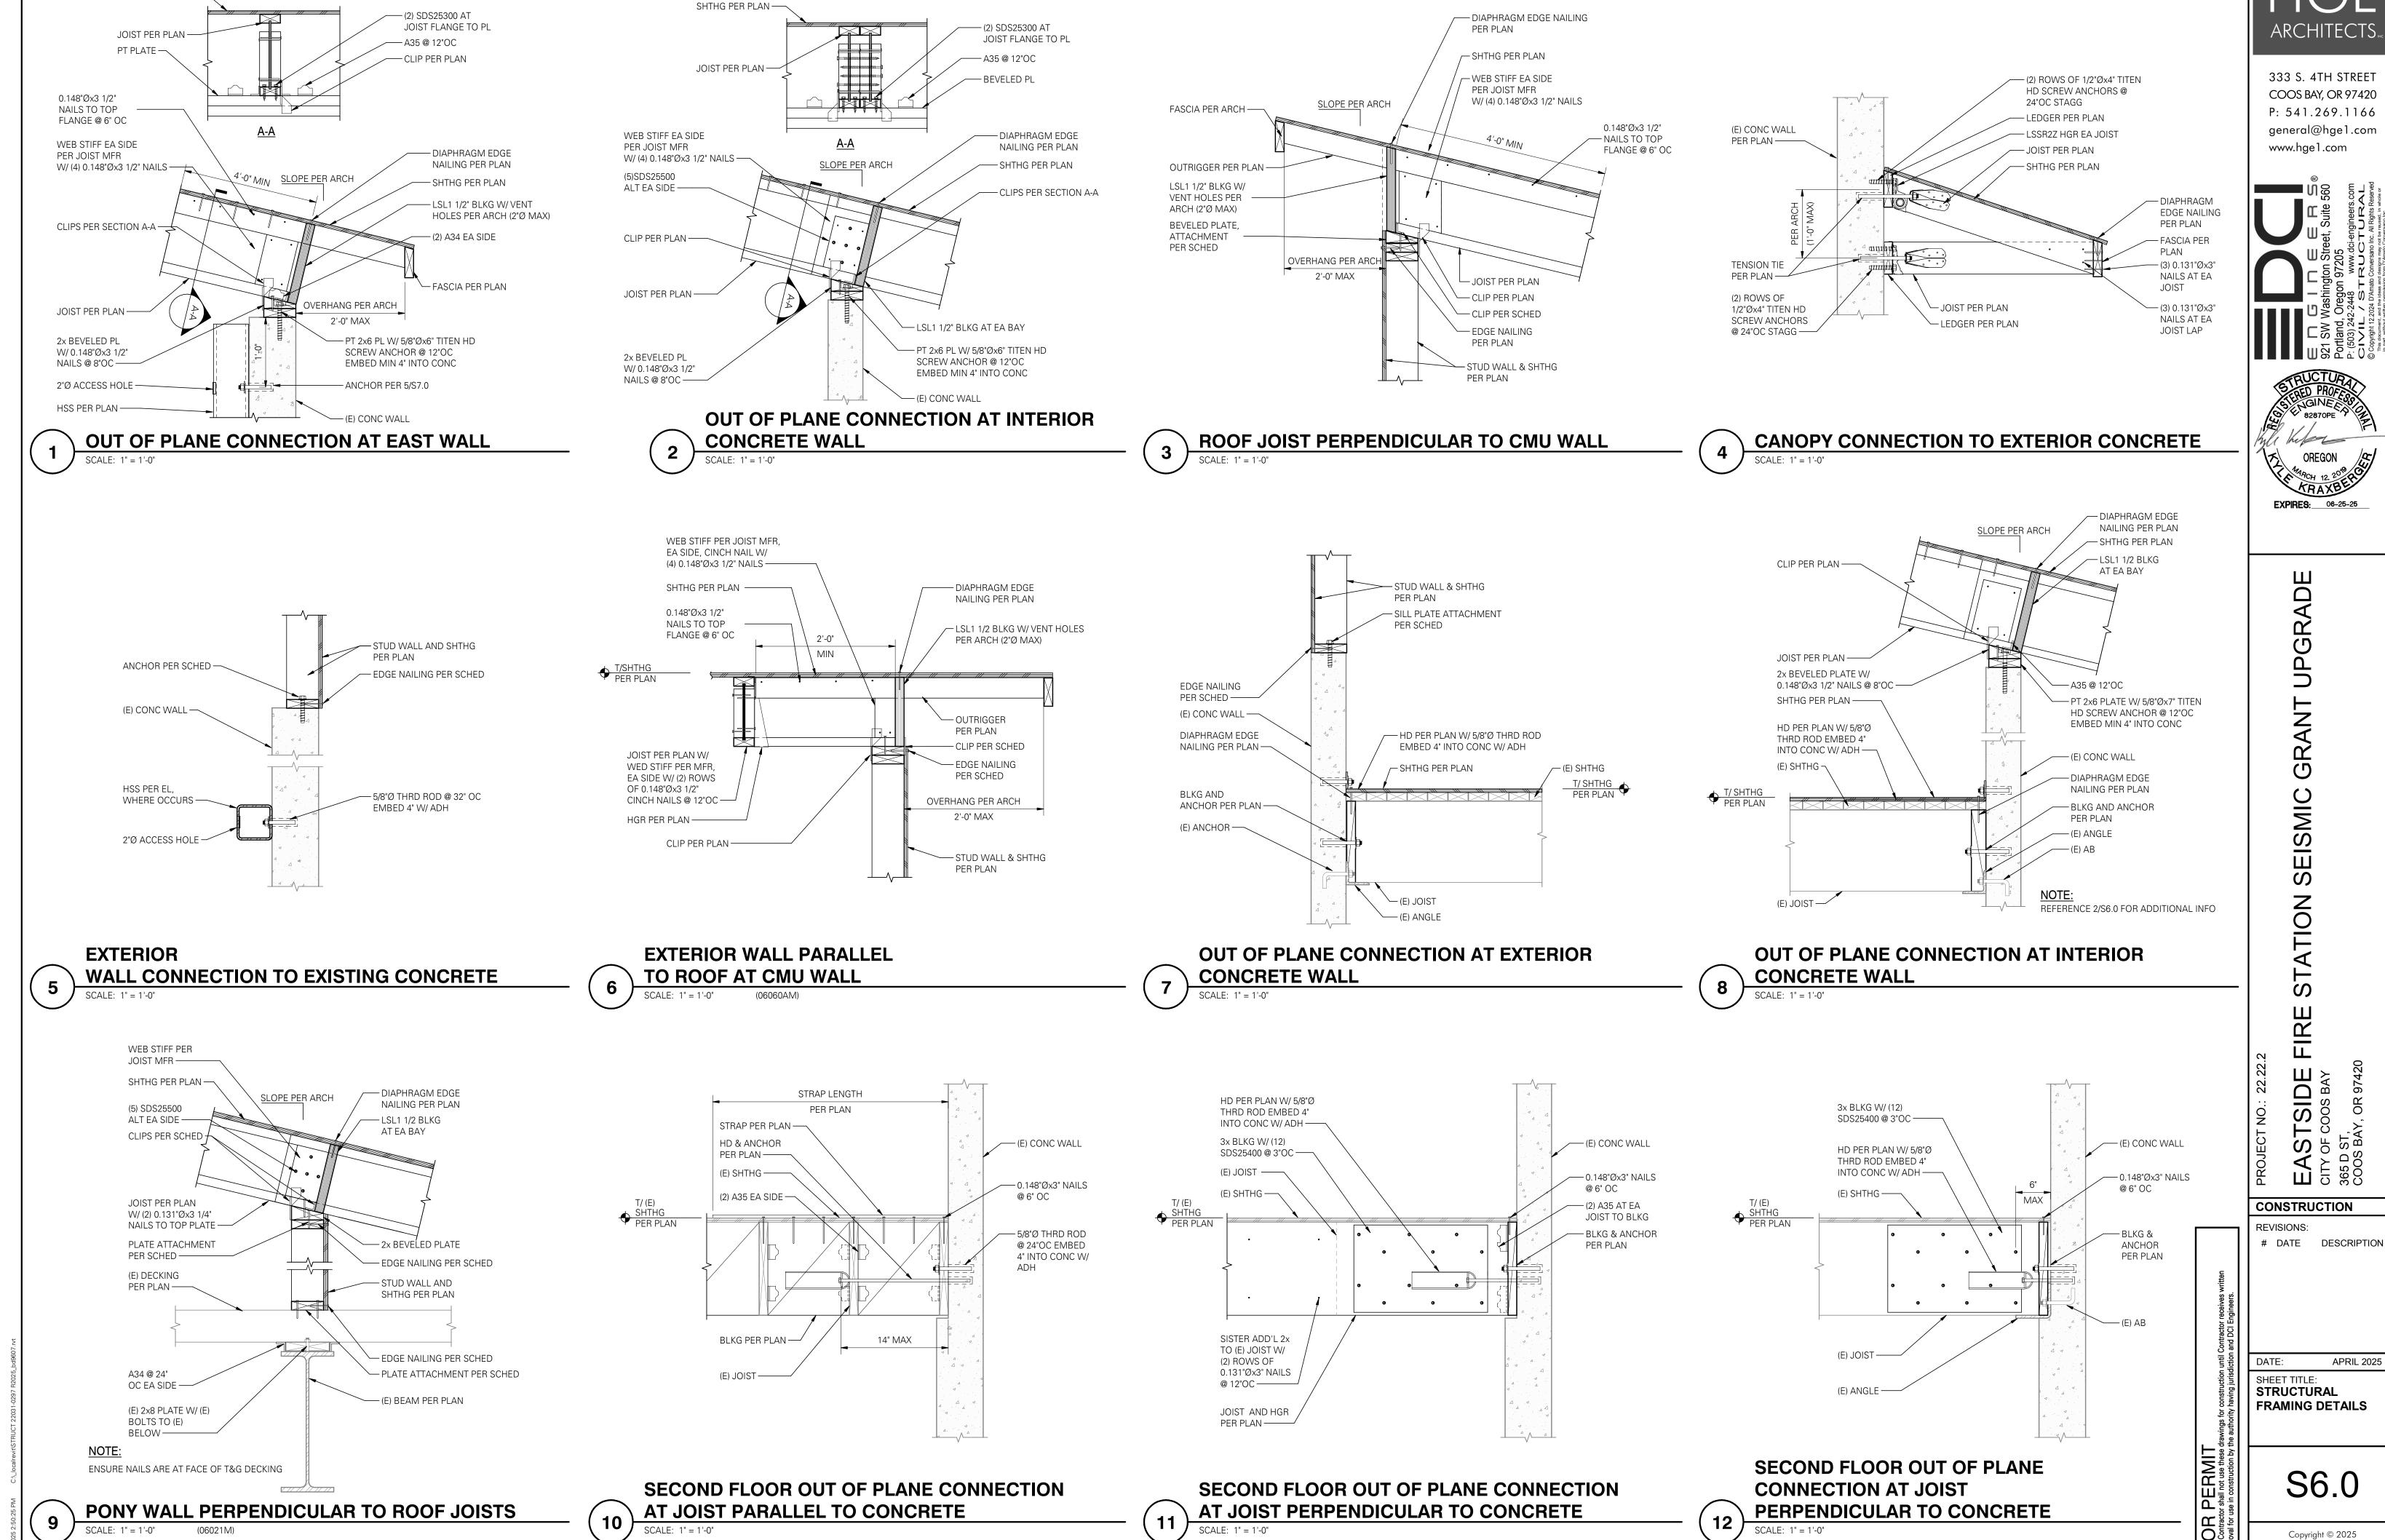

SHTHG PER PLAN -

COOS BAY, OR 97420

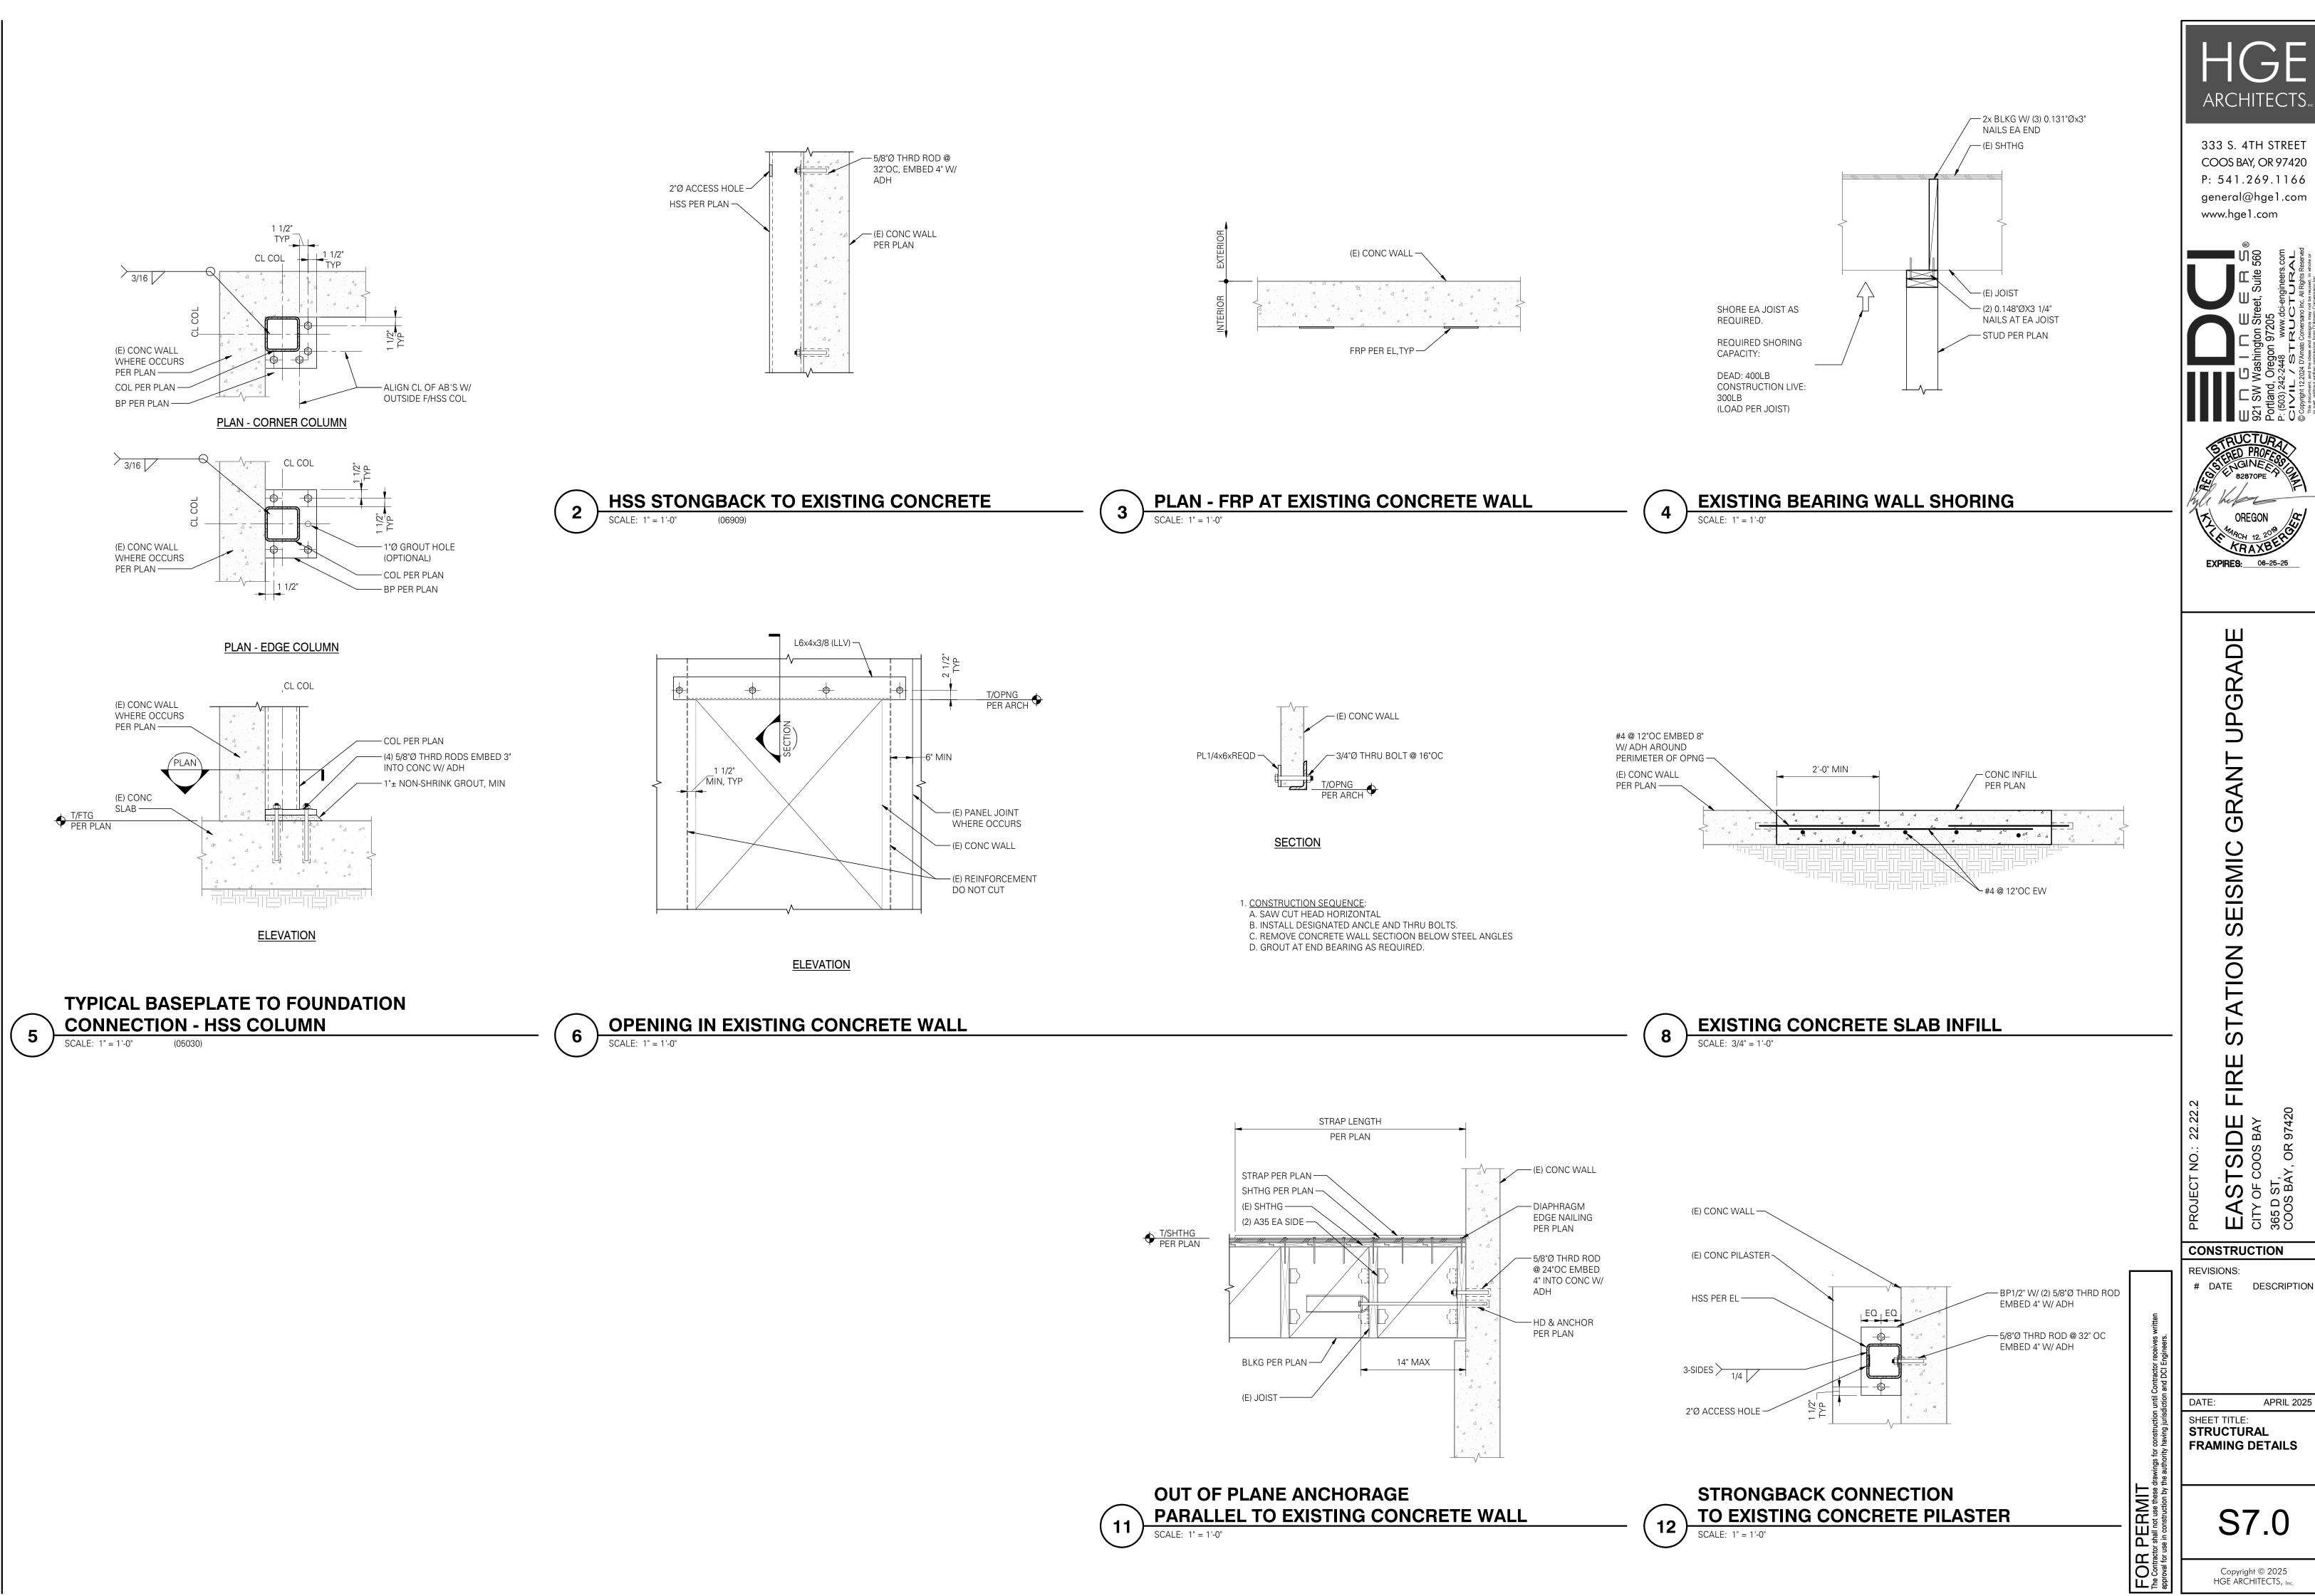

Copyright © 2025 HGE ARCHITECTS, Inc.

APRIL 2025

YMBOLS	ONELINE DIAGRAM	NOTES	SYMBOLS	LIGHT FIXTURES	NOT
	MOLDED CASE CIRCUIT BREAKER			WHEN ADDED TO LIGHT FIXTURE SYMBOL-	
w	TRANSFORMER		1	INDICATES WALL OR BRACKET MOUNTED LIGHT FIXTURE SURFACE OR PENDANT MOUNTED LIGHT FIXTURE OUTLET.	
\mathcal{M}			FD_2.	(NUMBER INDICATES CIRCUIT , CAPITAL LETTER	
<u> </u> //]	INDICATES FIXTURE TYPE, LOWER CASE LETTER INDICATES SWITCHING CONTROL, TYPICAL FOR ALL	
<u> </u>	CURRENT TRANSFORMER(S)		<u> </u>	LIGHT FIXTURES)	
	METER, TYPE AS NOTED			RECESSED CEILING LIGHT FIXTURE	
±	GROUND			RECESSED WALL WASHER, UNSHADED SIDE INDICATES DIRECTION OF WALL WASHING	
\square_{N}	NEUTRAL BUS				
(2)	MOTOR WITH MOTOR NUMBER (SEE EQUIPMENT SCHEDULE)			FLUORESCENT LIGHT FIXTURE	
D	COMBINATION FIRE SMOKE DAMPER	(2)]	FLUORESCENT STRIP LIGHT FIXTURE SINGLE FACE EXIT SIGN WITH NUMBER OF DIRECTIONAL	
$\langle \mathbf{x} \rangle$	FOURMENT NUMBER (SEE FOURMENT SOURDUILE)		<u>⊗</u> ⊗	ARROWS AS SHOWN , CEILING MOUNTED . SOLID	
$\backslash \mathbf{x}$	EQUIPMENT NUMBER (SEE EQUIPMENT SCHEDULE)			QUADRANT INDICATES FACE.	
마	NON-FUSED DISCONNECT SWITCH		SYMBOLS	SWITCHES	NOT
ď	FUSED DISCONNECT SWITCH (FUSES SIZED PER		\$	SINGLE POLE LIGHT SWITCH	+ 46"
 	EQUIPMENT MANUFACTURERS RECOMMENDATIONS UNO.) COMBINATION MOTOR STARTER / FUSED DISCONNECT		\$3	THREE WAY LIGHT SWITCH	+ 46"
	SWITCH		\$ _M	MOTOR RATED SWITCH	+ 46"
	SUB-DISTRIBUTION PANELBOARD OR SWITCHBOARD		1		+ 40
	BRANCH CIRCUIT PANELBOARD		W c W w		
	MISCELLANEOUS PANEL AS NOTED		L ®	PHOTOELECTRIC SWITCH	
<u> </u>	MAIN DISTRIBUTION PANELBOARD		SYMBOLS	SECURITY	ПОИ
T	TRANSFORMER			SECURITY CAMERA, PROVIDE J-BOX WITH CAT 6 CABLE	1101
W155: 5	P. A. A.PHILA LAP	MATTE	1 L	ELECTRONICALLY CONTROLLED LOCK	
YMBOLS	RACEWAYS	NOTES		DOOR POSITION SWITCH	
*	BRANCH CIRCUIT INSTALLED CONCEALED FROM FINISH SPACES. PROVIDE GROUND CONDUCTOR AS INDICATED		I — -	MOTION DETECTOR (OMNI DIRECTIONAL)	1
•	IN PANEL SCHEDULE. GROUND CONDUCTOR NOT INCLUDED IN HASH MARK INDICATION.		W CR		
	BRANCH CIRCUIT INSTALLED IN OR BELOW FLOOR.		SK	CARDREADER	+ 44"
X	PROVIDE GROUND CONDUCTOR AS INDICATED IN PANEL			KEYPAD	+ 44"
	SCHEDULE . GROUND CONDUCTOR NOT INCLUDED IN HASH MARK INDICATION .		SYMBOLS	AUDIO / VISUAL	NOT
	BRANCH CIRCUIT HOME RUN TO PANEL , HASH MARKS		<u> </u>	CEILING SPEAKER	1
HH 10-	INDICATES NUMBER OF CONDUCTORS . PROVIDE GROUND CONDUCTOR AS INDICATED IN PANEL			WALL MOUNTED SPEAKER	+ 80"
	SCHEDULE . GROUND CONDUCTOR NOT INCLUDED IN		HSV	WALL MOUNTED SPEAKER HORN	+ 80"
	HASH MARK INDICATION .				+ 18"
	LOW VOLTAGE EMPTY CONDUIT WITH PULL STRING - 34" UNO			TELEVISION (VIDEO) OUTLET INTERCOM REQUEST STATION (SPEAKER & PUSH BUTTON)	
PB	PULL BOX , 6" x 6" x 4" UNLESS NOTED OTHERWISE			INTERCOT REQUEST STATION (SPEAKER & PUSH BUTTON)	+ 44
<u></u>	JUNCTION BOX , 4" SQUARE UNLESS OTHERWISE NOTED		SYMBOLS	FIRE ALARM	NOT
	4" CONDUIT SLEEVE WITH BUSHINGS AT BOTH ENDS .		(M)	MANUAL PULL STATION	+ 44"
	LOCATE AT 6" ABOVE ACCESSIBLE CEILING . FIRESTOP WITH UL APPROVED SYSTEM .			COMBINATION VISUAL / AUDIBLE ALARM	+ 80" A
	CONDUIT STUB-OUT, CAP & MARK WITH APPROVED MARKER			VISUAL STROBE ALARM	+ 80" A
	CONDUIT, UP			PHOTOELECTRIC SMOKE DETECTOR (CEILING NOUNTED UNO)	+ 00 4
	CONDUIT, DOWN			IONIZATION SMOKE DETECTOR (CEILING MOUNTED UNO)	
				MAGNETIC DOOR HOLDER	
YMBOLS	RECEPTACLES	NOTES		HEAT DETECTOR (CEILING MOUNTED, 135° UNO)	
•	WHEN ADDED TO A SYMBOL , INDICATES OUTLET MOUNTED WITH BOTTOM OF OUTLET AT 2" ABOVE			THE PETESTOR COLLEGE TOWNIED, 155 GROV	
	COUNTER TOP OR BACK SPLASH UNO.		SYMBOLS	ABBREVIATIONS	NOT
0	DUPLEX CONVENIENCE OUTLET	+ 18"	AIC	AMPERE INTERRUPTING CAPACITY	
•	GFI DUPLEX CONVENIENCE OUTLET	+ 18"	AMP	AMPERE	
•	DUPLEX OUTLET WITH USB OUTLETS	+ 18"	C	CONDUIT	
#	DOUBLE DUPLEX CONVENIENCE OUTLET	+ 18"	EC	EMPTY CONDUIT (WITH PULL-IN LINE)	
•	SINGLE PHASE SPECIAL PURPOSE OUTLETS, AS NOTED	+ 18" UNO	ELEC	ELECTRICAL	
8	THREE PHASE SPECIAL PURPOSE OUTLETS, AS NOTED		FAAP	FIRE ALARM ANNUNCIATOR PANEL	
	FLUSH FLOOR OUTLET AS SHOWN		FACE	FIRE ALARM CONTROL PANEL	
			G, GND	GROUND	
YMBOLS	TELEPHONE / DATA	NOTES	GEN	GENERATOR	
•	WHEN ADDED TO SYMBOL, INDICATES OUTLET MOUNTED WITH BOTTOM OF OUTLET AT 2" ABOVE COUNTER TOP OR		GFI	GROUND FAULT CIRCUIT INTERRUPTER TYPE	
	BACKSPLASH UNO			HORSEPOWER	
4	TELE./DATA. PROVIDE (2) CAT6 CABLES UNO	+ 18"		ISOLATED GROUND	
⊿ ₪	'W' ADDED TO SYMBOL INDICATES WALL MOUNTED	+ 60" (1)	I -		
1 1	FLUSH FLOOR OUTLET AS SHOWN	(1)	MECH	MECHANICAL MANUE ACTUBED	
TTB	TELEPHONE TERMINAL BOARD, 8" HIGH (WIDTH AS SHOUN) 36" FIRE RESISTIVE PLYWOOD WITH # 6 CLICAD	~	MFGR	MANUFACTURER	
. \ /.	CHOCKY, 4 THE RESIDING FERENCE OF SHITT DOG GREE	_	NEC	NATIONAL ELECTRIC CODE	04.11-01
WIFD	WIRELESS ACCESS PORT. PROVIDE (1) CAT6 CABLES	<u></u>	NL OF CI	NIGHT LIGHT	24 HOU
4	TELE./DATA. PROVIDE (1) CAT6 CABLES UNO	+ 18"	OFCI	OWNER FURNISHED CONTRACTOR INSTALLED	
•		~		OWNER FURNISHED OWNER INSTALLED	
] PB	PULL BOX	
NO	TES		PH	PHASE	
	· • · · ·		PNL	PANEL	
ı. ALL	. SYMBOLS MAY NOT APPLY DIRECTLY TO THIS JOB.		PWR	POWER	
2. ALL	MOUNTING HEIGHTS SHOWN ARE TO CENTERLINE OF DEVIC	E.	SYS	SYSTEM	
3. <i>A</i> LI	L MOUNTING HEIGHTS ARE TYPICAL ON PLANS,		Т	TELEPHONE	
	·		TTB	TELEPHONE TERMINAL BOARD	
∠ ⊢\	YED NOTES		TYP	TYPICAL	
\ _	· — = · · · · · — ·		UNO	UNLESS NOTED OTHERWISE	
<u> </u>					
	PROVIDE I" CONDUIT FROM OUTLET BOX TO ACCESSIBLE LO		Y	VOLT	
	PROVIDE I'' CONDUIT FROM OUTLET BOX TO ACCESSIBLE LO BOVE CEILING, UNLESS NOTED OTHERWISE. TERMINATE CO BLUE INSULATED BOX CONNECTORS AND LABEL SYSTEM, SE	NDUITS WITH	V VP	VOLT VANDAL PROOF	
	BOVE CEILING, UNLESS NOTED OTHERWISE. TERMINATE CO	NDUITS WITH EE			

PROJECT NOTES

- 1. THIS PROJECT IS A SEISMIC UPGRADE TO AN EXISTING FIRE STATION. FIELD COORDINATE REQUIREMENTS TO ACCOMMODATE INSTALLATION OF NEW SEISMIC SUPPORTS AND TO RE-ENERGIZE EXISTING EQUIPMENT-TO-REMAIN. IT IS THE ELECTRICIAN'S RESPONSIBILITY TO FAMILIARIZE THEMSELVES WITH STRUCTURAL AND ARCHITECTURAL PLANS TO FULLY UNDERSTAND THE REQUIREMENTS OF THIS PROJECT.
- 2. 400 AMP SERVICE: REPLACE EXISTING SYSTEM OF PANELS AND DISCONNECTS WITH NEW 400 AMP SERVICE (SEE NEW I-LINE). PROVIDE SERVICE ENTRANCE DISCONNECT TO FEED ATS AND PANEL 'A'. PROVIDE NEW 150 AMP PANEL AND FEEDER TO UPSTAIRS DORMITORY AREA. FIELD COORDINATE ALL OTHER BREAKER REQUIREMENTS WITH EXISTING EQUIPMENT TO REMAIN. PROVIDE TYPE WRITTEN PANEL SCHEDULE WITH PLASTIC COVER. PROVIDE NEW ENGRAVED PHYNOLIC PANEL LABELS WITH NAME, VOLTAGE AND AMP RATING.
- 3. WORK SHOWN ON PLAN IS BASED ON AVAILABLE INFORMATION AT THE TIME OF DESIGN. FIELD COORDINATE SEISMIC UPGRADE REQUIREMENTS WITH ARCHITECTURAL AND STRUCTURAL. CONTRACTOR IS TO FIELD YERIFY EXISTING CIRCUITING AND INSTALLATION.
- 4. CONTRACTOR SHALL COORDINATE AND PERFORM NECESSARY ELECTRICAL DEMOLITION WORK ASSOCIATED WITH ALL ITEMS AND EQUIPMENT TO BE REMOVED.
- 5. CONFIRM THAT ALL EXISTING DEVICES AND EQUIPMENT PLANNED FOR REUSE ARE IN GOOD OPERATING CONDITION. UNSUITABLE ITEMS SHALL NOT BE REUSED. RETURN ALL OTHER ITEMS SUITABLE FOR REUSE TO OWNER.
- 6. WIRING WHICH SERVES USABLE EXISTING OUTLETS SHALL BE REROUTED AND RESTORED CLEAR OF CONSTRUCTION. MAINTAIN ELECTRICAL CONTINUITY OF EXISTING SYSTEM. REPAIR AND RECONDITION ASSOCIATED SURFACES TO MATCH ADJACENT SURFACES. VERIFY EXACT LOCATIONS IN THE FIELD.

								<u> </u>	<u>4N</u>	IEL_	<u>'</u>	<u> </u>					F	AULT CURRENT :	= 12	3ار:
400	0	AMP	MAIN	BRE	AKER	₹		120	/	24	Ø	VOL	19					1-PHASE, 3	3-W	川下
EE	EDE	R SIZE			CO	PPER	2: 2 SI	ets -	2	" C	:, з	*3/0	PH, #	1/0 G	RD			FLUSH MO	UNT	ΤE
OAI		STRIBUTION	LTG	REC	MOTOR	DATA	EXTG	HEAT				MISC	PH-A	PH-B		TOTAL	AMPS	WITH SPARE		
:ONN	NECT	ED VA	23Ø3	42338	9344	Ø	Ø	4500)			1200	31454	28231		59685	262	746 <i>0</i> 6 VA		
ΙνΈ	RSIT	Y FACTOR	125%	62%	100%	100%	65%	100%				100%								
ΙVΕ	RSIF	IED VA	2879	26169	9344	Ø	Ø	4500)			1200	22799	21292		44Ø92	190	55115 VA		
`L	T	LOAD	VA	HP	PHW	GND	CON	BKR		PH		BKR	CON	GND	PHW	HP	VA	LOAD	T	
	P	PANEL B	דרושו					200	2	Д	2	150					4800	PANEL C	P	7
3	P	PANEL B	9123							В							7419	PANEL C	P	1
,		SPACE								Д								SPACE		
		SPACE								В								SPACE		
	0	FIRE ALARM PANEL	1200		12	12	1/2	20	1	A	1	20	1/2	12	12		180	REC: OUTDOOR	R	
	R	REC: CONF RM / HALL	900		12	12	1/2	20	1	В	1	20	1/2	12	12		360	REC: W. APP BAY	R	
3	R	REC: SW CONF RM	540		12	12	1/2	20	1	A	1	20	1/2	12	12		720	REC: N. APP BAY	R	
,	R	REC: CONF RM TV	360		12	12	1/2	20	1	В	1	20	1/2	12	12		720	REC: E. APP BAY	R	
1	R	REC: NW CONF / HALL	540		12	12	1/2	20	1	A	1	30	1/2	10	12	1	1656	WEST DOOR	М	
3	R	REC: STORAGE 6	900		12	12	1/2	20	1	В	1	30	1/2	10	12	1	1656	CENTER DOOR	М	
1	R	REC: DATA	360		12	12	1/2	20	1	A	1	3Ø	1/2	10	12	1	1656	EAST DOOR	М	
3	R	REC: DATA	360		12	12	1/2	20	1	В	1	20	1/2	12	12		180	REC: W. TRUCK	R	
۶	R	REC: TOILET 5	180		12	12	1/2	20	1	A	1	20	1/2	12	12		180	REC: C. TRUCK	R	_
۱	R	REC: TOILET 4	180		12	12	1/2	20	1	В	1	20	1/2	12	12		180	REC: E. TRUCK	R	
9		SPARE	Ø				1/2	20	1	A	1	20	1/2	12	12		360	REC: CEILING DROP	R	4
1		SPARE	Ø				1/2	20	1	В	1	20	1/2	12	12	1/2	1176	PROPANE UNIT HTR	М	\perp
3		SPARE	Ø				1/2	2Ø	1	A	1	20	1/2	12	12		276	ATTIC REC & LTS	R	
5		SPARE	0				1/2	20	1	В	1	20	1/2	12	12		880	LTS: LOWER ADMIN	L	4
٦		SPARE	Ø				1/2	20	1	A	1	20	1/2	12	12		260	LTS: EXTERIOR	L	4
9		SPARE	Ø				1/2	20	1	В	1	20	1/2	12	12		704	LTS: APP BAY	<u>⊩</u> ∟	

ALL CIRCUIT CONDUCTORS SIZED FOR COPPER

25.05 Schedules

								<u> </u>	<i>IN</i>	EL	<u> </u>	3 ' <u> </u>					FA	<u> ULT CURRENT = 1</u>	0,9	308
20	0	AMP	MAIN	BRE	AKER	₹		120	/	240	0	YOL	rs					1-PHASE, 3	3-W	IRE
FE	EDE	R SIZE				CO	PPER	₹: 2" (٥,	3 *:	3/0	DPH,	*6 G	RD				FLUSH MO	UNT	ED
		STRIBUTION	LTG		•	DATA	EXTG	HEAT				MISC	•	PH-B		TOTAL	•	WITH SPARE		25
		ED VA	0	13200	3200	0	0	4500				0	11050	9850		20900	92	26125 VA		113
		Y FACTOR	125%	88%	100%	100%	65%	100%				100%								
	ERSIF	IED VA	0	11600	3200	Ø	0	4500				0	דדושו	9123		19300	85	24125 VA		100
PL	T	LOAD	VA	<u>1</u>	PHW	GND	CON	BKR		PH		BKR	CON	GND	PHW	HP	VA	LOAD	T	PL
1	R	50-AMP RECEPTACLE	4800		6	10	3/4	50	2	Д	1	2Ø	1/2	12	12		1200	GEN: BATTERY	R	2
3	R		4800							В	1	20	1/2	12	12		1200	GEN: HEATER	R	4
5	н	WATER HEATER	2250		10	10	1/2	3Ø	2	Д	1	20	1/2	12	12		1200	GEN: ANNUNCIATOR	R	6
Т	H	WATER HEATER	2250							Ø	1	20	1/2				Ø	SPARE		8
9	М	MINI-SPLIT	1600		10	10	1/2	3Ø	2	A	1	20	1/2				Ø	SPARE		10
11	М		1600							Ø	1	20	1/2				Ø	SPARE		12
13		SPARE	Ø				1/2	2Ø	1	A	1	20	1/2				Ø	SPARE		14
15		SPARE	Ø				1/2	20	1	В	1	20	1/2				Ø	SPARE		16
ΙΤ										A										18
19										В										20
21										A										22
23										В										24
25										A										26
27										В										28
29										A										30
31										В										32
33										A										34
35										В										36
37										A									<u> </u>	38
39										В										40


								P	ΔN	EL	' (S '						FAULT CURRENT	- 7	,716
150)	AMP	MAIN	BRE	AKER	2		120	/	24	0	VOL.	TS					1-PHASE, 3	3-W	IRE
FEE	EDE	R SIZE				ALI	MINUT	1: 2"	C	, 3 '	* 3/	Ø PH	, * 4 G	RD.				FLUSH MO	UNT	ΈD
L <i>OA</i> I		STRIBUTION	LTG	REC	MOTOR	DATA	EXTG	HEAT				MISC	PH-A	PH-B		TOTAL	AMPS	WITH SPARE		25%
CON	NECT	ED VA	459	21662	Ø	ø	Ø	Ø				Ø	12296	9825		22121	102	27 6 51 VA		128
DIVE	RSIT	Y FACTOR	125%	73%	100%	100%	65%	100%				100%								
DIVE	RSIF	IED VA	574	15831	Ø	Ø	Ø	Ø				Ø	8986	7419		16405	75	2 <i>0</i> 5 <i>0</i> 6 ∨A		94
PL	T	LOAD	VA	1 P	PHW	GND	CON	BKR		PH		BKR	CON	GND	PHW	HP	VA	LOAD	T	PL
1	R	\$1 0 √E	4000		6	10	3/4	50	2	Д	1	20	1/2	12	12		1600	REC: BATHROOM	R	2
3	R		4000							В	1	20	1/2	12	12		64	BATHROOM LTG / FAN	L	4
5	R	REFRIGERATOR	1200		12	12	1/2	20	1	A	1	20	1/2	12	12		720	REC: EXISTING DAY RM	R	6
7	R	DISHWASHER	1200		12	12	1/2	20	1	В	1	20	1/2	12	12		1200	SLEEPING AREAS	R	8
9	R	GARBAGE DISP.	1656	3/4	12	12	1/2	20	1	A	1	20	1/2				Ø	SPARE		10
11	R	REC: COUNTER / FAN	1200		12	12	1/2	20	1	В	1	20	1/2				Ø	SPARE		12
13	R	REC: COUNTER	1200		12	12	1/2	20	1	A	1	20	1/2				Ø	SPARE		14
15	R	REC: COUNTER	1200		12	12	1/2	20	1	В	1	20	1/2				Ø	SPARE		16
דו	R	REC: ISLAND	1200		12	12	1/2	20	1	A	1	20	1/2				Ø	SPARE		18
19	R	REC: RADIO COUNTER	360		12	12	1/2	20	1	В	1	20	1/2				Ø	SPARE		20
21	R	REC: DINING ROOM	720		12	12	1/2	20	1	A	1	20	1/2				Ø	SPARE		22
23	R	REC / LT: ATTIC	206		12	12	1/2	20	1	В	1	20	1/2	12	12		395	LIGHTS	L	24
C							"		5/	27/20	5 25							FED FROM PA	NEL	'A'

ALL CIRCUIT CONDUCTORS SIZED FOR COPPER

ALL CIRCUIT CONDUCTORS SIZED FOR COPPER


25.05 Schedules

25.05 Schedules

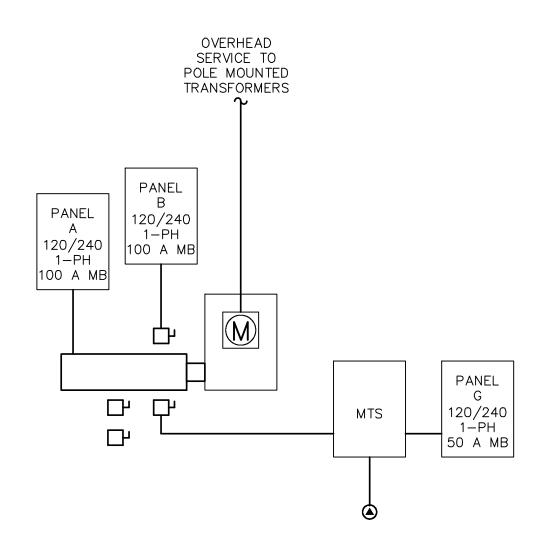

APPROXIMATION OF EXISTING 1-LINE DIAGRAM FOR REFERENCE ONLY. ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS.

EXISTING 1-LINE DIAGRAM E1.0 120/240 VOLT, 1-PHASE

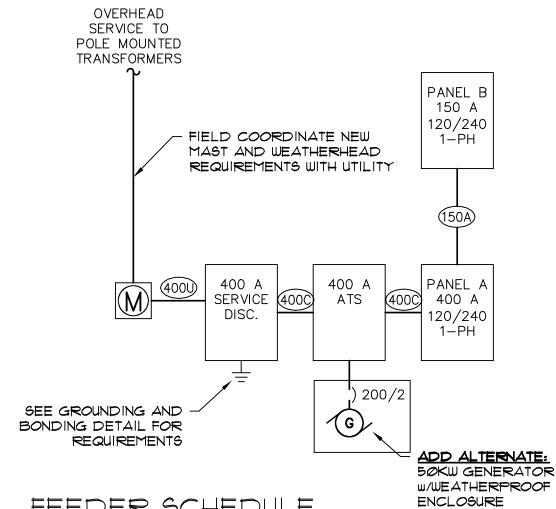

FEEDER SCHEDULE


(150A) 3 #3/0 AL PH, #4 AL GRD, 2" C

200A) 3 #250 AL PH, #4 AL GRD, 2" C

400C) 2 SETS - 3 #3/0 CU PH, #1/0 CU GRD, 2" C

400U 2 SETS - 3 #3/0 CU PH, 2" C

2 NEW 1-LINE DIAGRAM E1.0 / 120/240 VOLT, 1-PHASE



DETAIL NOTES

- #1/0 KCMIL CU MAIN BONDING JUMPER AND EQUIPMENT BONDING JUMPER PER NEC 250.28(D) AND 250.102(C)
- 2 #1/0 KCMIL CU GROUNDING ELECTRODE SYSTEM JUMPER PER NEC 250.52(A)(1,3
- 3 #6 CU TO ROD, PIPE, OR PLATE ELECTRODES PER NEC 250.66(A)
- 4 #4 CU TO CONCRETE ENCASED ELECTRODE PER NEC 250.52(A)(3) AND 250.66(B)
- WHERE REQUIRED, BOND PIPING SYSTEMS AND EXPOSED STRUCTURAL STEEL PER NEC





333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com





G S

SIDI

CONSTRUCTION

REVISIONS: # DATE DESCRIPTION

DATE: MAY 2025

SHEET TITLE:

ELECTRICAL PLAN SYMBOLS & SCHEDULES

E1.1 SCALE: 3/16" = 1'-0"

PROJECT NOTES

ALL REQUIREMENTS. SEE NEW PLANS

- WORK SHOWN ON PLAN IS BASED ON AVAILABLE INFORMATION AT THE TIME OF DESIGN. FIELD COORDINATE SEISMIC UPGRADE REQUIREMENTS WITH ARCHITECTURAL AND STRUCTURAL. CONTRACTOR IS TO FIELD YERIFY EXISTING CIRCUITING AND INSTALLATION.
- 2. CONTRACTOR SHALL COORDINATE AND PERFORM NECESSARY ELECTRICAL DEMOLITION WORK ASSOCIATED WITH ALL ITEMS AND EQUIPMENT TO BE REMOVED.
- 3. CONFIRM THAT ALL EXISTING DEVICES AND EQUIPMENT PLANNED FOR REUSE ARE IN GOOD OPERATING CONDITION. UNSUITABLE ITEMS SHALL NOT BE REUSED. RETURN ALL OTHER ITEMS SUITABLE FOR REUSE TO OWNER.
- 4. WIRING WHICH SERVES USABLE EXISTING OUTLETS SHALL BE REROUTED AND RESTORED CLEAR OF CONSTRUCTION. MAINTAIN ELECTRICAL CONTINUITY OF EXISTING SYSTEM. REPAIR AND RECONDITION ASSOCIATED SURFACES TO MATCH ADJACENT SURFACES. VERIFY EXACT LOCATIONS IN THE FIELD.

333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com





SIDI


CONSTRUCTION # DATE DESCRIPTION

DATE: MAY 2025 SHEET TITLE:

ELECTRICAL PLAN DEMOLITION

Copyright © 2025

HGE ARCHITECTS,

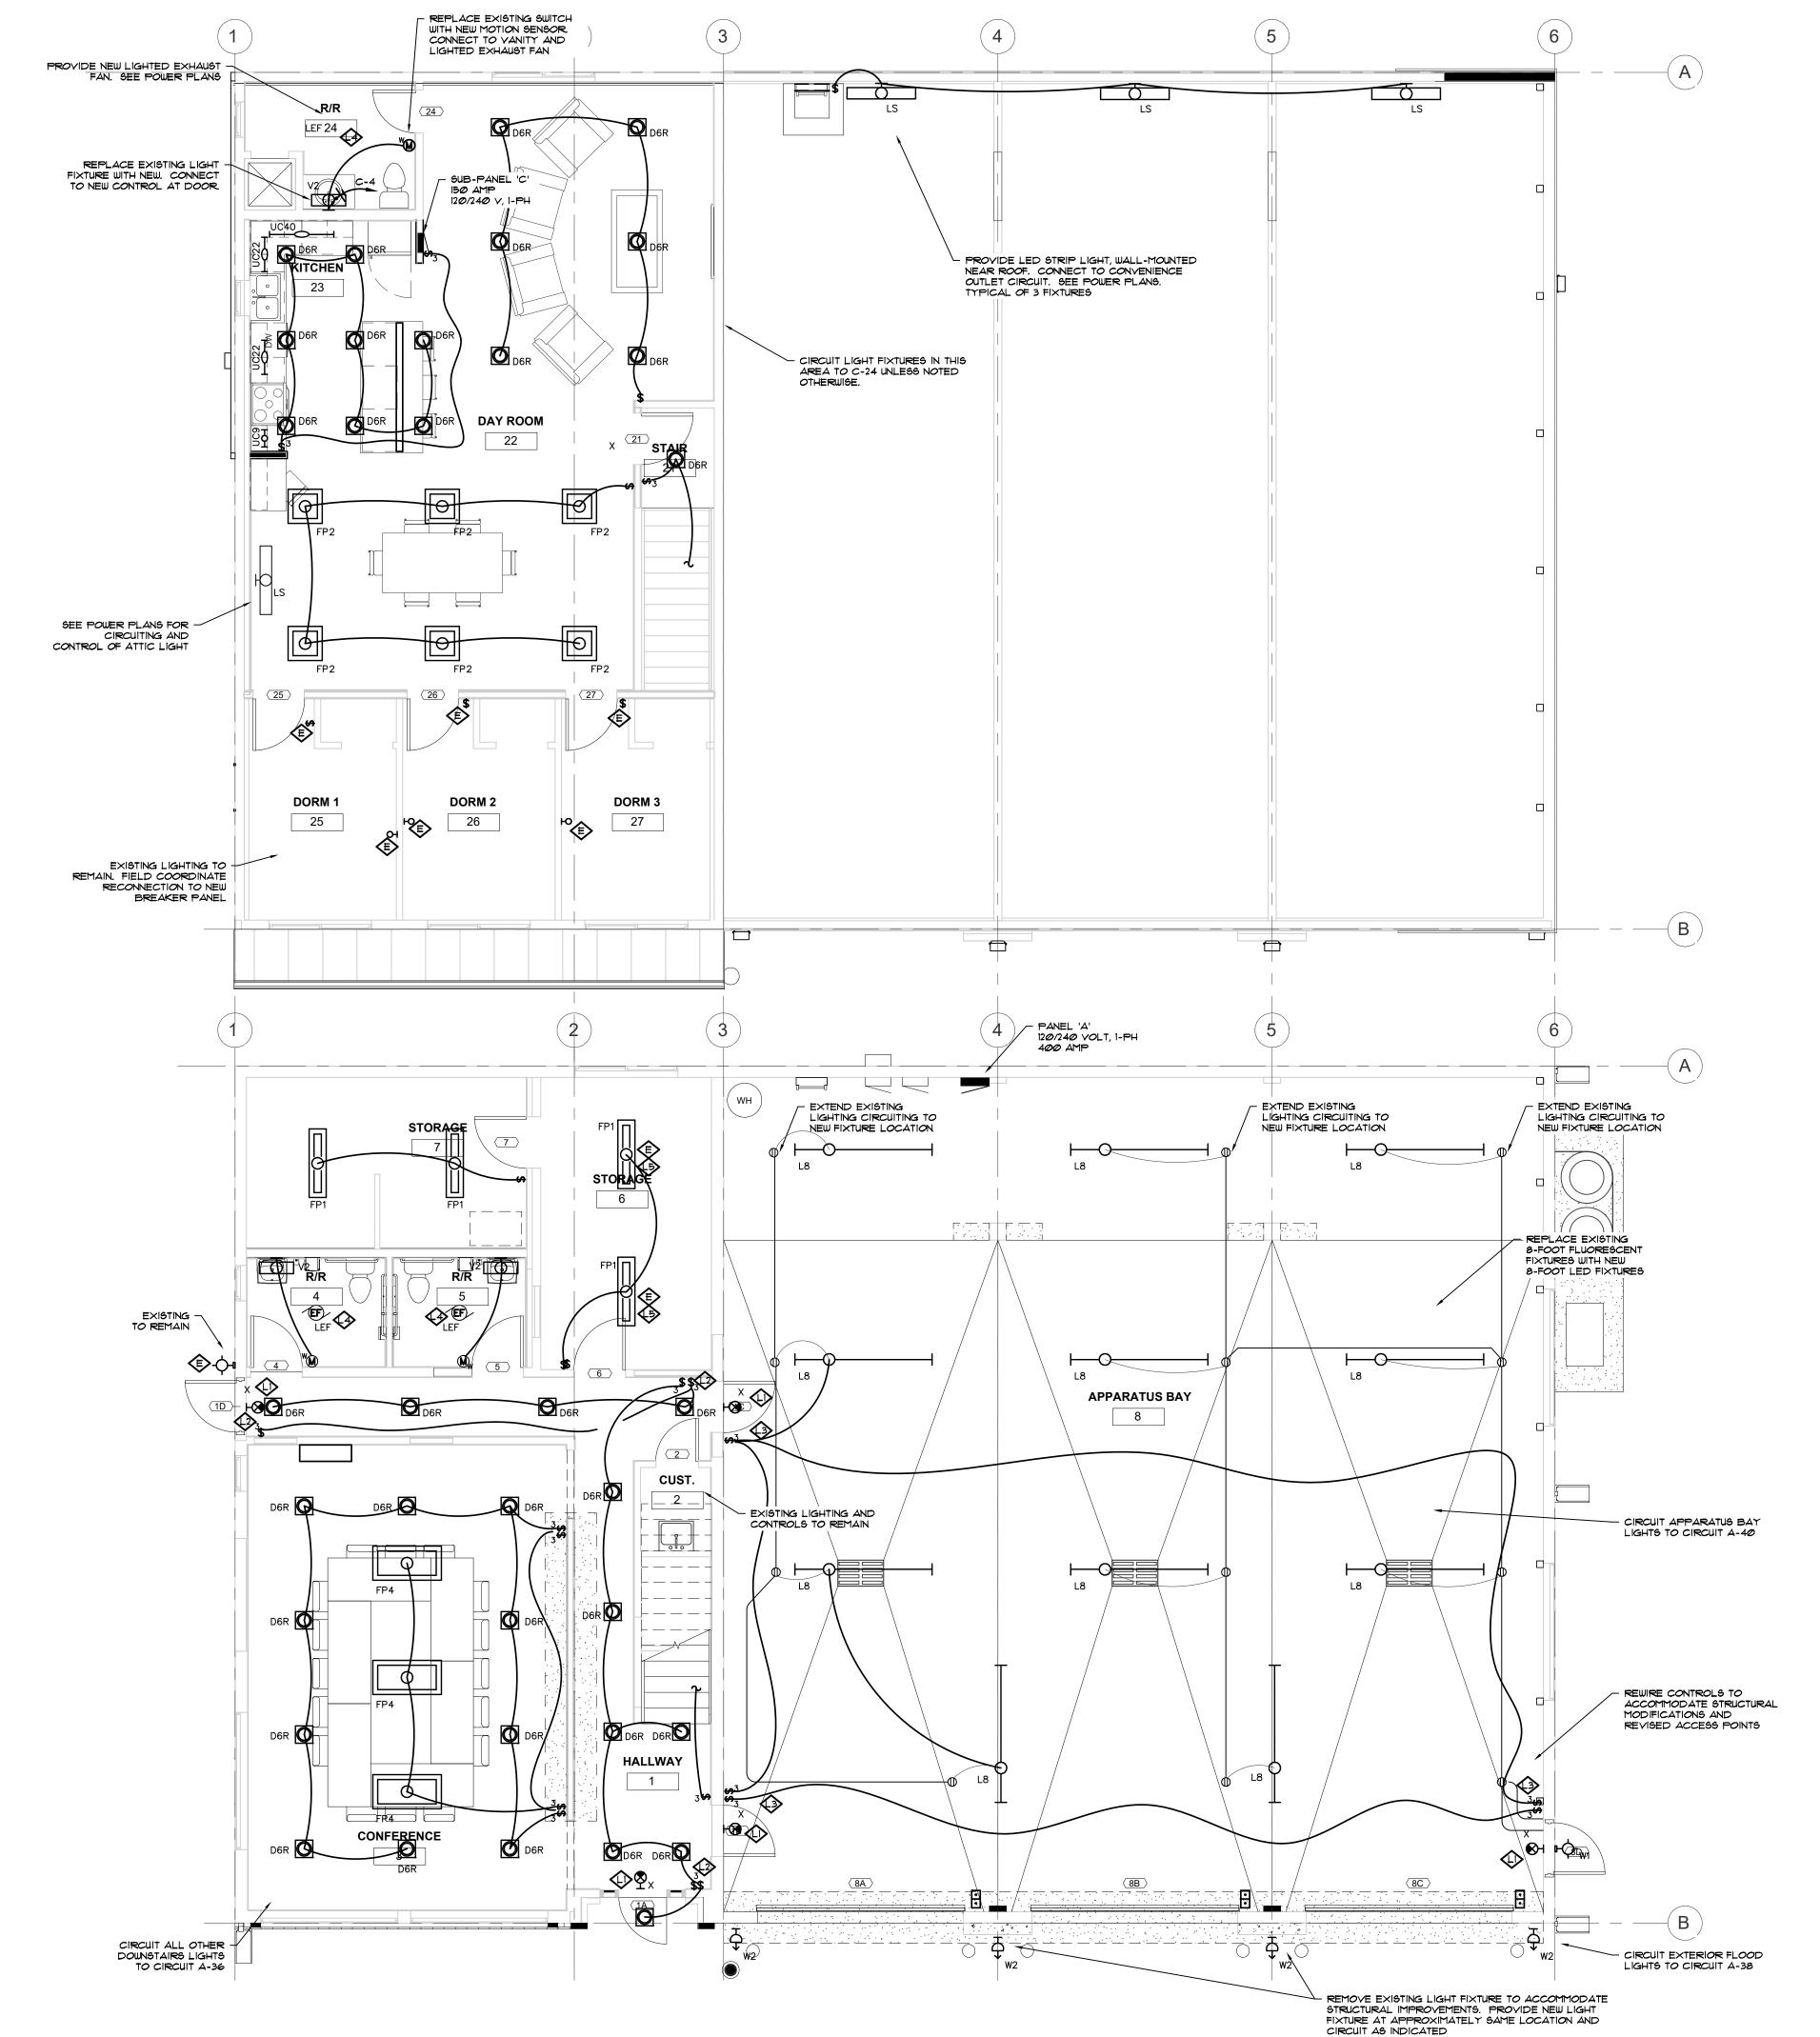

NAME	MANUFACTURER		SCHEDULE DESCRIPTION
	LITHONIA	+>n=	
D6R / D6RE		TYPE: TRIM:	6" LED RECESSED DOWNLIGHT
/ DORE	LDN6 35/2000 L06 AR LD MVOLT		SELF FLANGED, CLEAR DIFFUSE
		MOUNTING:	RECESSED - VERIFY CEILING TYPE
		D6E:	ADD EMERGENCY BATTERY PACK
		LAMPS:	LED 3500K, 2000 LUMENS, 23 WATTS
D6W	LITHONIA	TYPE:	6" LED CANLESS DOWNLIGHT
	WF6 LL LED 27K3ØK35K 9ØCRI MW	TRIM:	MATTE WHITE
		MOUNTING:	RECESSED - VERIFY CEILING TYPE
		LAMPS:	LED 3000K, 900 LUMENS, 10 WATTS
L8	LITHONIA	TYPE:	8-FOOT LED STRIP
	CSS L96 ALO4 MYOLT SWW3 80CRI	HOUSING:	DIE-FORMED 22 GAUGE, PRIMED COLD ROLLED STEEL
	CORD & PLUG	FINISH:	WHITE POLYESTER ENAMEL W/POLYCARBONATE LENS
		MOUNTING:	SURFACE
		FINISH:	WHITE POLYESTER ENAMEL
		LAMPS:	LED 3500K, 8000 LUMENS, 64 WATTS
FPI	LITHONIA	TYPE:	1 × 4 LED FLAT PANEL
111	CPANL 1X4 24/33/44LM 35K M4 2X2CFMK	HOUSING:	ALUMINUM FRAME
	CPANE 1X4 24/33/44EI I 35K I I4 2X2CFI IK		
		FINISH:	WHITE POLYESTER COATING
		MOUNTING:	SURFACE - CEILING
		LAMPS:	LED, 82 CRI, 3,500K, 3,300 LUMEN (20/28/39 WATTS)
FP2	LITHONIA	TYPE:	2 × 2 LED FLAT PANEL
	CPANL 2X2 ALOI SWWT M4	HOUSING:	ALUMINUM FRAME
		FINISH:	WHITE POLYESTER COATING
		MOUNTING:	SURFACE - CEILING
		LAMPS:	LED, 82 CRI, 3,500K, 3,300 LUMEN (31 WATTS)
FP4	LITHONIA	TYPE:	2 × 4 LED FLAT PANEL
	CPANL 2X4 40/50/60LM 35K M2 2X4CFMK	HOUSING:	ALUMINUM FRAME
		FINISH:	WHITE POLYESTER COATING
		MOUNTING:	SURFACE - CEILING
		LAMPS:	LED, 82 CRI, 3,500K, 5,000 LUMEN (32/42/52 WATTS)
LEF	BANAGONIC	TYPE:	· · · · · · · · · · · · · · · · · · ·
LEF	PANASONIC		LIGHTED EXHAUST FAN
	FV-1115VKL2	OPERATION:	50 CFM CONTINUOUS / 130 CFM OCCUPIED
	FY-VS15VKI MULTI SPEED MODULE	FINISH:	WHITE POWDER COAT
	FV-MSVKI MOTION SENSOR	MOUNTING:	SURFACE - WALL
		LAMPS:	LED, 3,000K, 700 LUMEN (10+30 WATTS)
LS	LITHONIA - Z SERIES	TYPE:	LED STRIP LIGHT
	ZLID L48 SMR 5000LM FST MYOLT 35K	HOUSING:	COLD-ROLLED STEEL, ACRYLIC LENS
	80CRI WH	FINISH:	WHITE POWDER COAT
		MOUNTING:	SURFACE - WALL
		LAMPS:	LED, 3,500K, 5,000 LUMEN (41 WATTS)
UCxx	KELVIX - SEE PLANS FOR MODELS	TYPE:	UNDER CABINET LIGHT
	UC9-3040-010V-120277-WH	MOUNTING:	SURFACE - UNDER CABINET
	UC22-3040-010Y-120277-WH	FINISH:	WHITE
	UC40-3040-010Y-120277-WH	CONTROL:	CONTROL W/SEPARATE WALL SWITCH
		LAMPS:	LED , 3,000 K
	LITHONIA	TYPE:	24" VANITY LIGHT
¥			
	FMVTSL 24IN MVOLT 30K 90CRI BN M4		SURFACE - WALL
		FINISH:	BRUSHED NICKEL
		LENS:	WHITE ACRYLIC DIFFUSER
		LAMPS:	LED 3,000K, 1,300 LUMEN, 9.5 WATTS
W1	LITHONIA	TYPE:	LED WALL PACK
	WDGE2 LED P13 30K 80CRI VF MVOLT	HOUSING:	DIE-CAST ALUMINUM
	SRM DDBXD	FINISH:	DARK BRONZE
		MOUNTING:	SURFACE - WALL
		LAMPS:	LED, 3,000K, 1,200 LUMEN (10 WATTS)
W2	LITHONIA	TYPE:	LED WALL PACK
WZ			
	WDGE2 LED P5 30K 80CRI VF MVOLT	HOUSING:	DIE-CAST ALUMINUM
	SRM DDBXD	FINISH:	DARK BRONZE
		MOUNTING:	SURFACE - WALL
		LAMPS:	LED, 3,000K, 6,000 LUMEN (48 WATTS)
×	LITHONIA - ECBR LED M6	TYPE:	LED EXIT SIGN WITH EMERGENCY LIGHT BAR
		HOUSING:	THERMOPLASTIC OR POLYCARBONATE
		FINISH:	WHITE HOUSING WITH RED LETTERS
		MOUNTING:	FIELD VERIFY MOUNTING
		LAMPS:	LED
		BATTERY:	NI-CAD BATTERY
		NOTE:	DOUBLE FACE AS NECESSARY

SHEET NOTES

EASTSIDE FIRE STATION

1. UNLESS NOTED OTHERWISE, PROVIDE NEW LIGHT FIXTURES, CONTROLS AND CIRCUITING FOR ALL LIGHTING IN RENOVATED SPACES.

ALL FIXTURES ARE 120 YOLT UNLESS NOTED OTHERWISE

- 2. APPARATUS BAY LIGHTING: EXISTING APPARATUS BAY LIGHTING
 CONSIST OF 8-FOOT CORD & PLUG FLUORESCENT FIXTURES. CONDUIT AND
 RECEPTACLES ARE SURFACE-MOUNTED. REPLACE EXISTING
 FLUORESCENT FIXTURES WITH NEW LED FIXTURES AS INDICATED. MODIFY
 CONTROLS AND CONTROL CIRCUITING AS INDICATED. EXTEND LIGHTING
 INTO RENOVATED AREA AND PROVIDE NEW FIXTURES.
- 3. EXTERIOR LIGHTING: REPLACE ALL EXTERIOR LIGHTS WITH NEW.
 PROVIDE NEW PHOTOCELL CONTROL. CONNECT EXTERIOR LIGHTS TO
 CIRCUIT A-38 IN NEW PANEL. SOME FIXTURES REQUIRE REMOVAL AND
 CONDUIT, CONDUCTOR AND J-BOX MODIFICATIONS TO ACCOMMODATE
 STRUCTURAL MODIFICATIONS. FIELD COORDINATE WITH ARCHITECTURAL
 AND STRUCTURAL PLANS.

KEYED NOTES

- EXIT SIGNS AND BATTERY-PACK NIGHT LIGHTS: CONNECT TO UNSWITCHED LIGHTING CIRCUIT SERVING THIS AREA.
- FIELD COORDINATE REQUIREMENTS TO PROVIDE 3-WAY SWITCHING OF NEW LIGHT FIXTURES IN EXISTING HALLWAYS.
- MODIFY APPARATUS BAY LIGHTING CONTROL AS REQUIRED TO ACCOMMODATE NEW 3-WAY CONTROL LOCATIONS AND GROUPS.
- NEW VARIABLE SPEED, LIGHTED EXHAUST FAN WITH MOTION CONTROL.
 FAN TO RUN CONTINUOUSLY ON LOW AND INCREASE SPEED WITH MOTION
 CONTROL. LIGHT TO BE MOTION CONTROLLED. CONNECT TO
 UNSWITCHED LIGHTING CIRCUIT SERVING THIS AREA.
- REPLACE EXISTING STORAGE LIGHT FIXTURE WITH NEW LED FIXTURE AS INDICATED.



333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com

www.hge1.com

DOUBLE 'E'
ENGINEERING, LL
Myrtle Point, Oregon
www.ee-engineering.com





IIDE FIRE STATION SEISMIC GRANT UPGRADE

ASTSIDE FIRE S

OR

CONSTRUCTION

REVISIONS:
DATE DESCRIPTION

DATE: MAY 2025

SHEET TITLE:

ELECTRICAL PLAN

LIGHTING

E20



DOOR CONTROLLER

REPLACE EXISTING RECEPTACLE AND RE-FEED FROM NEW PANEL.

FIELD COORDINATE FINAL CIRCUIT

WALL MOUNTED TY

E2.0 | SCALE: 3/16" = 1'-0"

SEE DETAIL


₹

CONFERENCE

3

\ ELECTRICAL PLAN - POWER & SIGNAL

HALLWAY

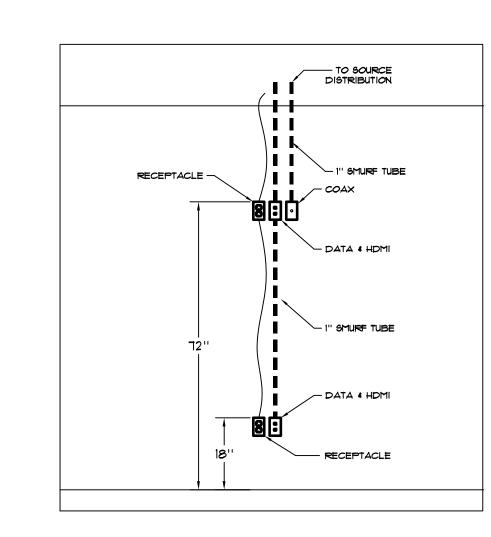

2 A/V DETAIL - WALL MOUNTED TV E2.0 DAYROOM & TRAINING ROOM

- I. UNLESS SPECIFICALLY NOTED AS EXISTING, ASSUME THAT ALL DEVICES SHOWN ARE NEW.
- 2. FIELD COORDINATE REQUIREMENTS TO RECONNECT EXISTING DEVICES TO NEW ELECTRICAL PANEL - CIRCUIT AS INDICATED.
- 3. DATA: EXTEND DATA CABLING FROM DATA RACK IN STORAGE TO EACH LOCATION INDICATED BY DATA TRIANGLE.

KEYED NOTES

- VIDEO WALL: SEE A/V DETAIL FOR WALL MOUNTED TY. PROVIDE RECEPTACLES, COAX TELEVISION, DATA AND HDMI AT VIDEO WALL. PROVIDE RECESSED BOX AT UPPER LOCATION TO ACCOMMODATE LOW-PROFILE WALL MOUNTED TELEVISION.
- PROVIDE CODE COMPLIANT SMOKE DETECTOR WITH NOTIFICATION FOR SLEEPING AREAS.
- EMERGENCY GARAGE DOOR OPENER CONTROL: REMOVE AND REINSTALL COMPLETELY TO ACCOMMODATE SEISMIC SUPPORT INSTALLATION. FIELD COORDINATE REQUIREMENTS WITH NEW GARAGE DOORS.

FIRE ALARM

- 1. PROVIDE A COMPLETE DESIGN-BUILD, CODE COMPLIANT, ADDRESSABLE FIRE ALARM SYSTEM FOR THE ENTIRE FIRE STATION. REPLACE EXISTING DEVICES AND CABLING.
- 2. DEVICES SHOWN SHOWN ON THE PLANS ARE IN ADDITION TO THE MINIMUM CODE COMPLIANT SYSTEM. CONTRACTOR MAY MODIFY FINAL LOCATIONS SO LONG AS THE INTENT IS MAINTAINED.
- 3. SLEEPING AREAS DETECTION AND NOTIFICATION SHALL BE PROVIDED WITH CARBON MONOXIDE DETECTION AS PROPANE MAY BE USED IN THE FACILITY FROM TIME TO TIME.

GENERATOR ALTERNATE

BASE BID:

1. PROVIDE ATS-ONLY AS A PART OF THE UTILITY SERVICE AND POWER DISTRIBUTION SYSTEM.


ADD ALTERNATE: . PROVIDE 50 KW PROPANE GENERATOR WITH WEATHERPROOF ENCLOSURE AND

- ALL ASSOCIATED APPURTENANCES (INCLUDING BATTERY CHARGER, WARMER, FREEZE PROTECTION, ETC.)
- 2. PROVIDE REMOTE ANNUNCIATOR 3. SEE SPECIFICATIONS



333 S. 4TH STREET COOS BAY, OR 97420 P: 541.269.1166 general@hge1.com www.hge1.com





SMIC

SID

CONSTRUCTION

REVISIONS: # DATE DESCRIPTION

DATE: MAY 2025 SHEET TITLE: **ELECTRICAL PLAN POWER & DATA**

E3.0